




	ELEVATOR AVAILABLE		DEFIBRILLATOR (A.E.D.)		FIRE PUMP
	ELEVATOR NOT AVAILABLE		DOMESTIC WATER SHUTOFF		GAS SHUT OFF VALVE
	ELECTRICAL		ELECTRIC SHUTOFF		REFUGE AREA
	HAZARDOUS EQUIPMENT		EMERGENCY TELEPHONE		SIAMESE/FIRE DEPT. CONNECTION
	SMOKE TOWER		FIRE ALARM ANNUNCIATOR		SPRINKLER CONTROL VALVE
	STAIRWELL		FIRE EXTINGUISHER		STANDPIPE/RISER
	TELEPHONE		1-1/2" FIRE HOSE CONNECTION		STAIRWELL
	VERTICAL OPENINGS		2-1/2" FIRE HOSE CONNECTION		VOICE CONTROL PANEL




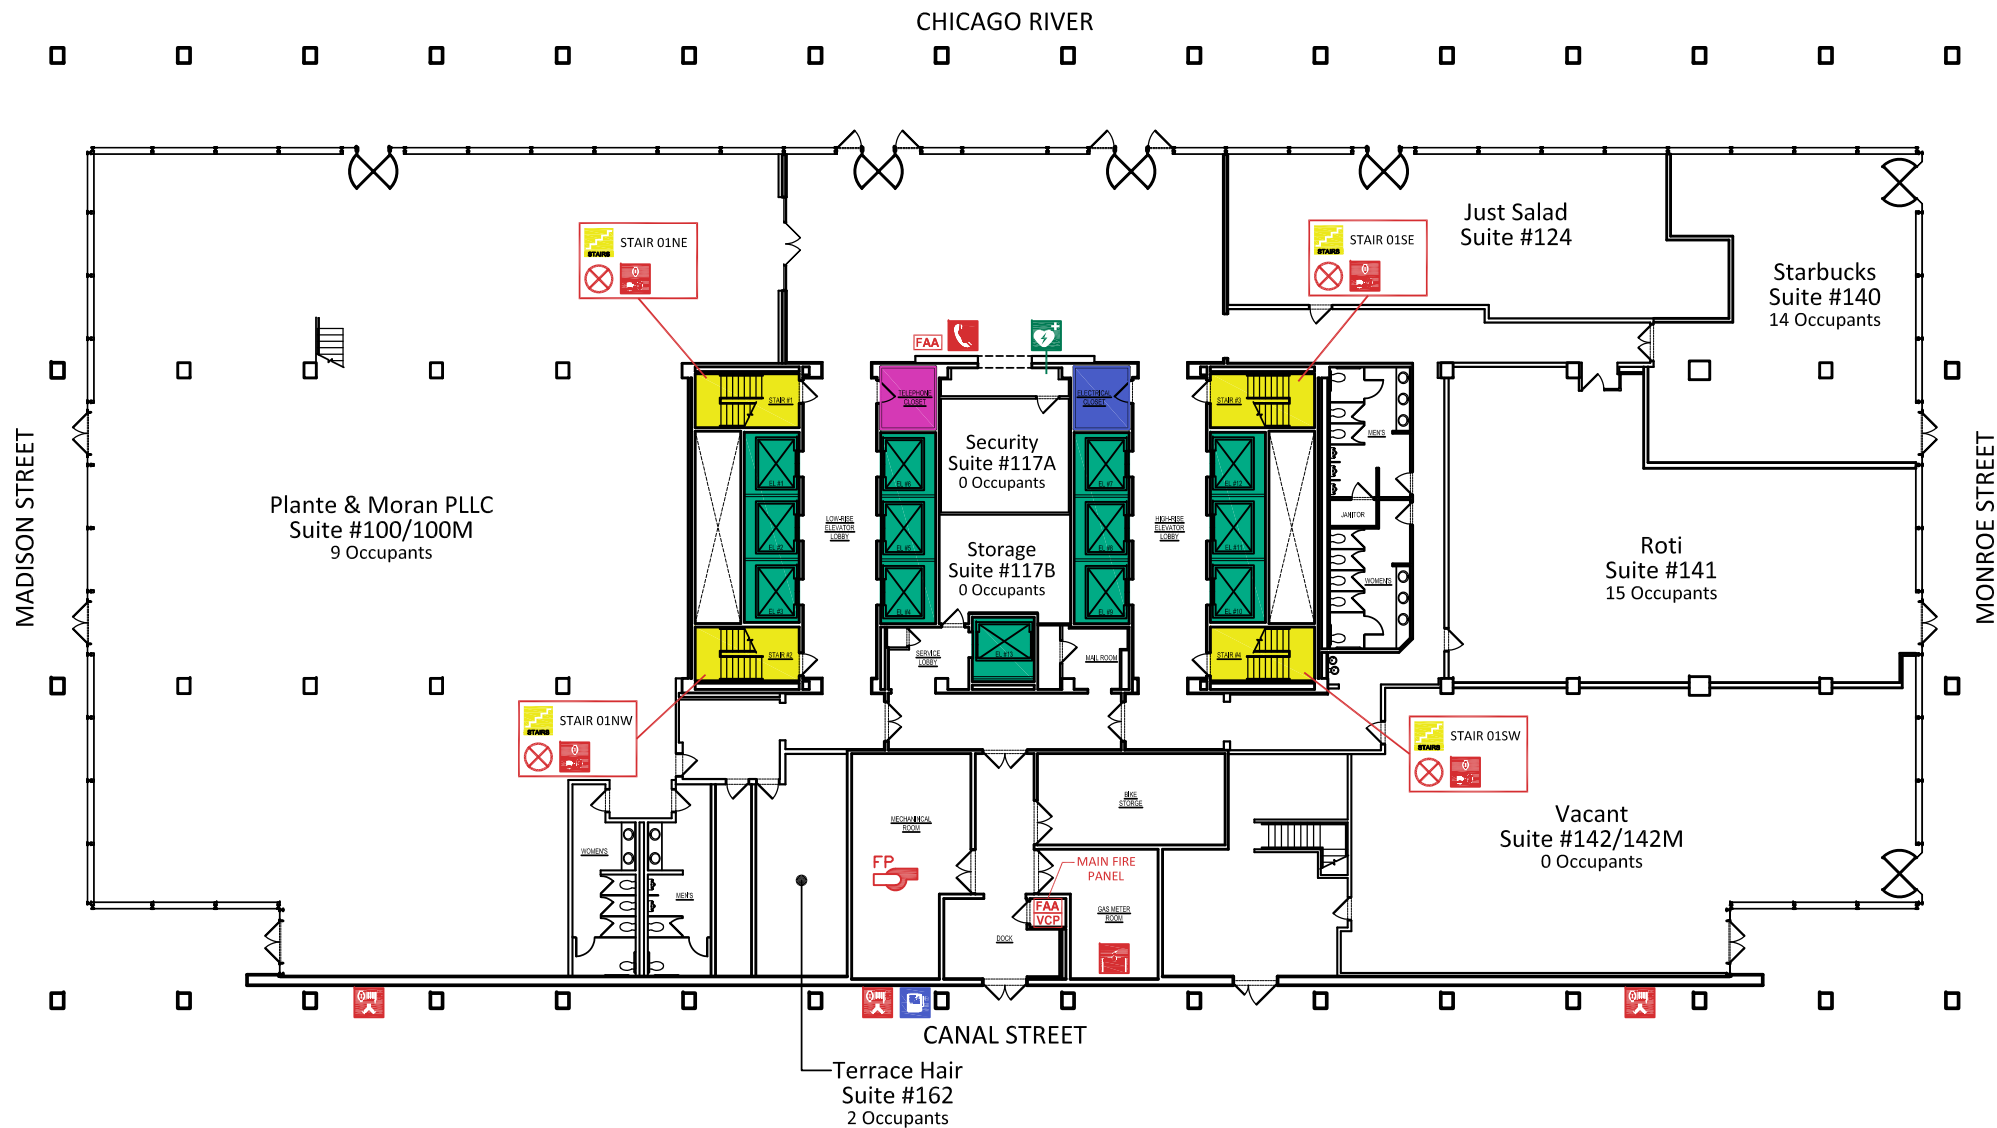

NOTE: FLOOR IS FULLY SPRINKLERED

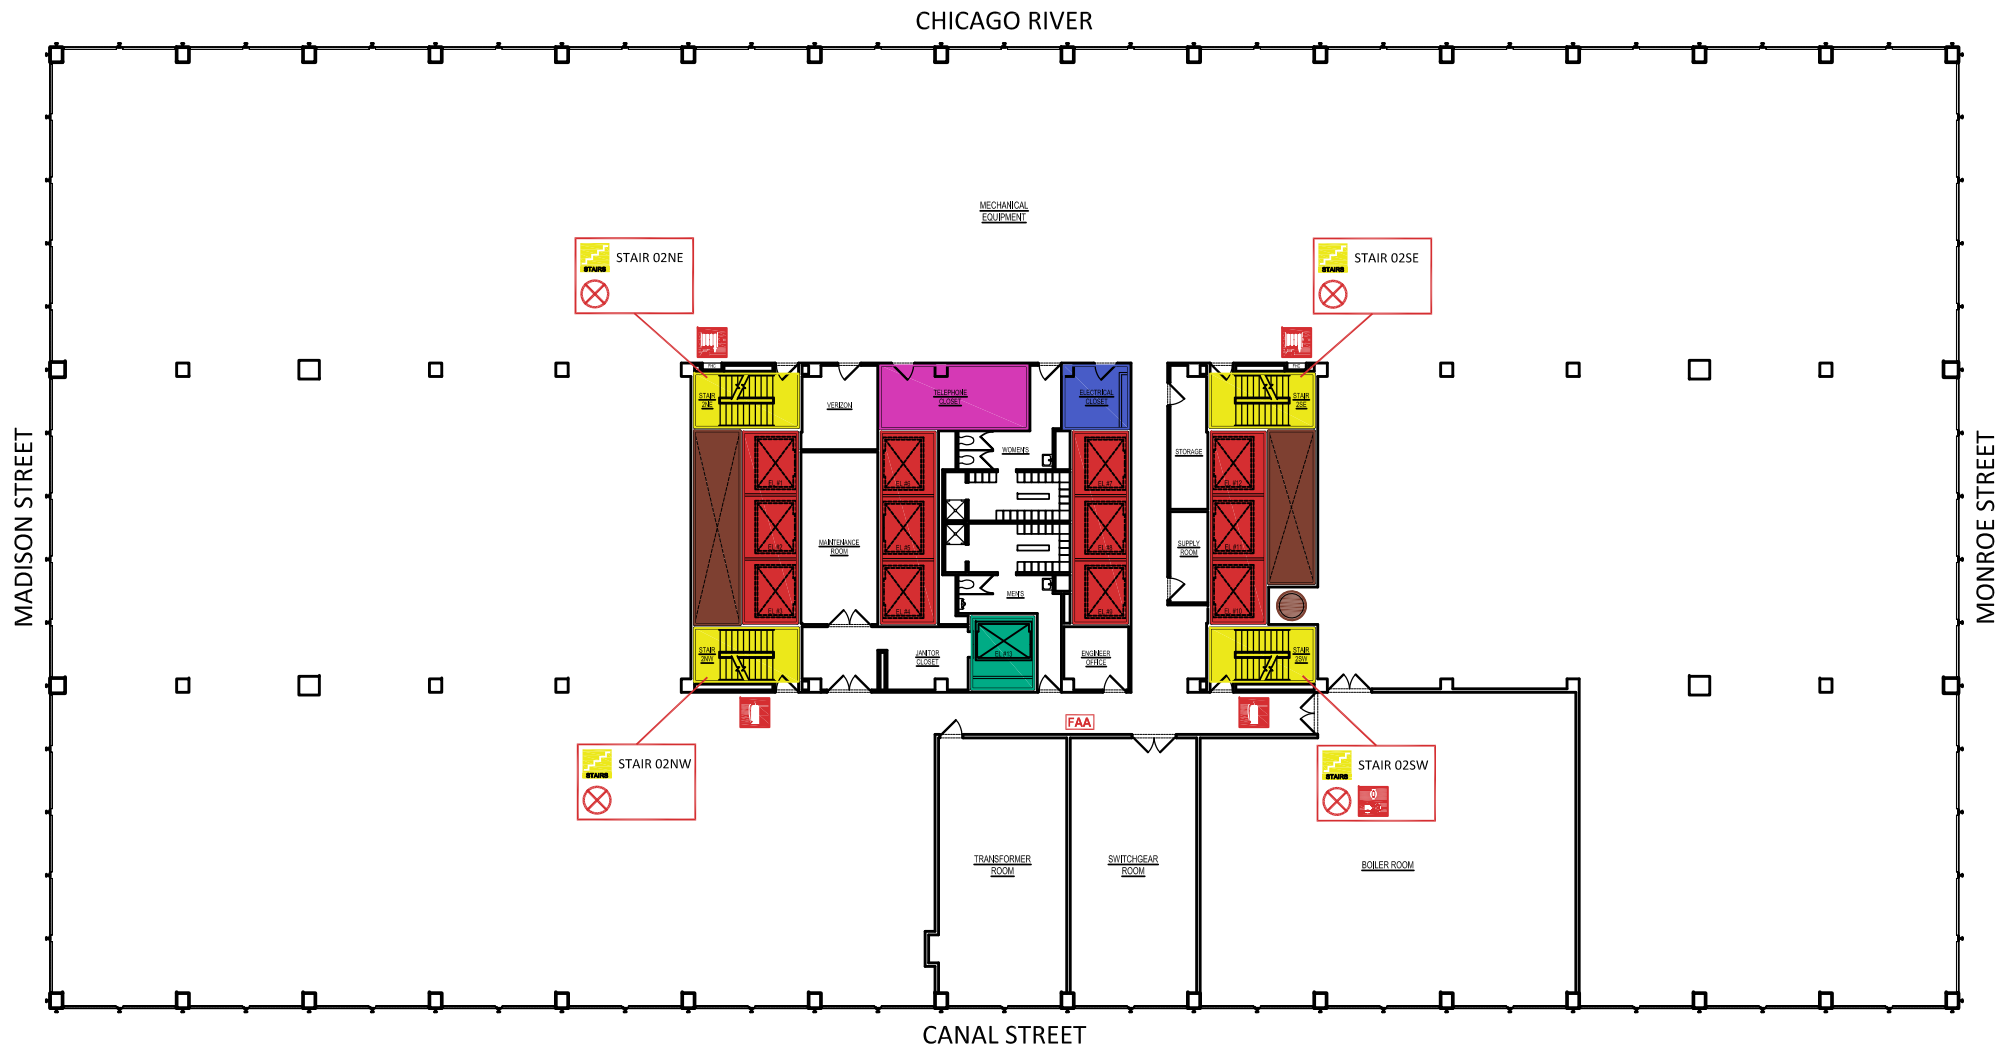


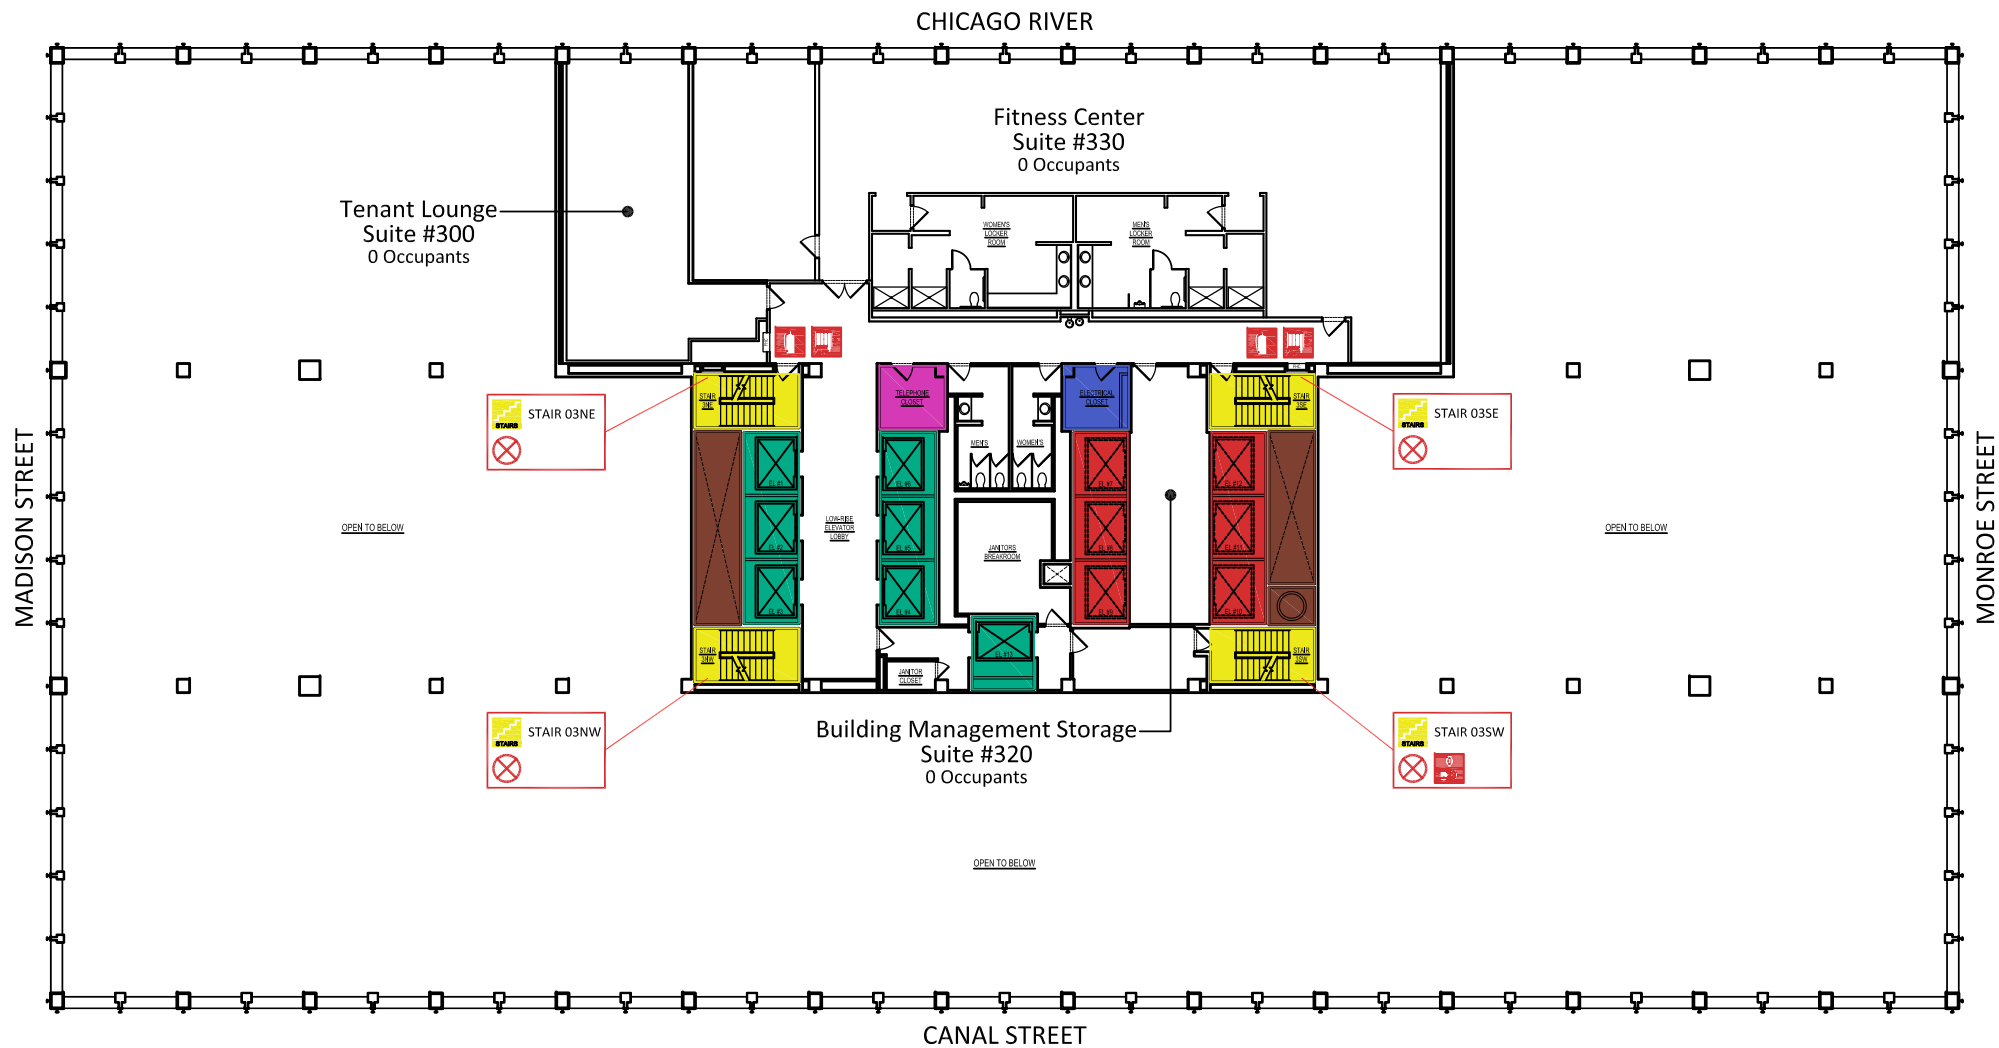


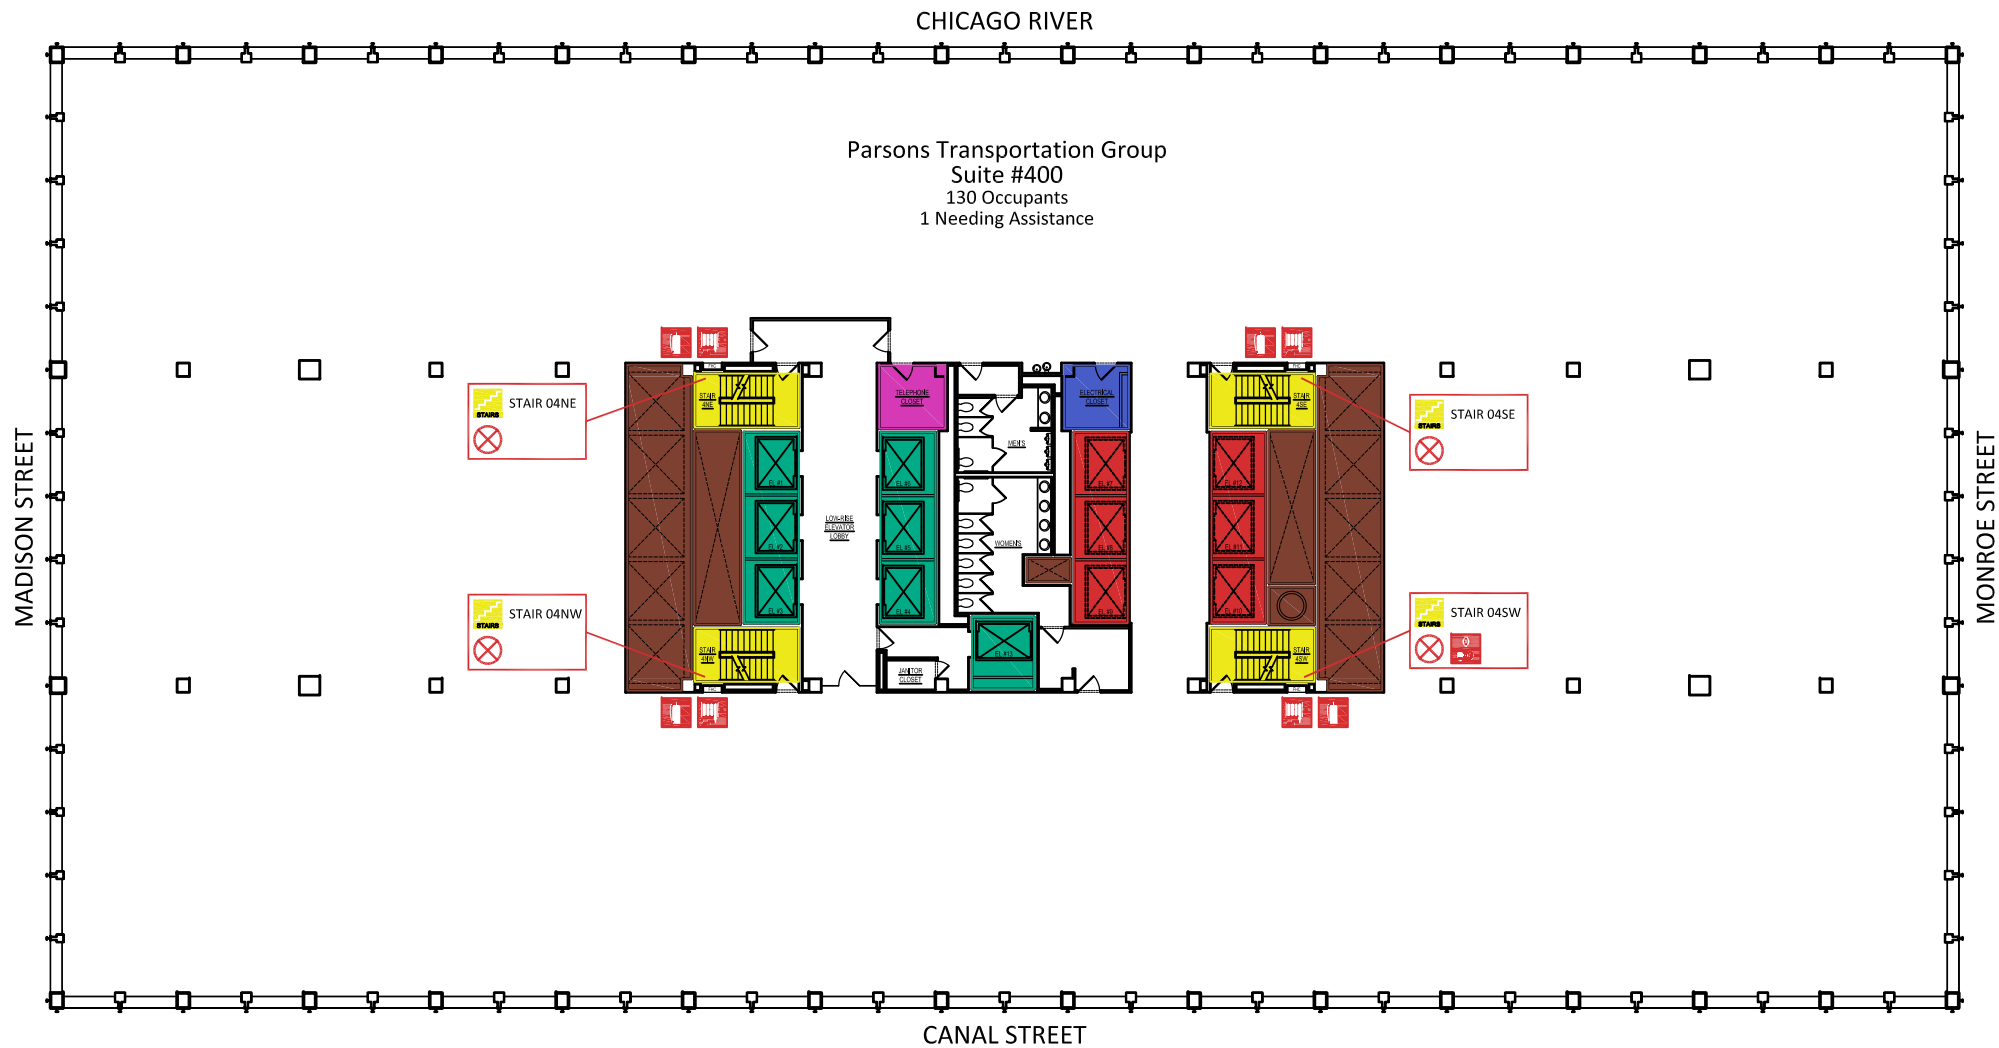



E*Trade Financial Corporation
Suite #500
175 Occupants




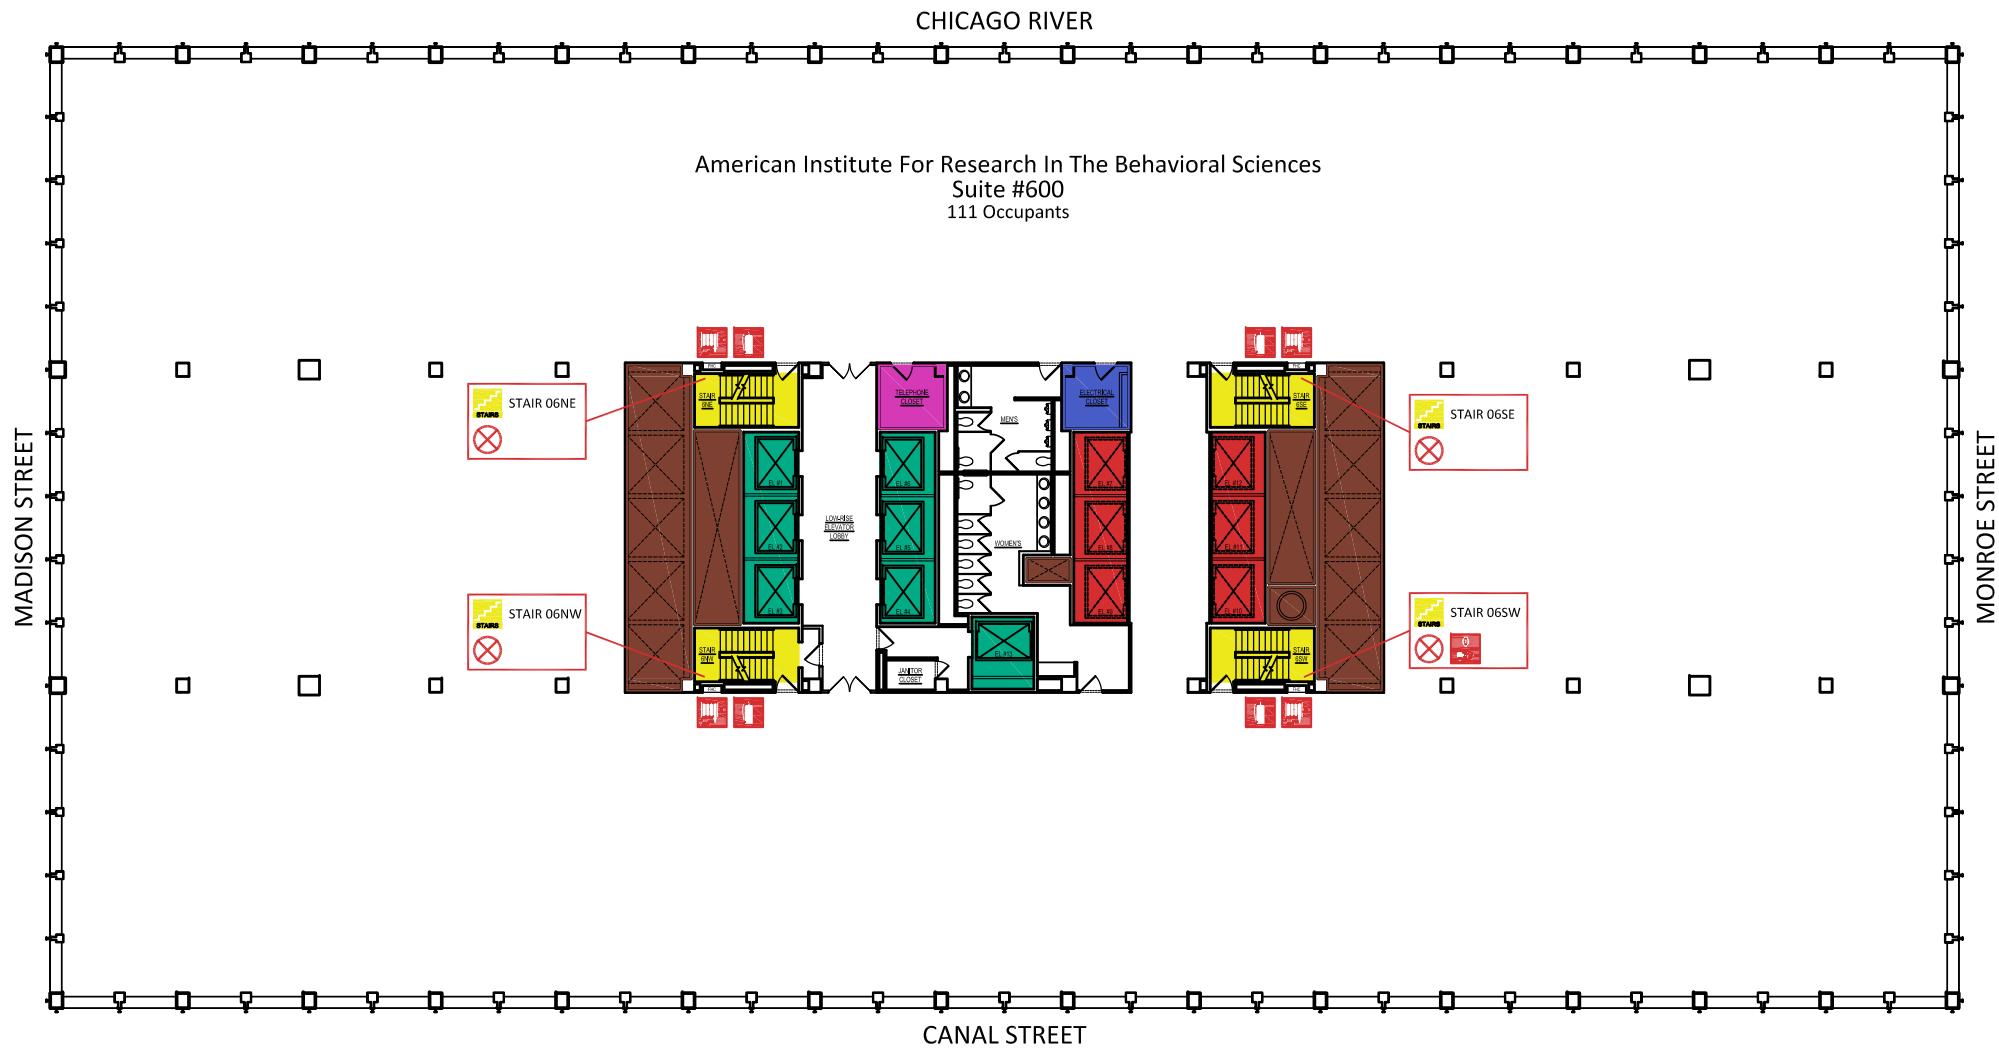


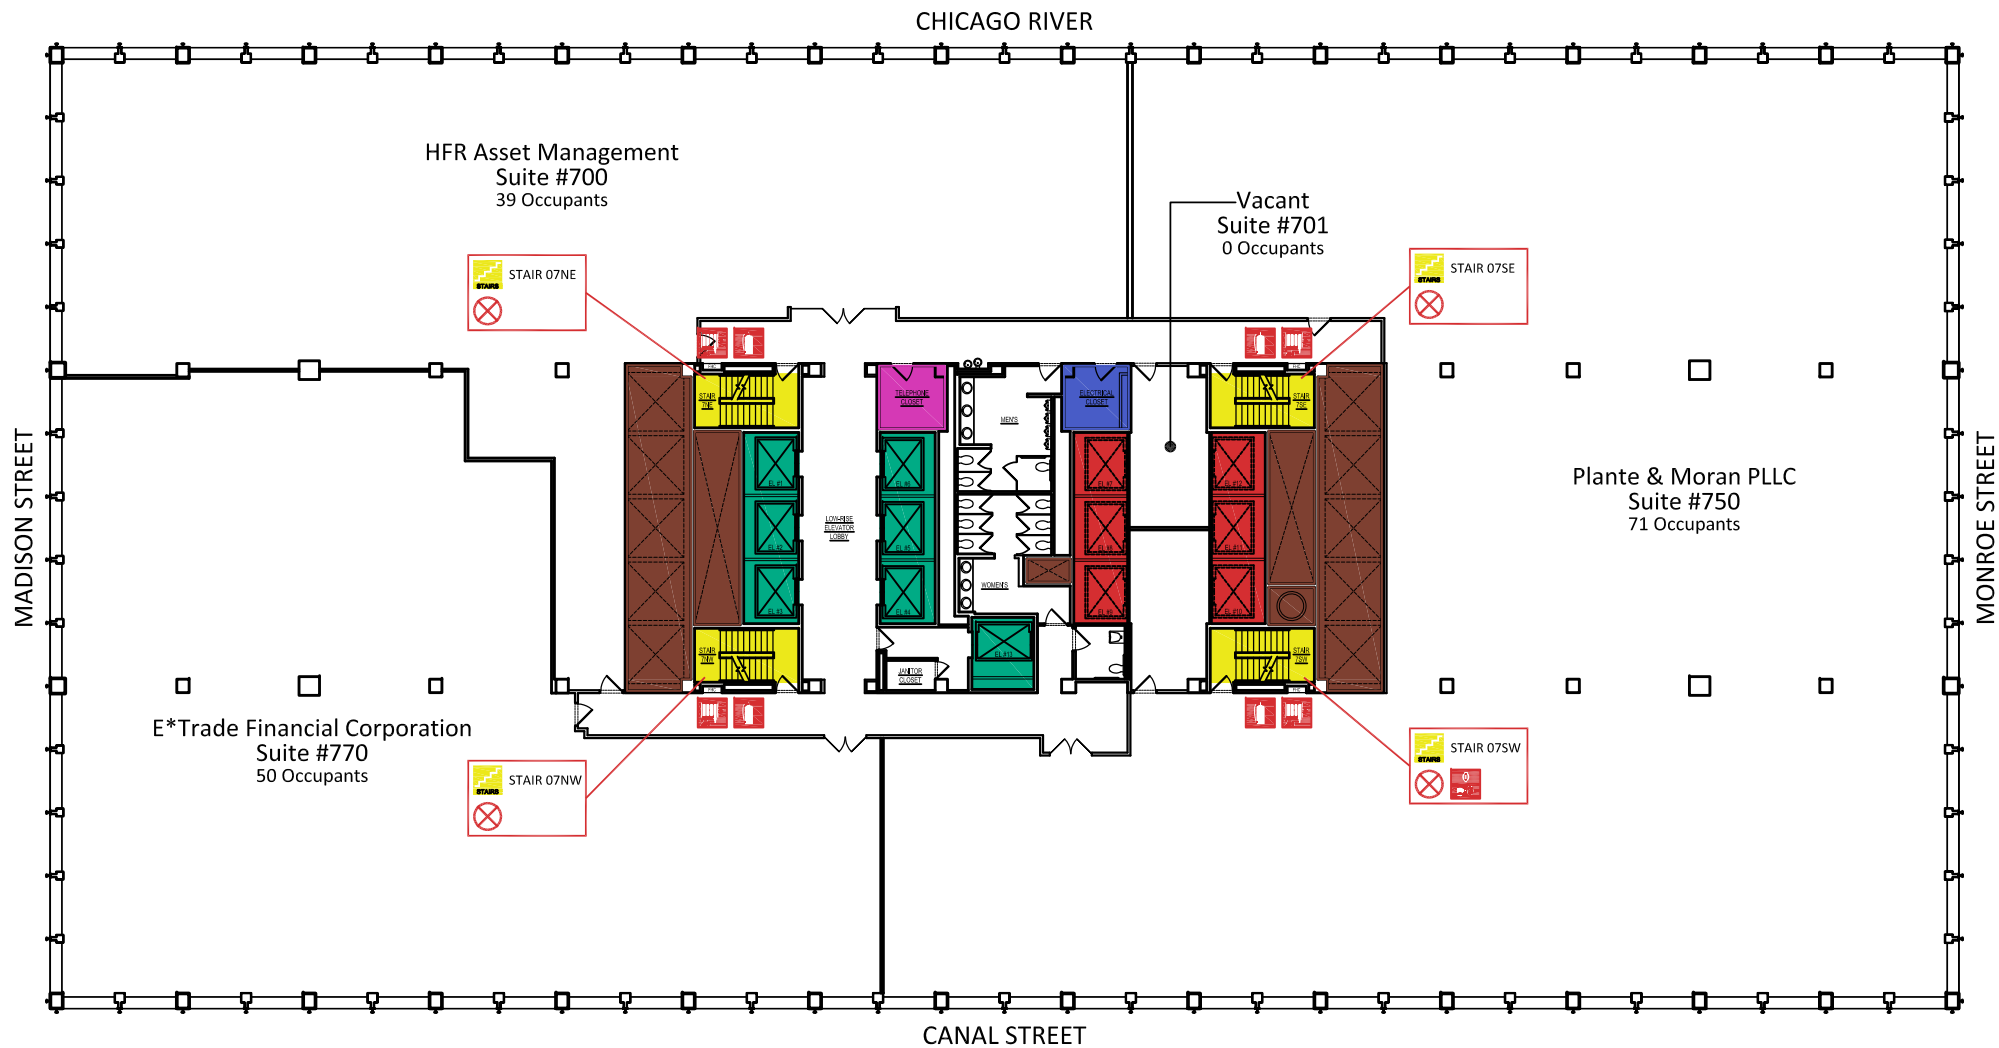


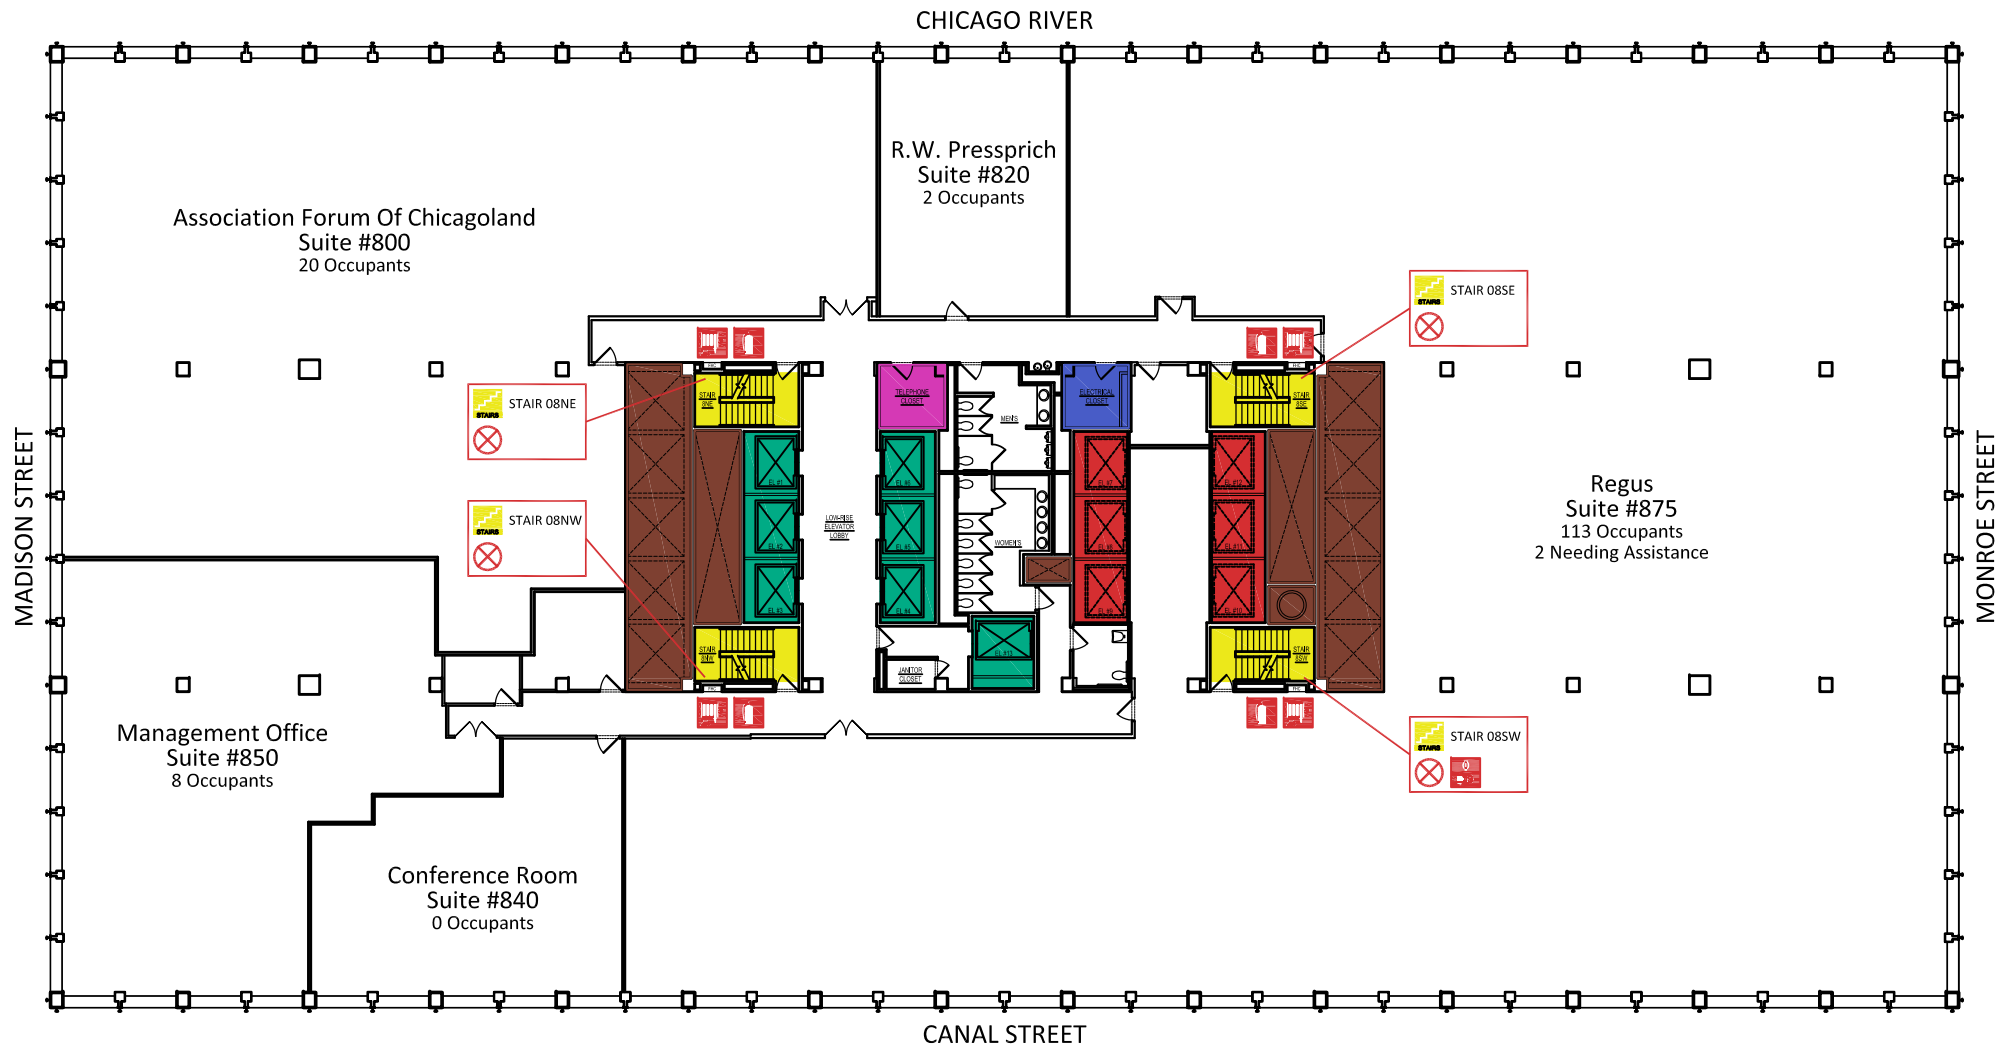


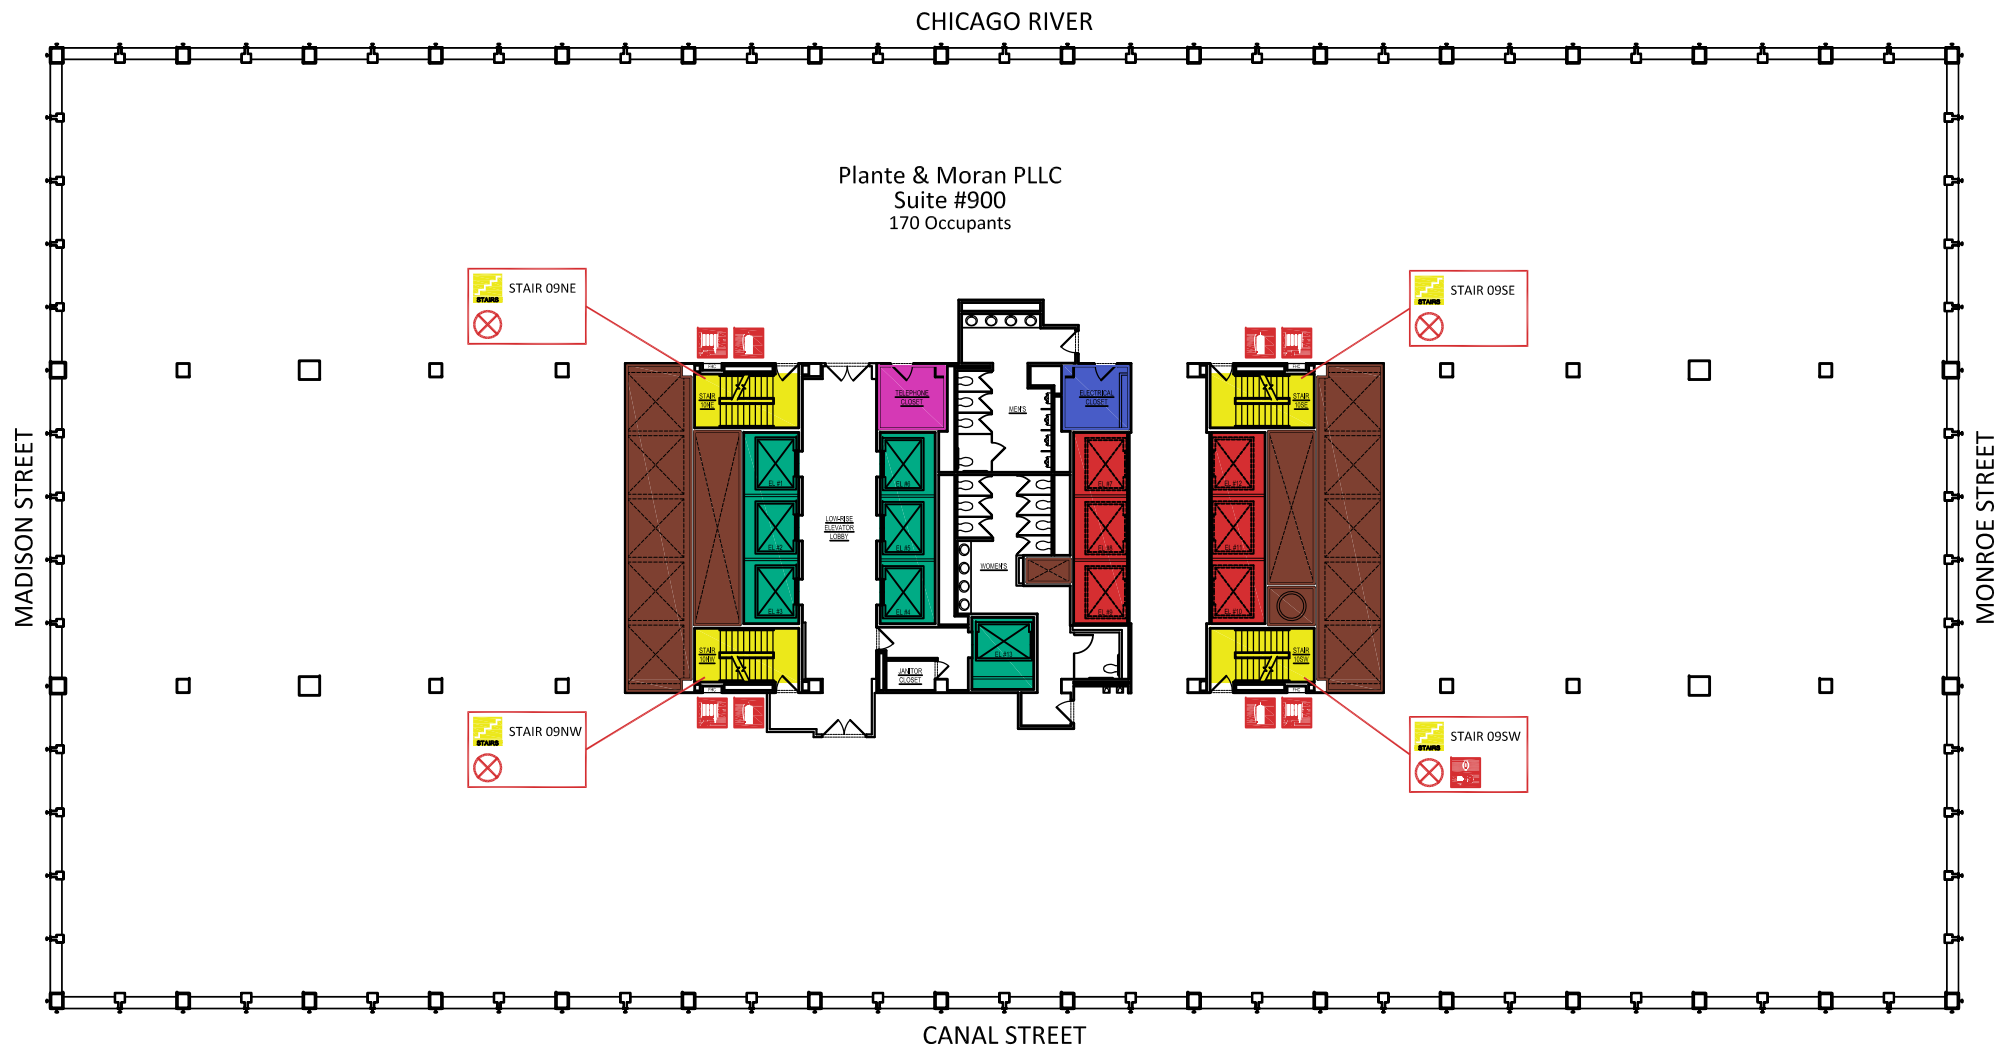


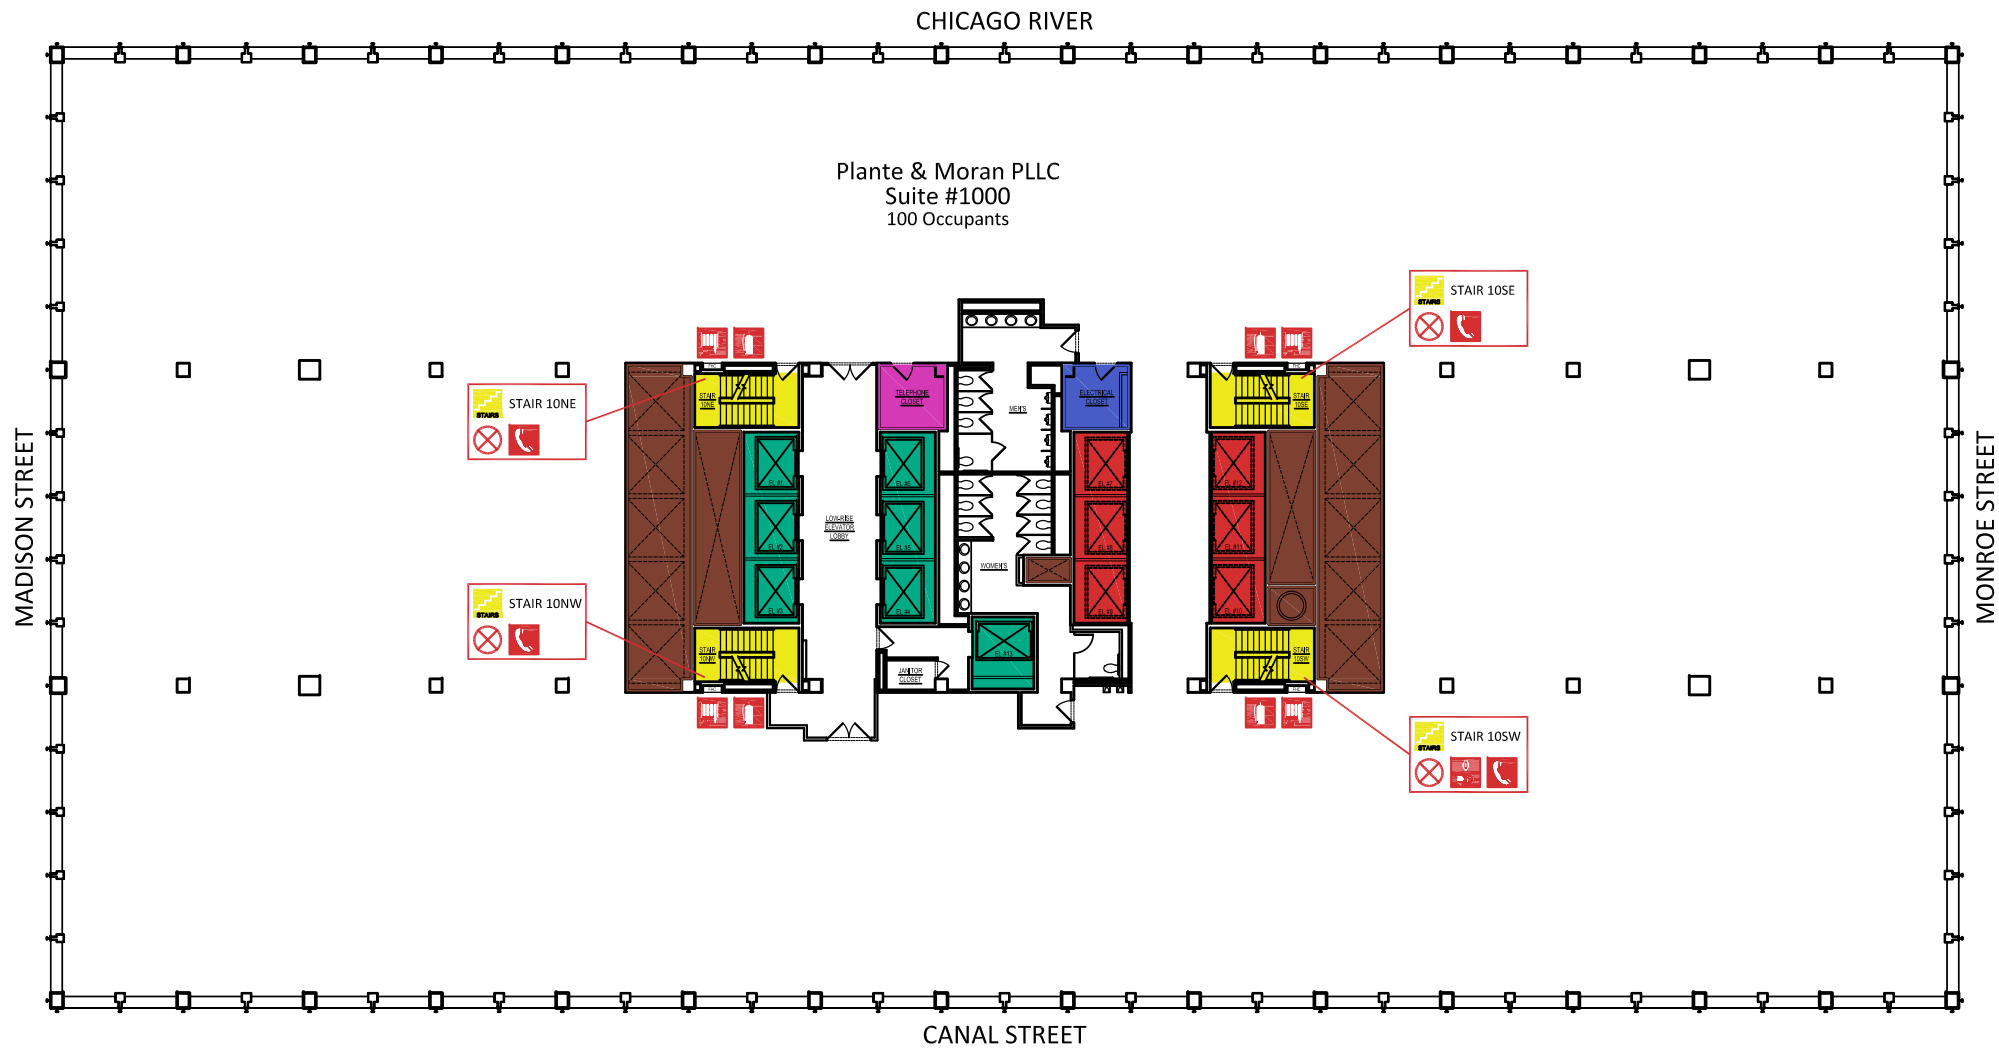


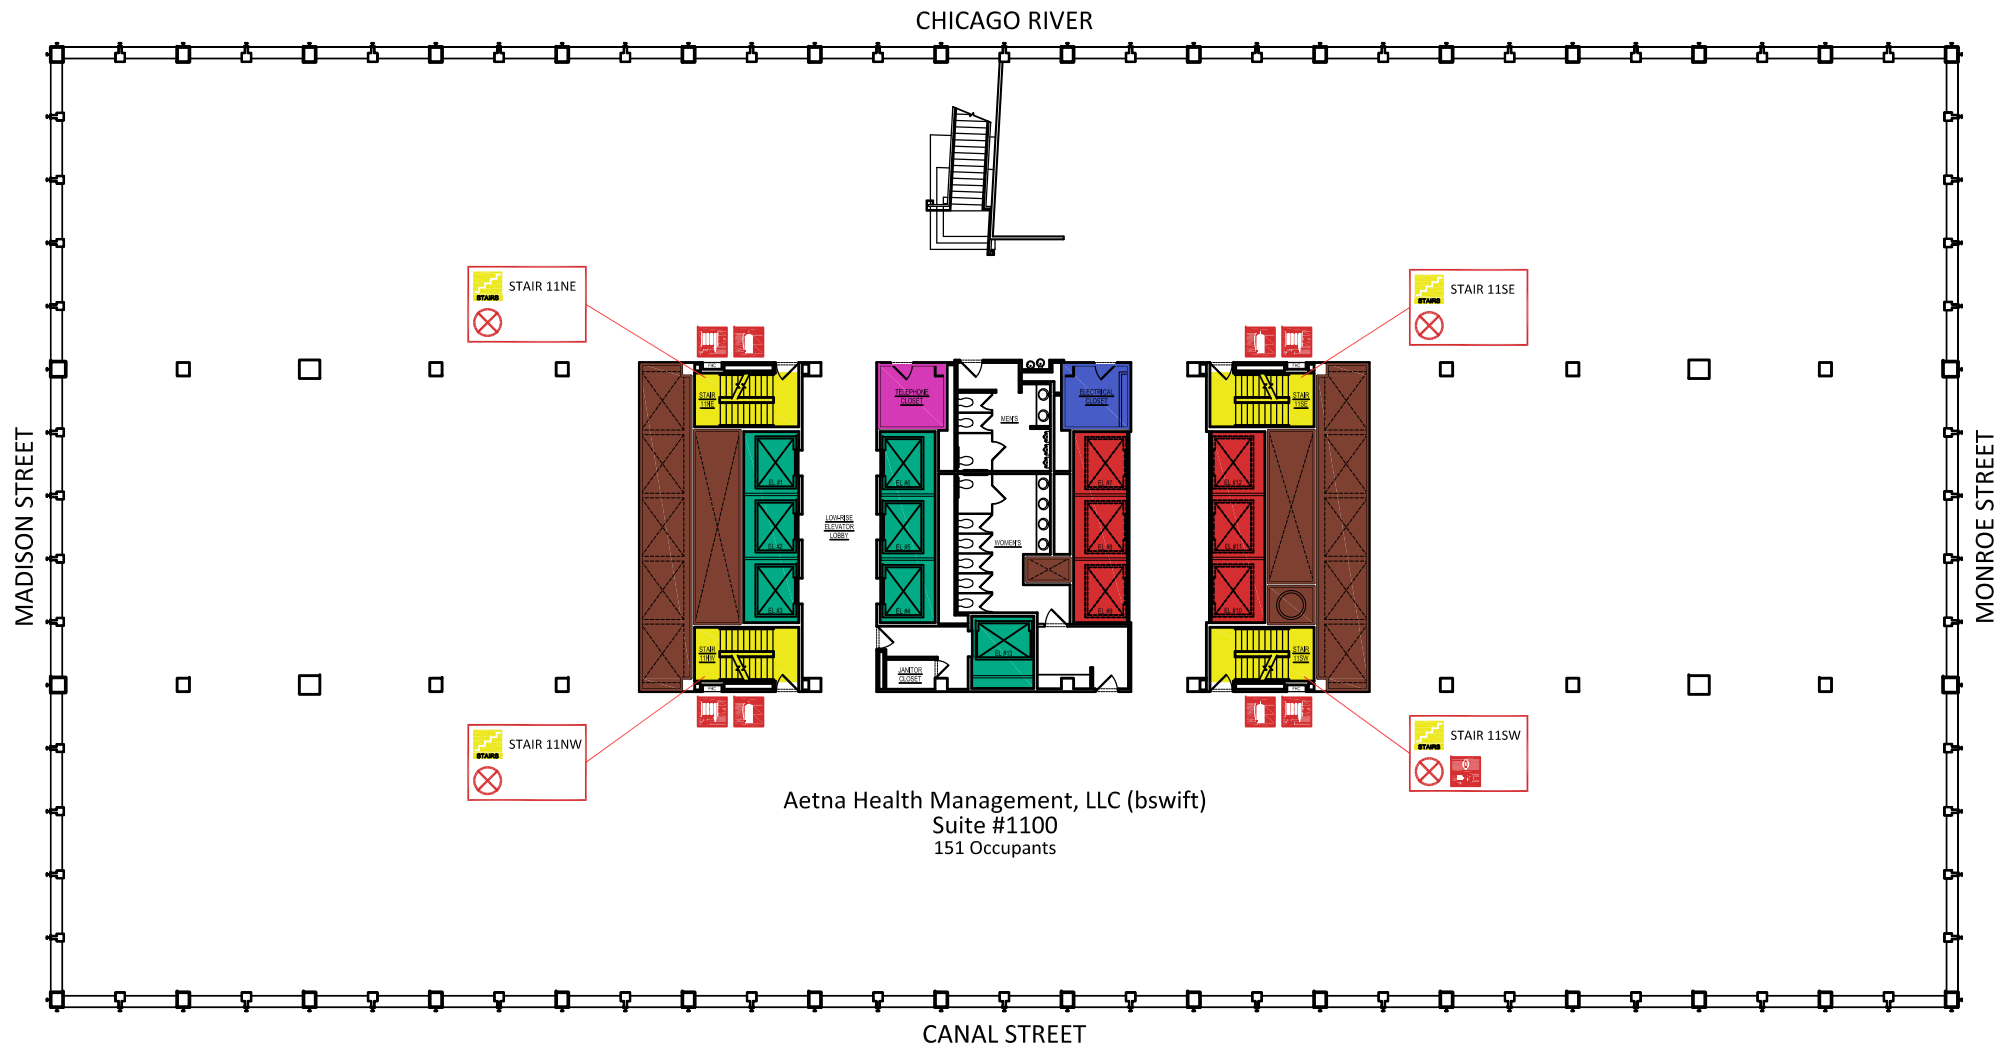


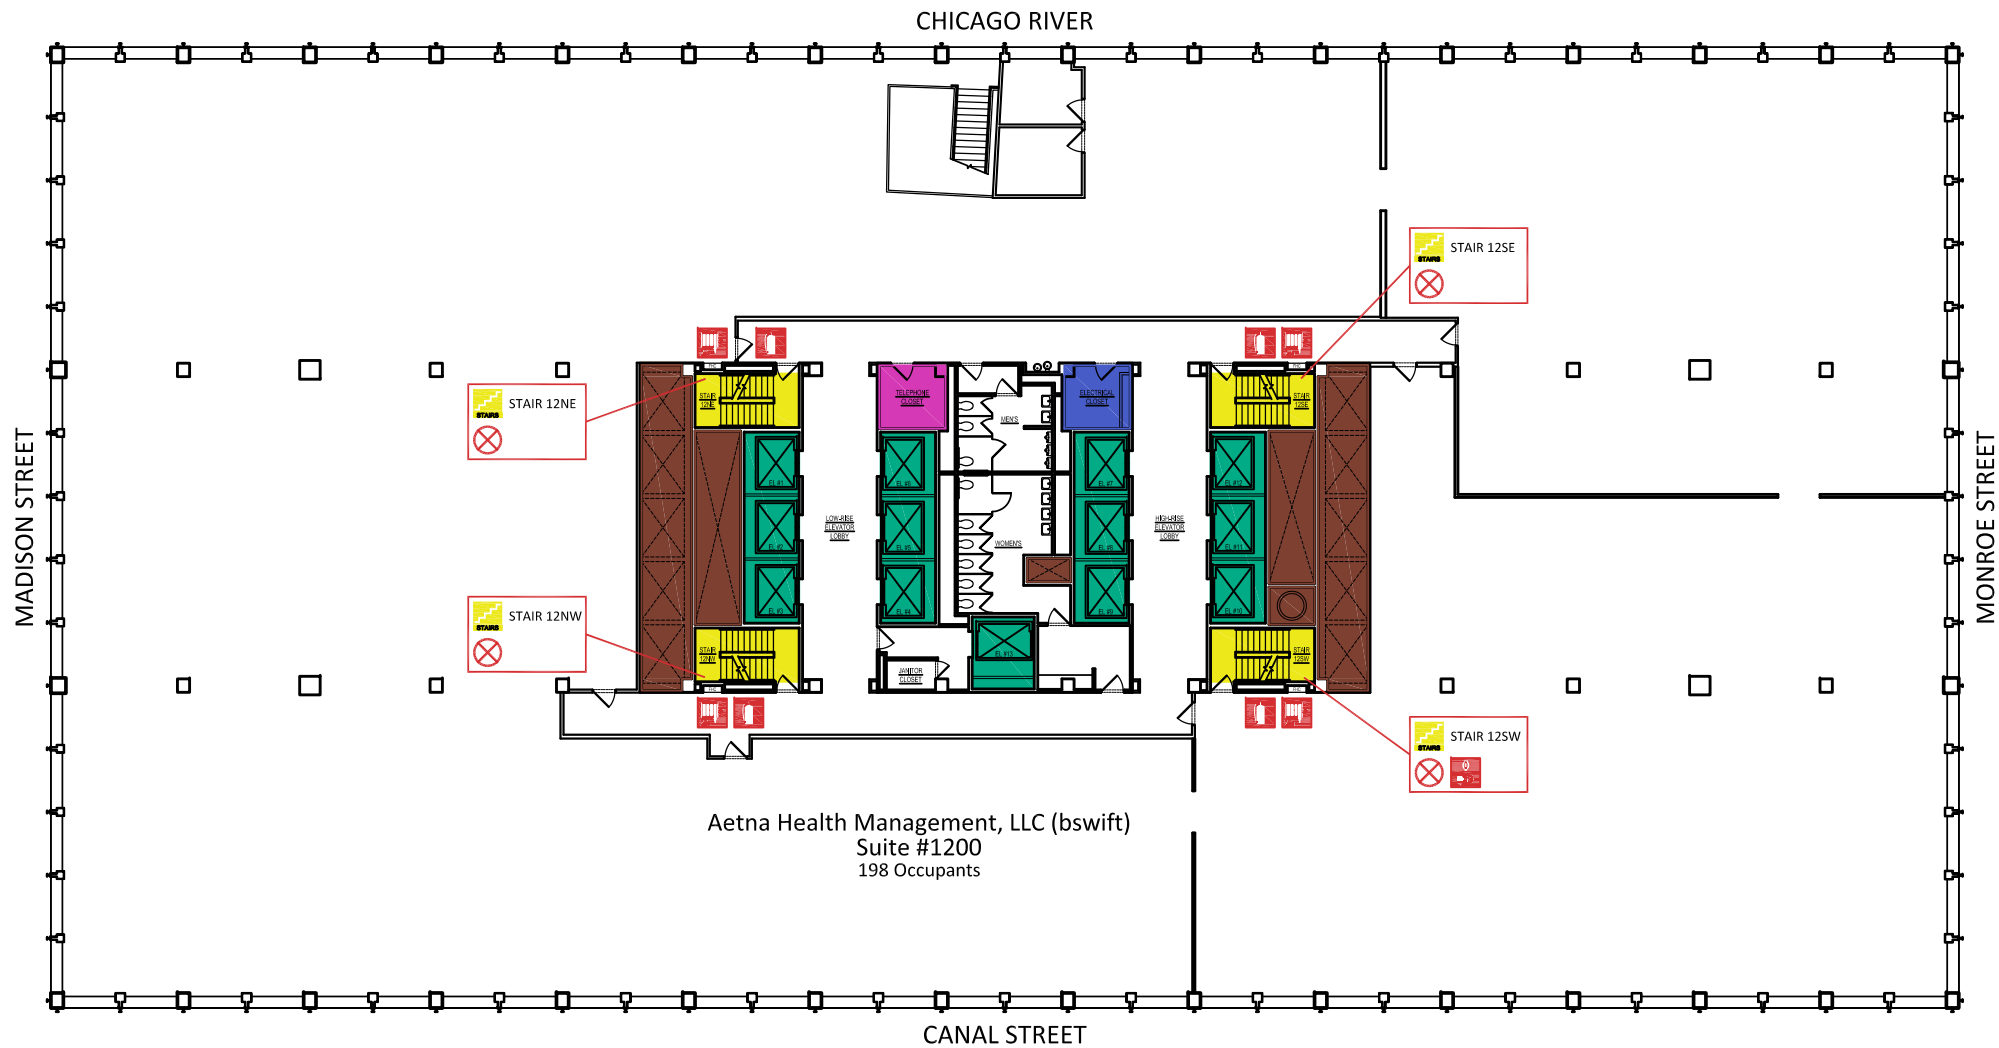


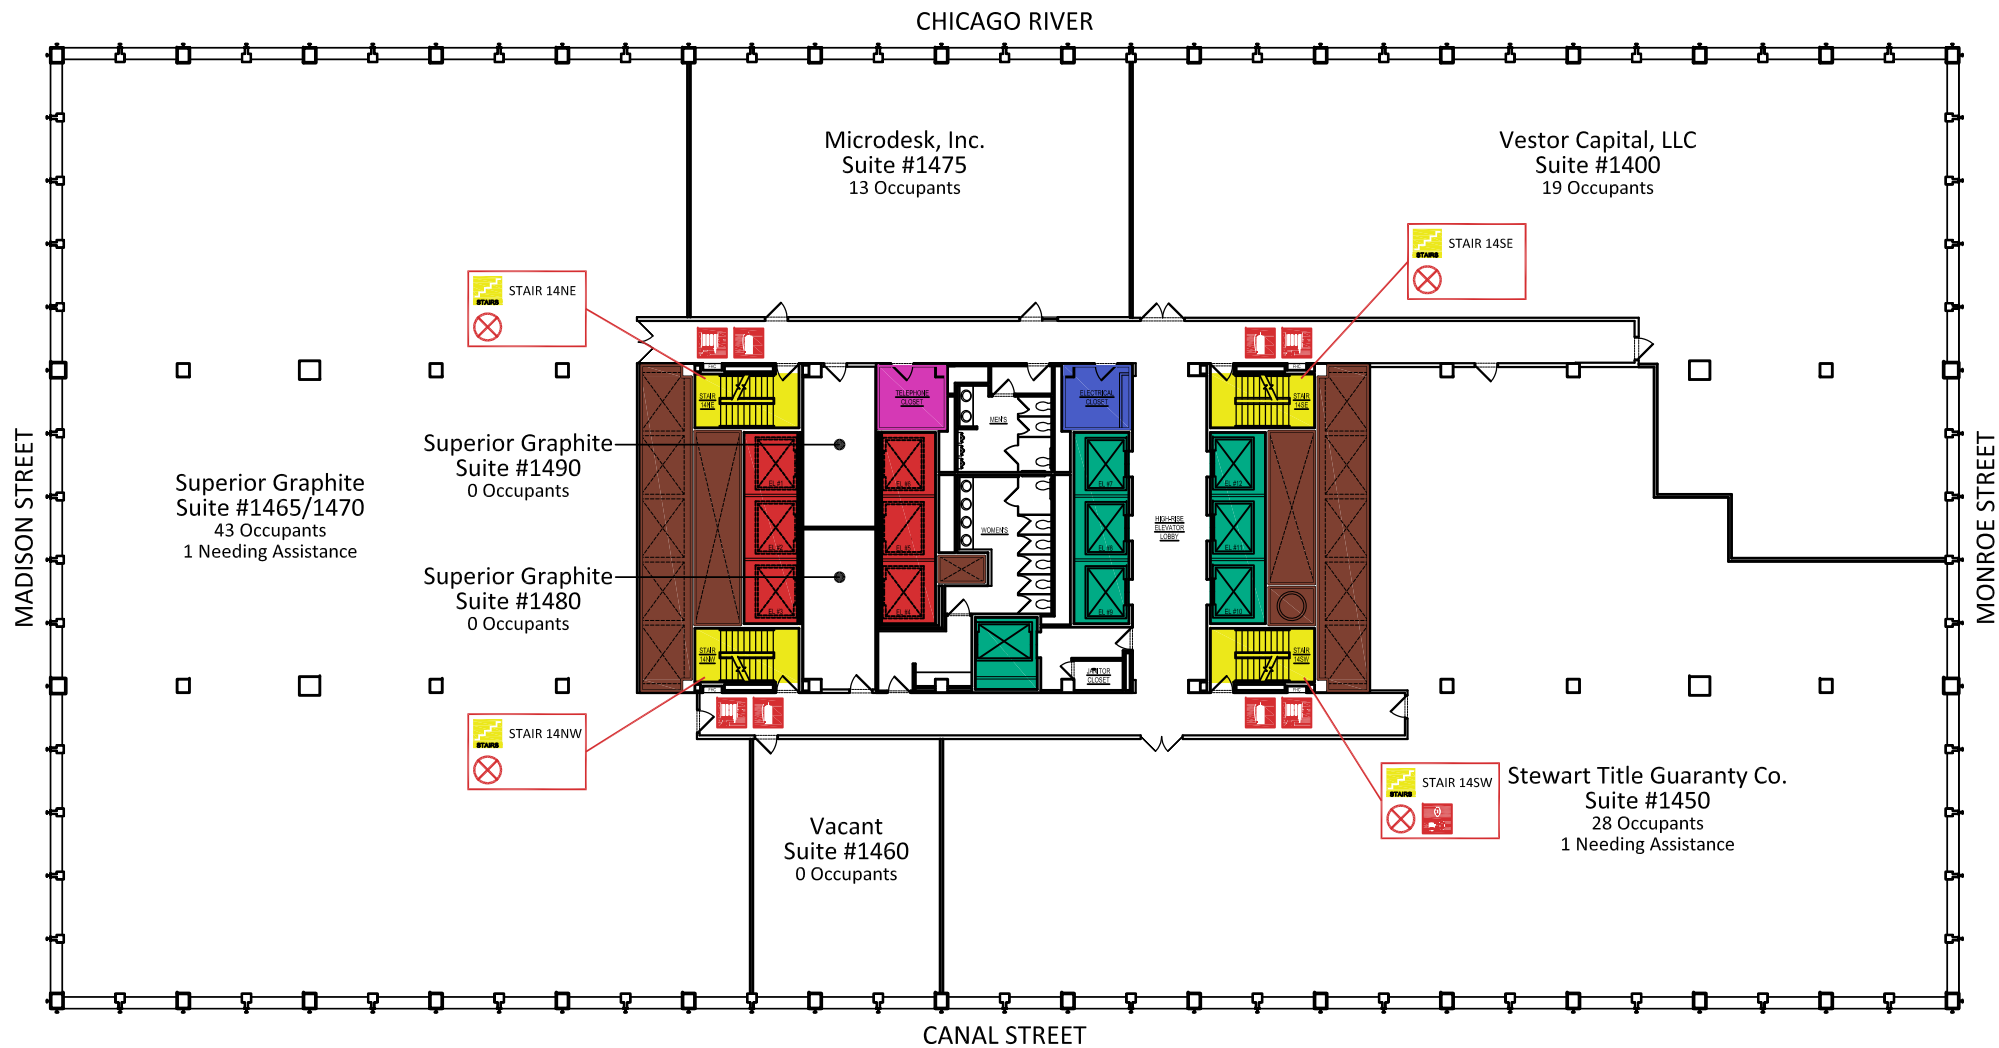


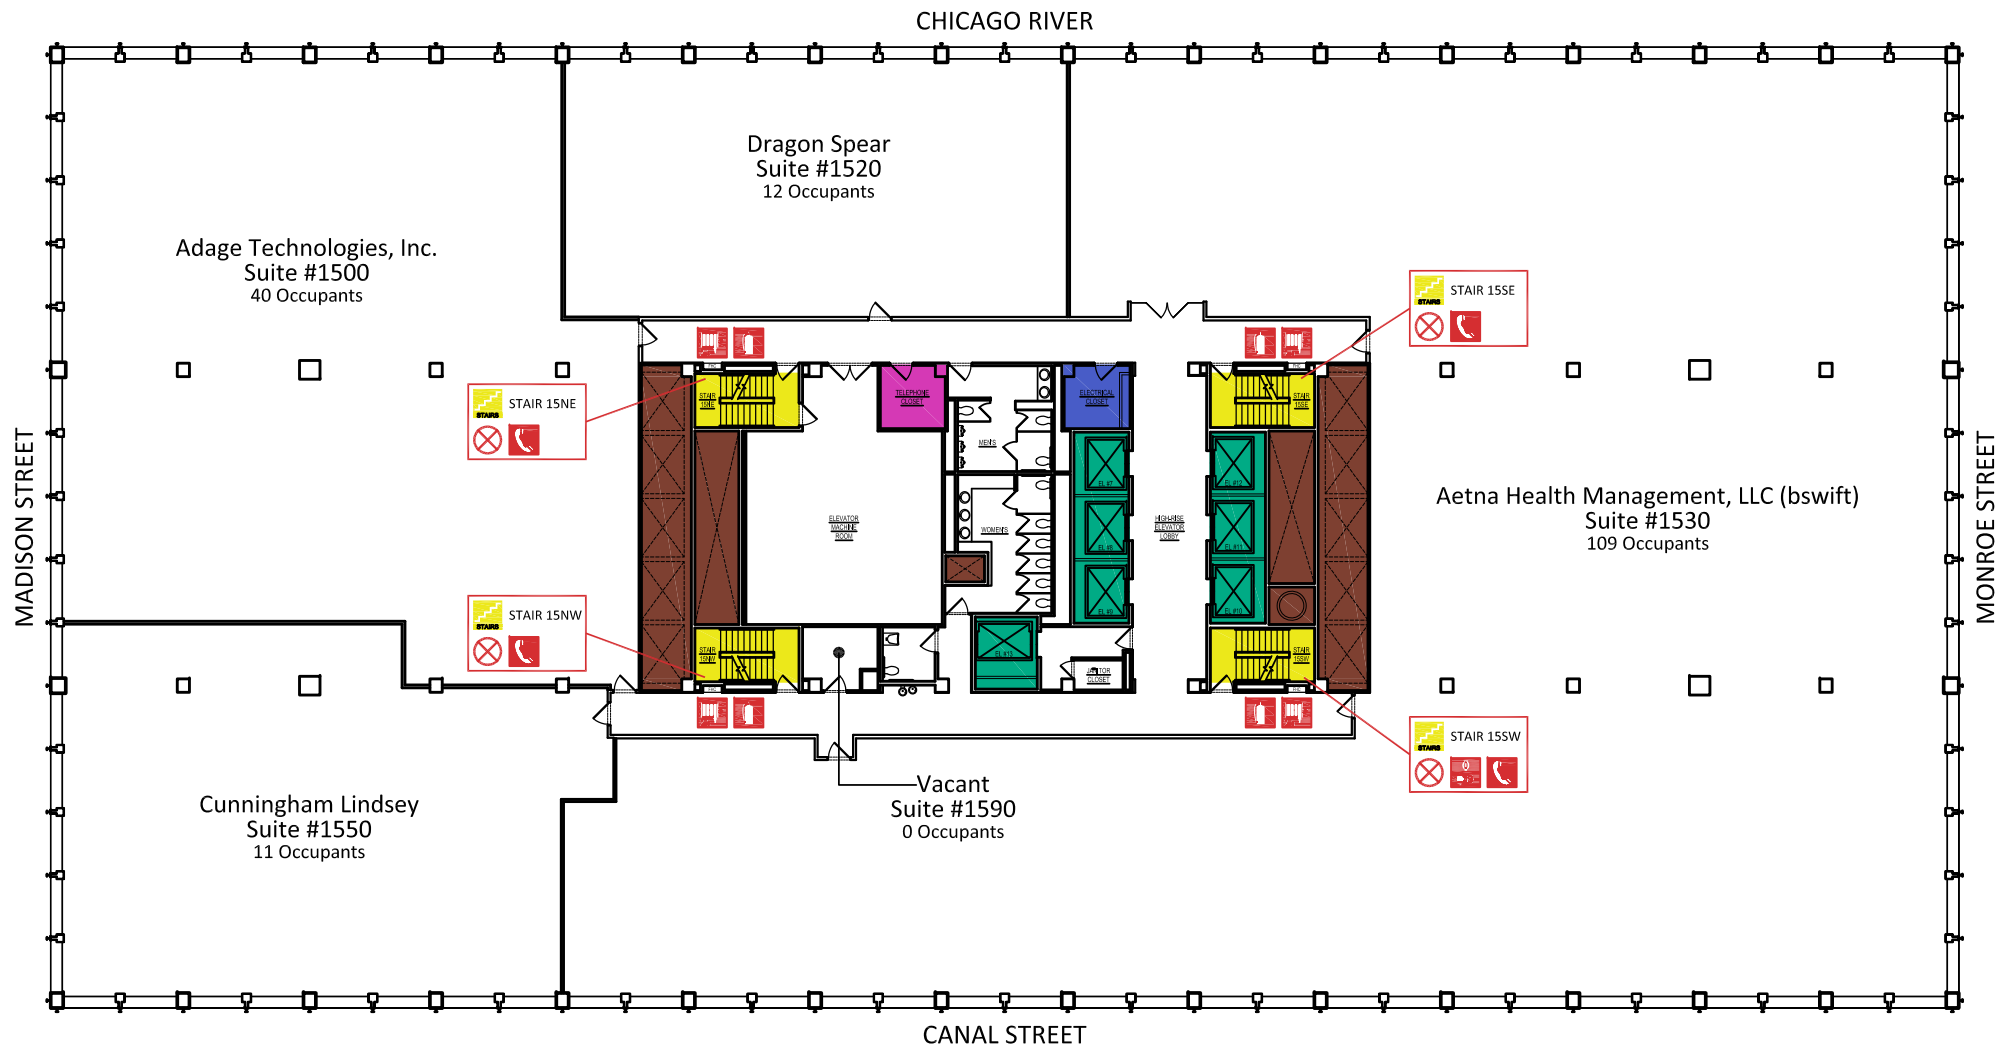

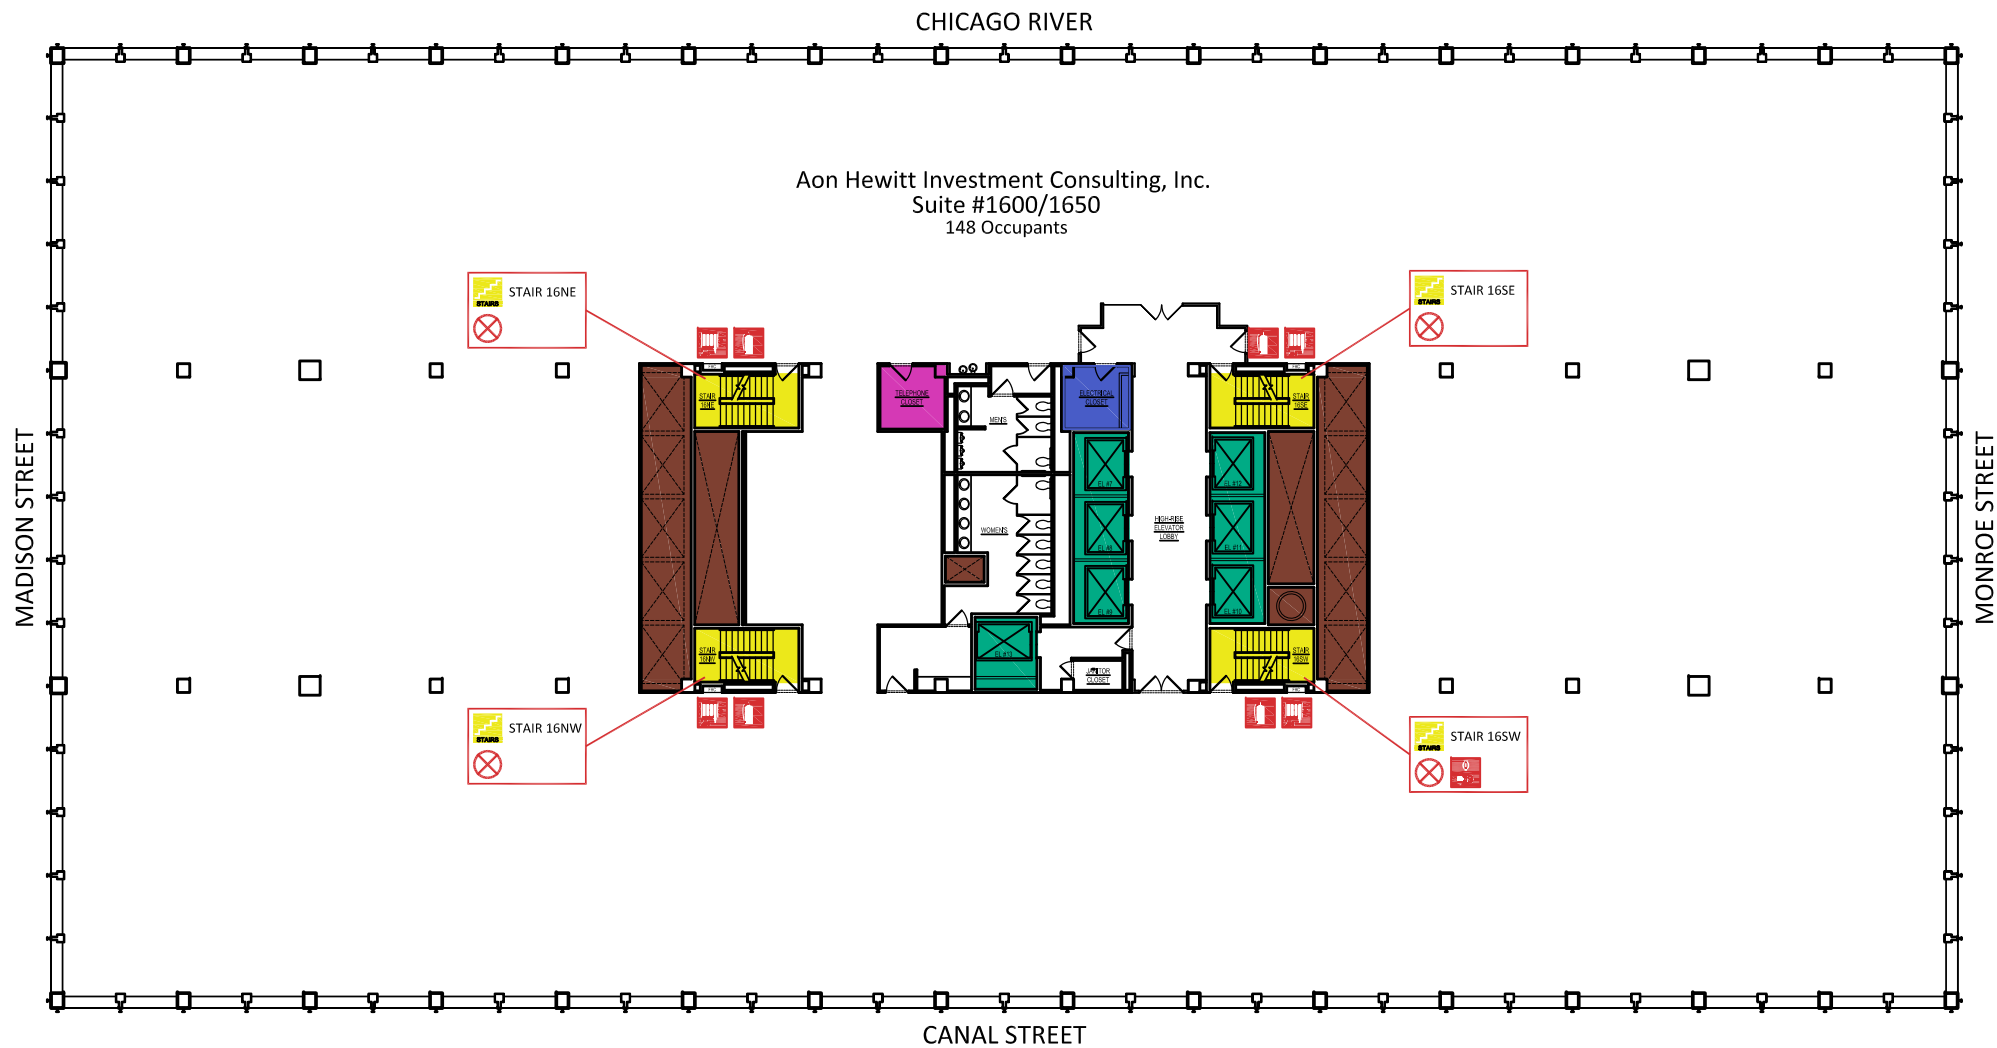

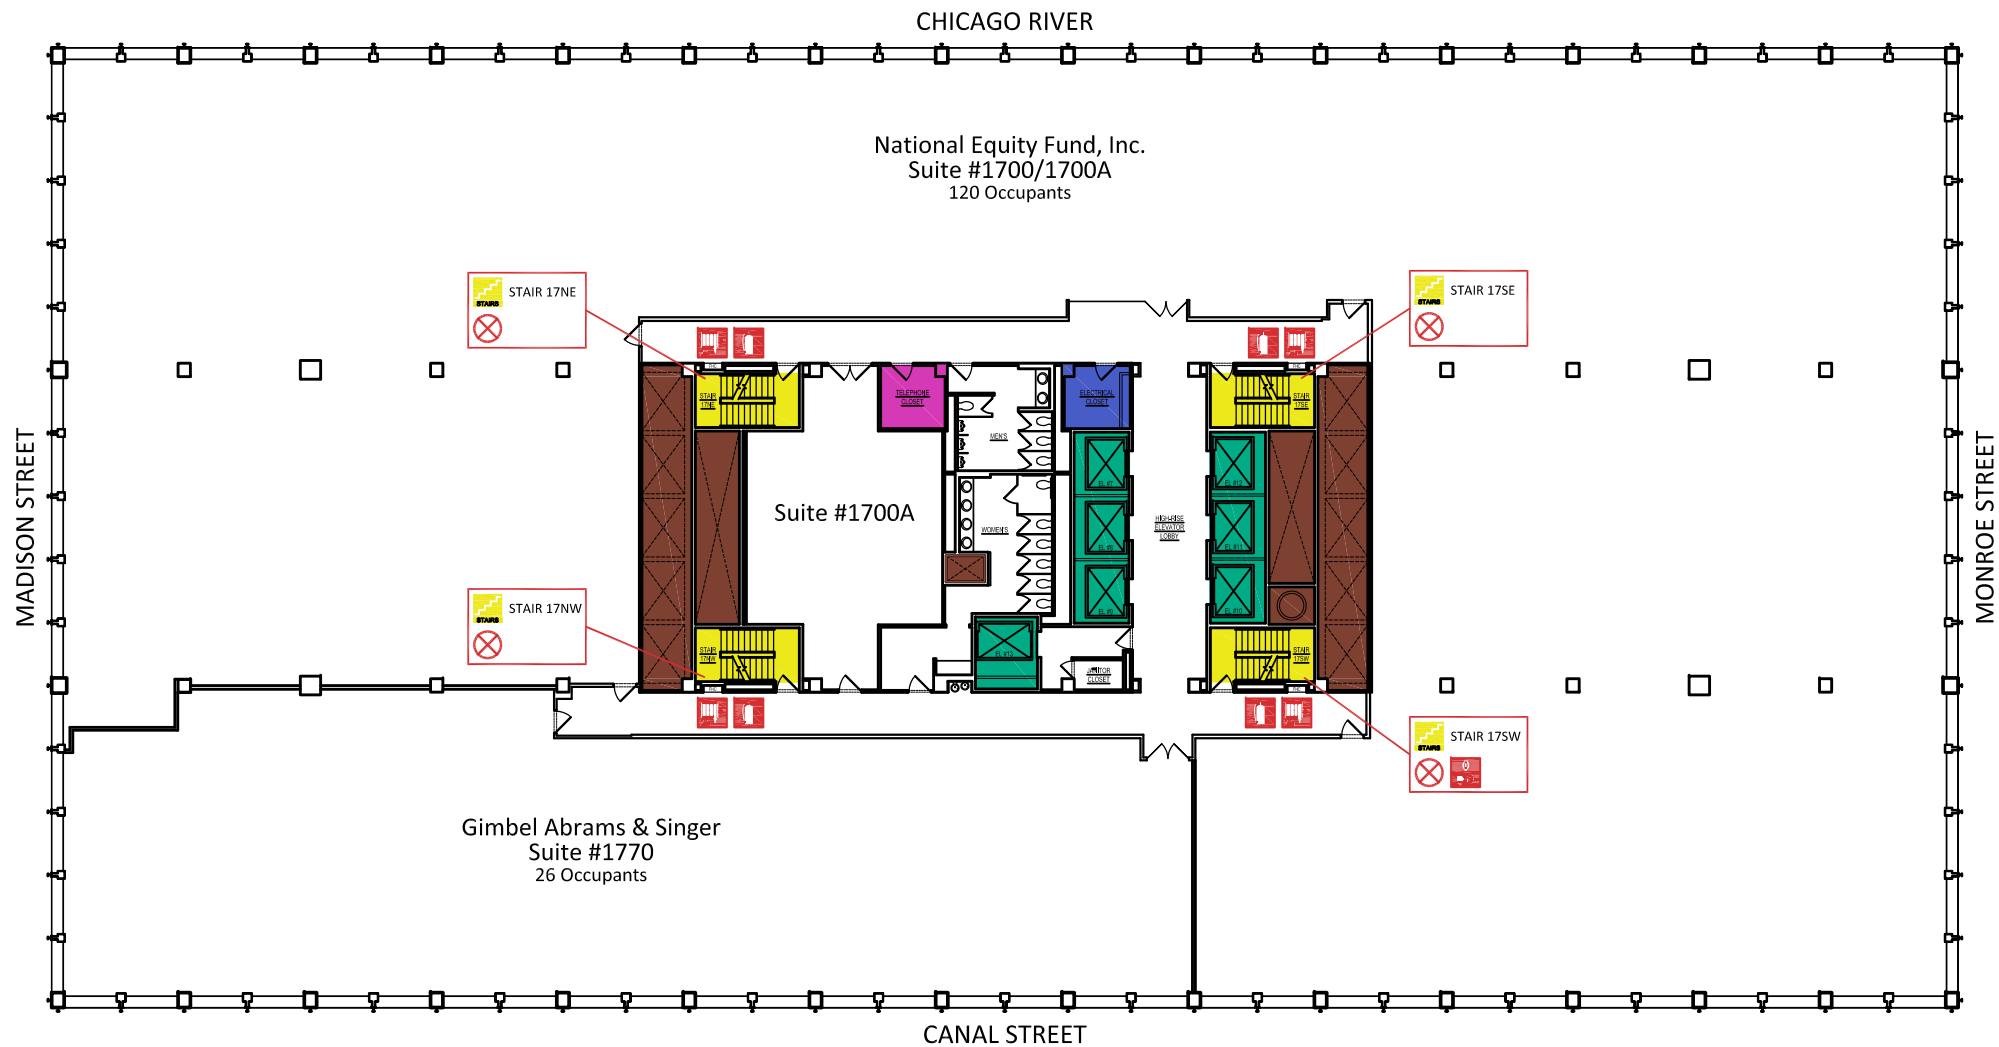

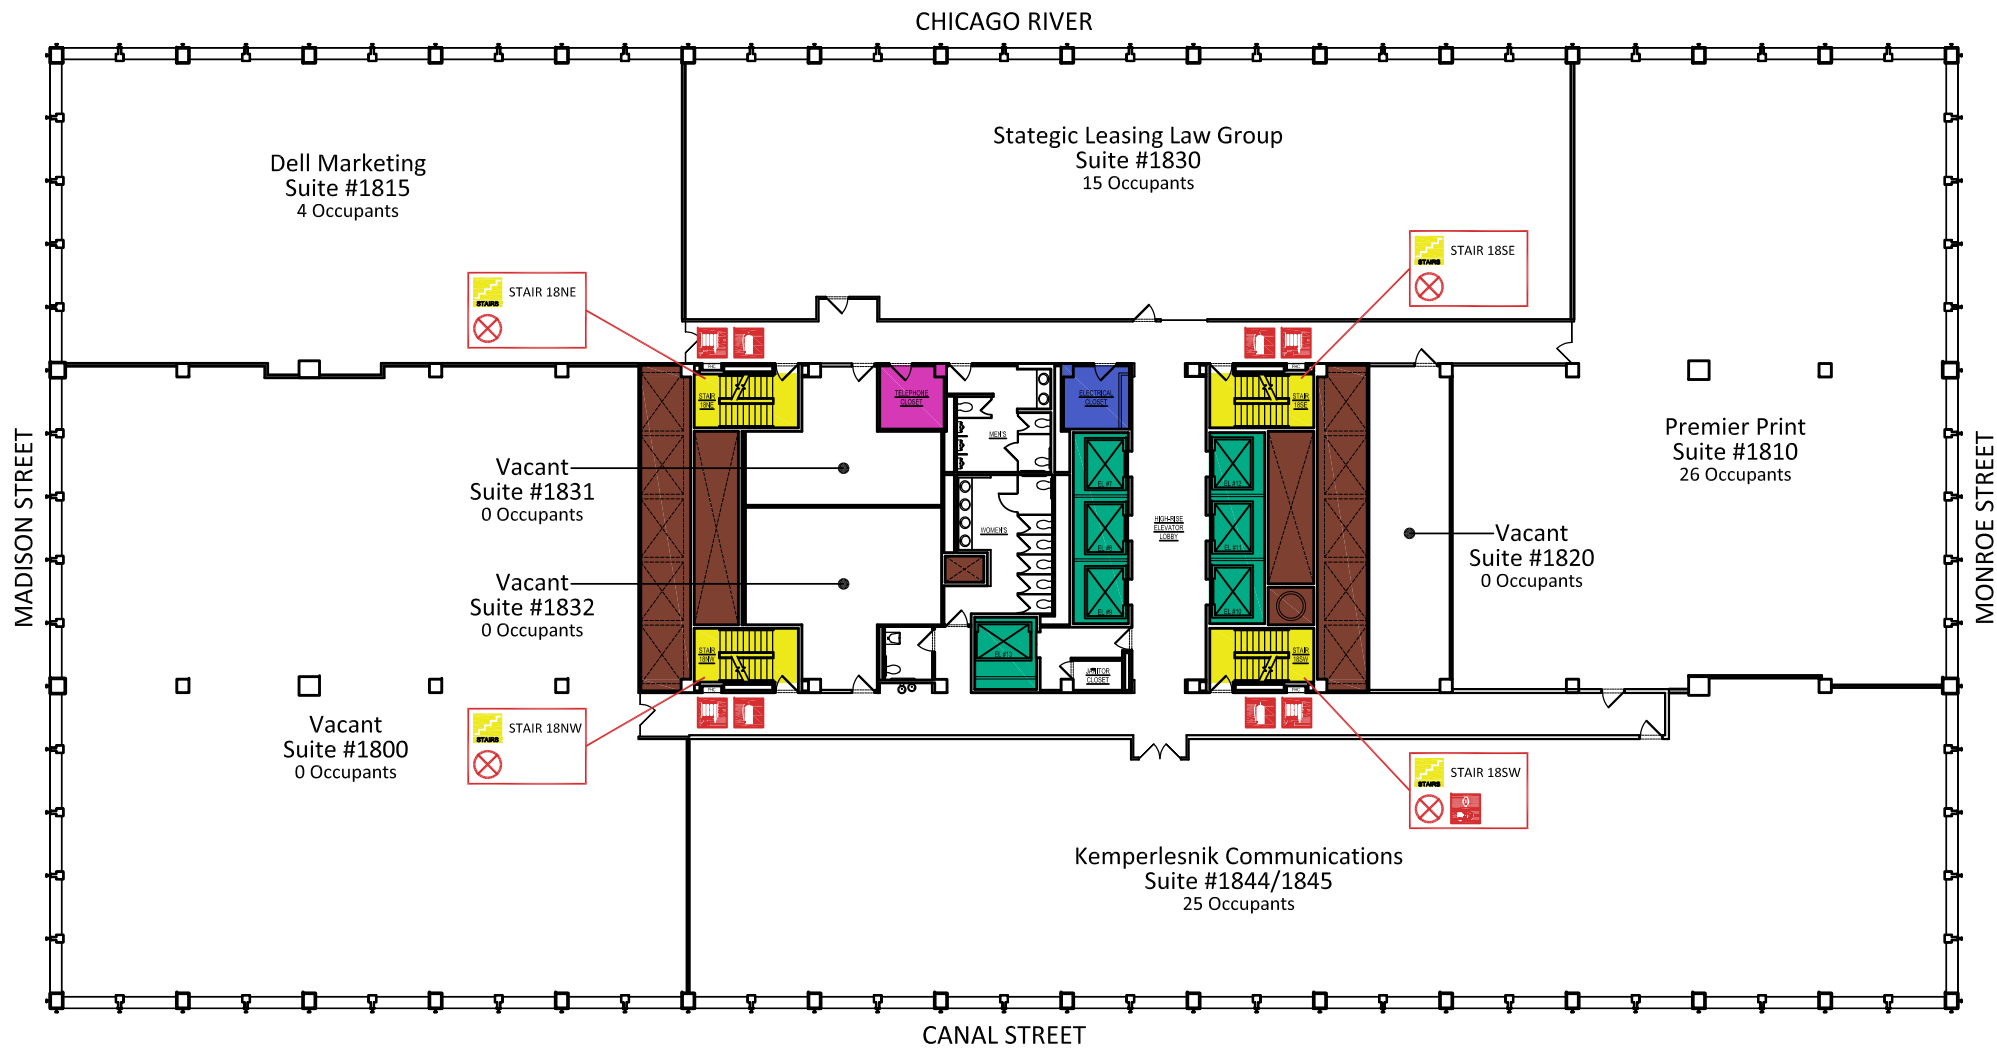

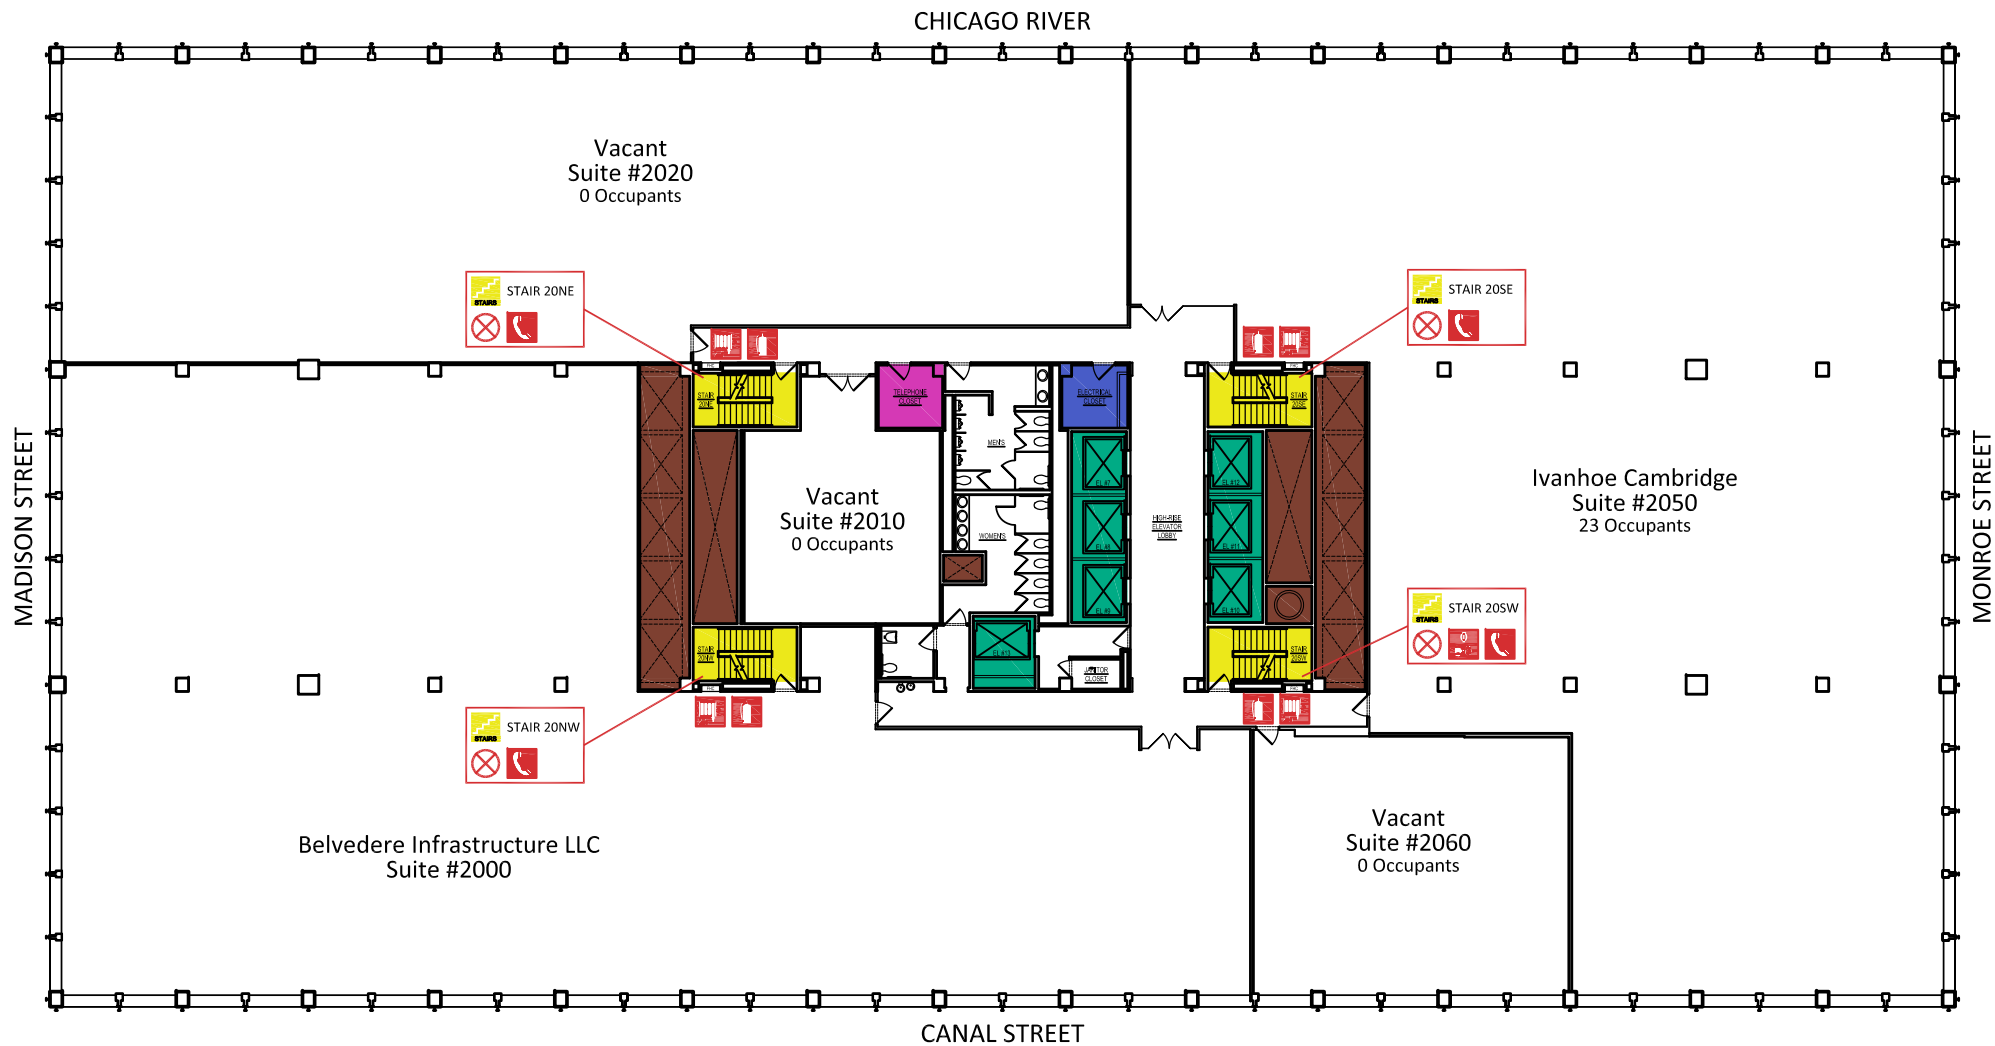

Belvedere Infrastructure LLC
Suite #2100
190 Occupants

MADISON STREET

MONROE STREET

CANAL STREET

STAIR 21NE

STAIR 21SE

STAIR 21NW

STAIR 21SW

RECEPTION AREA

OFFICE

MEETING ROOM

RESTROOM

STORAGE

ELECTRICAL ROOM

MAIL ROOM

STAIR 21NE

STAIR 21SE

STAIR 21NW

STAIR 21SW

RECEPTION AREA

OFFICE

MEETING ROOM

RESTROOM

STORAGE

ELECTRICAL ROOM

MAIL ROOM



December 26, 2018

