




	ELEVATOR AVAILABLE		DEFIBRILLATOR (A.E.D.)		FIRE PUMP
	ELEVATOR NOT AVAILABLE		DOMESTIC WATER SHUTOFF		GAS SHUT OFF VALVE
	ELECTRICAL		ELECTRIC SHUTOFF		REFUGE AREA
	HAZARDOUS EQUIPMENT		EMERGENCY TELEPHONE		SIAMESE/FIRE DEPT. CONNECTION
	SMOKE TOWER		FIRE ALARM ANNUNCIATOR		SPRINKLER CONTROL VALVE
	STAIRWELL		FIRE EXTINGUISHER		STANDPIPE/RISER
	TELEPHONE		1-1/2" FIRE HOSE CONNECTION		STAIRWELL
	VERTICAL OPENINGS		2-1/2" FIRE HOSE CONNECTION		VOICE CONTROL PANEL


□ □ □ □ □ □ □ □ □ □ □ □ □ □ □ □




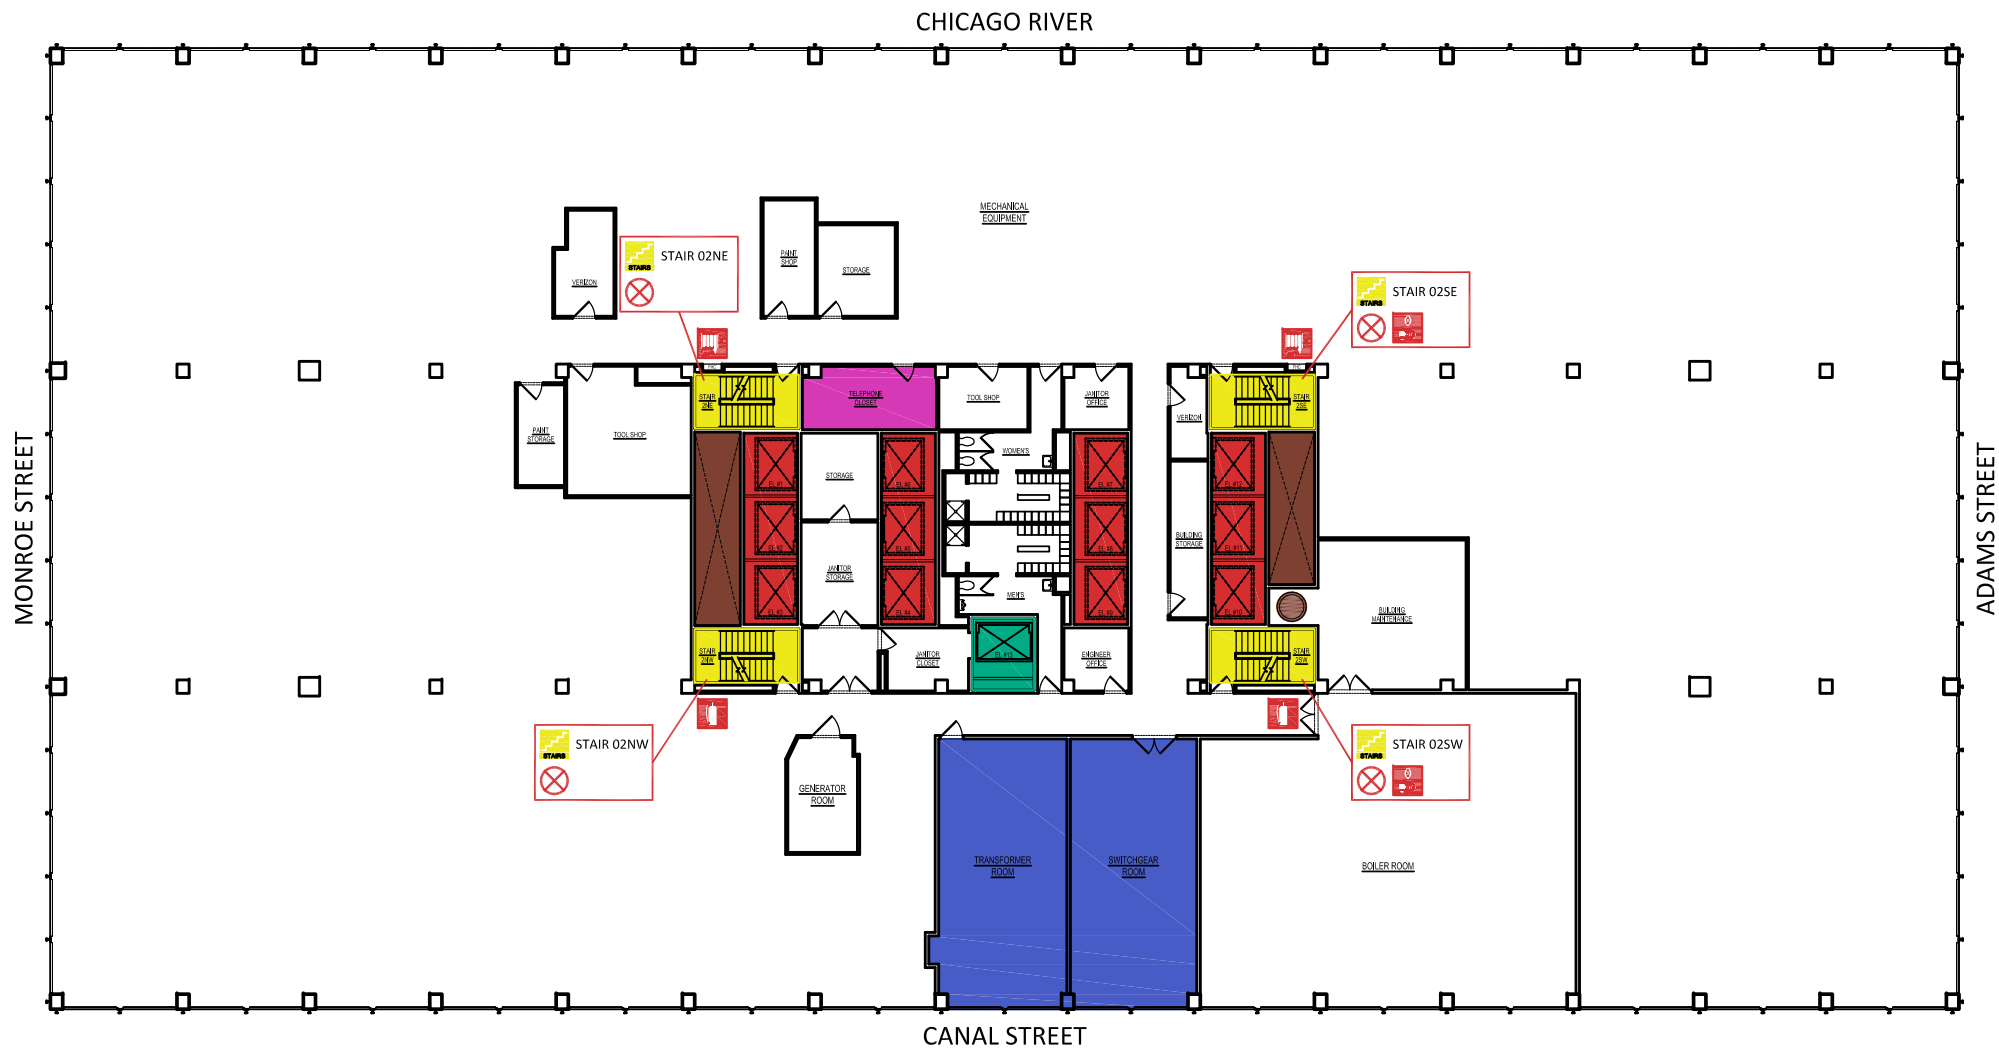


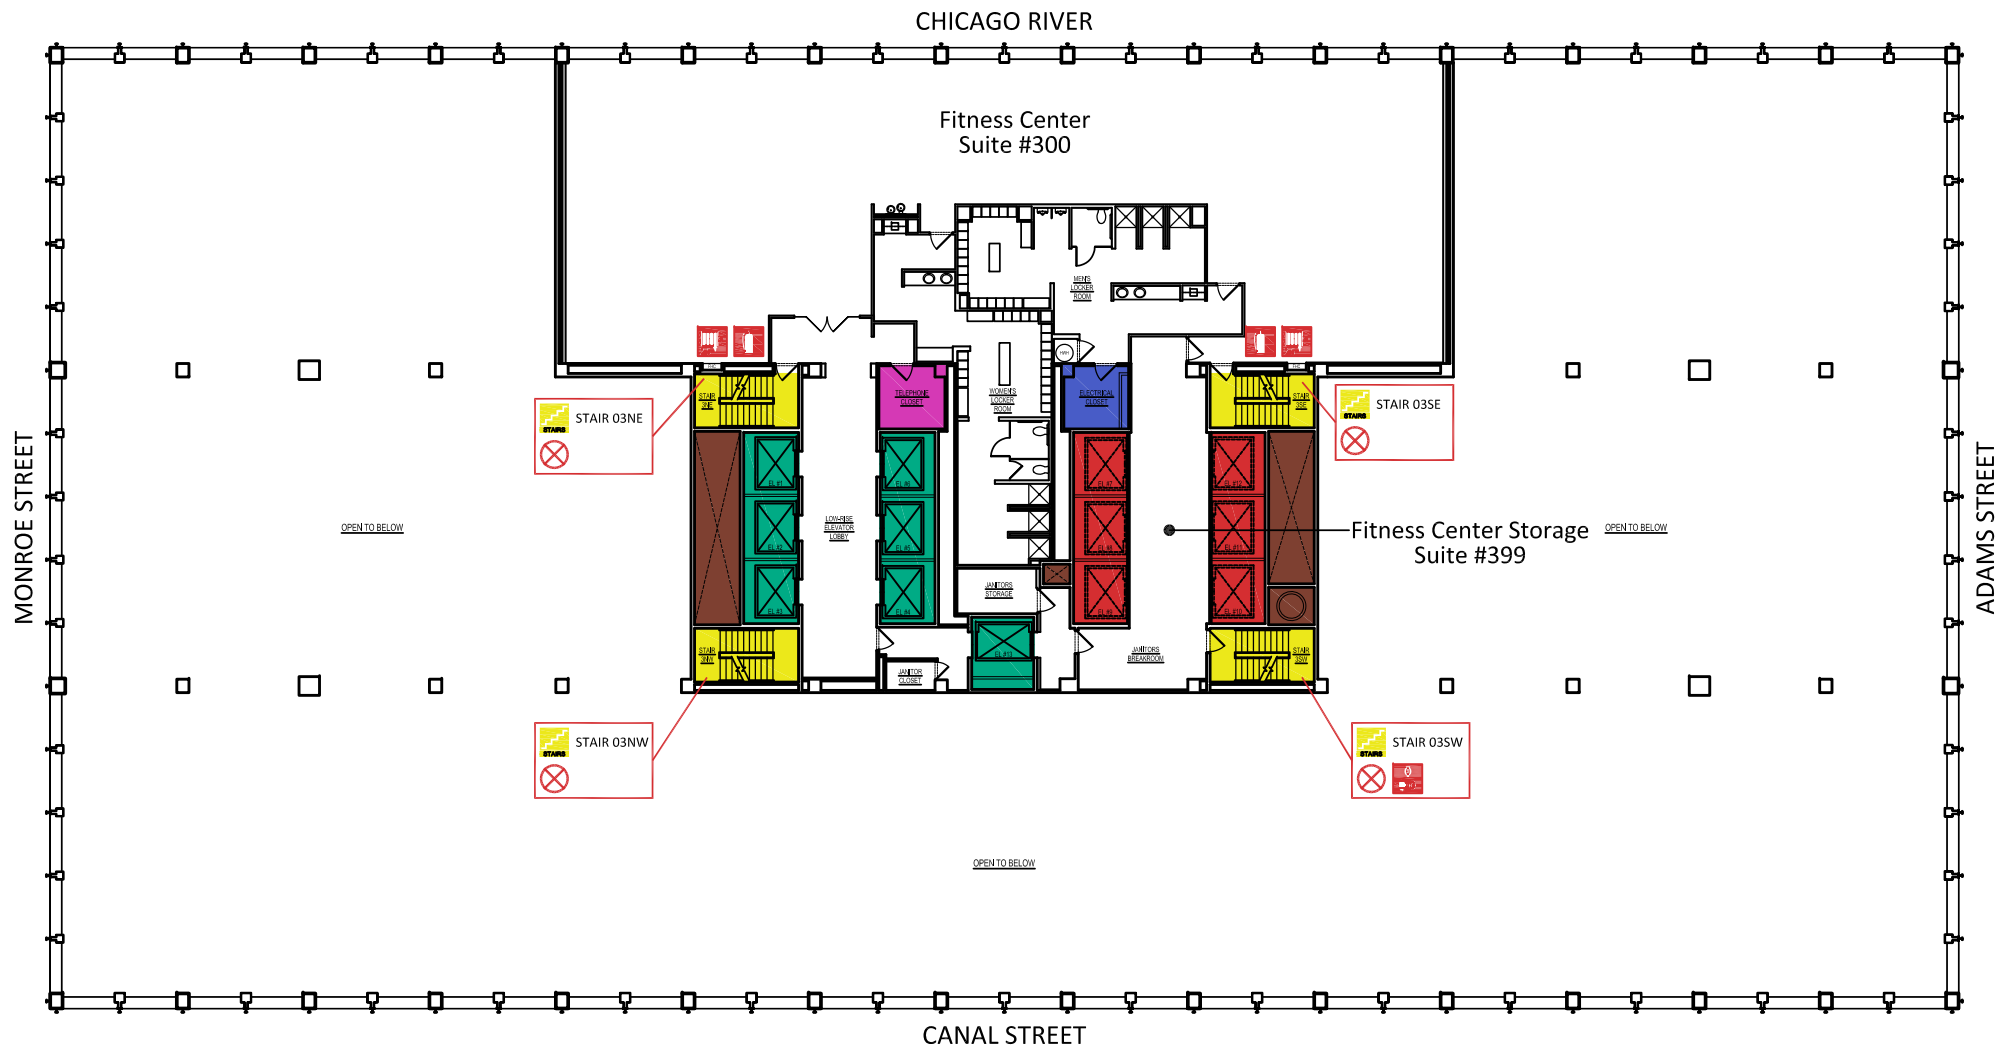


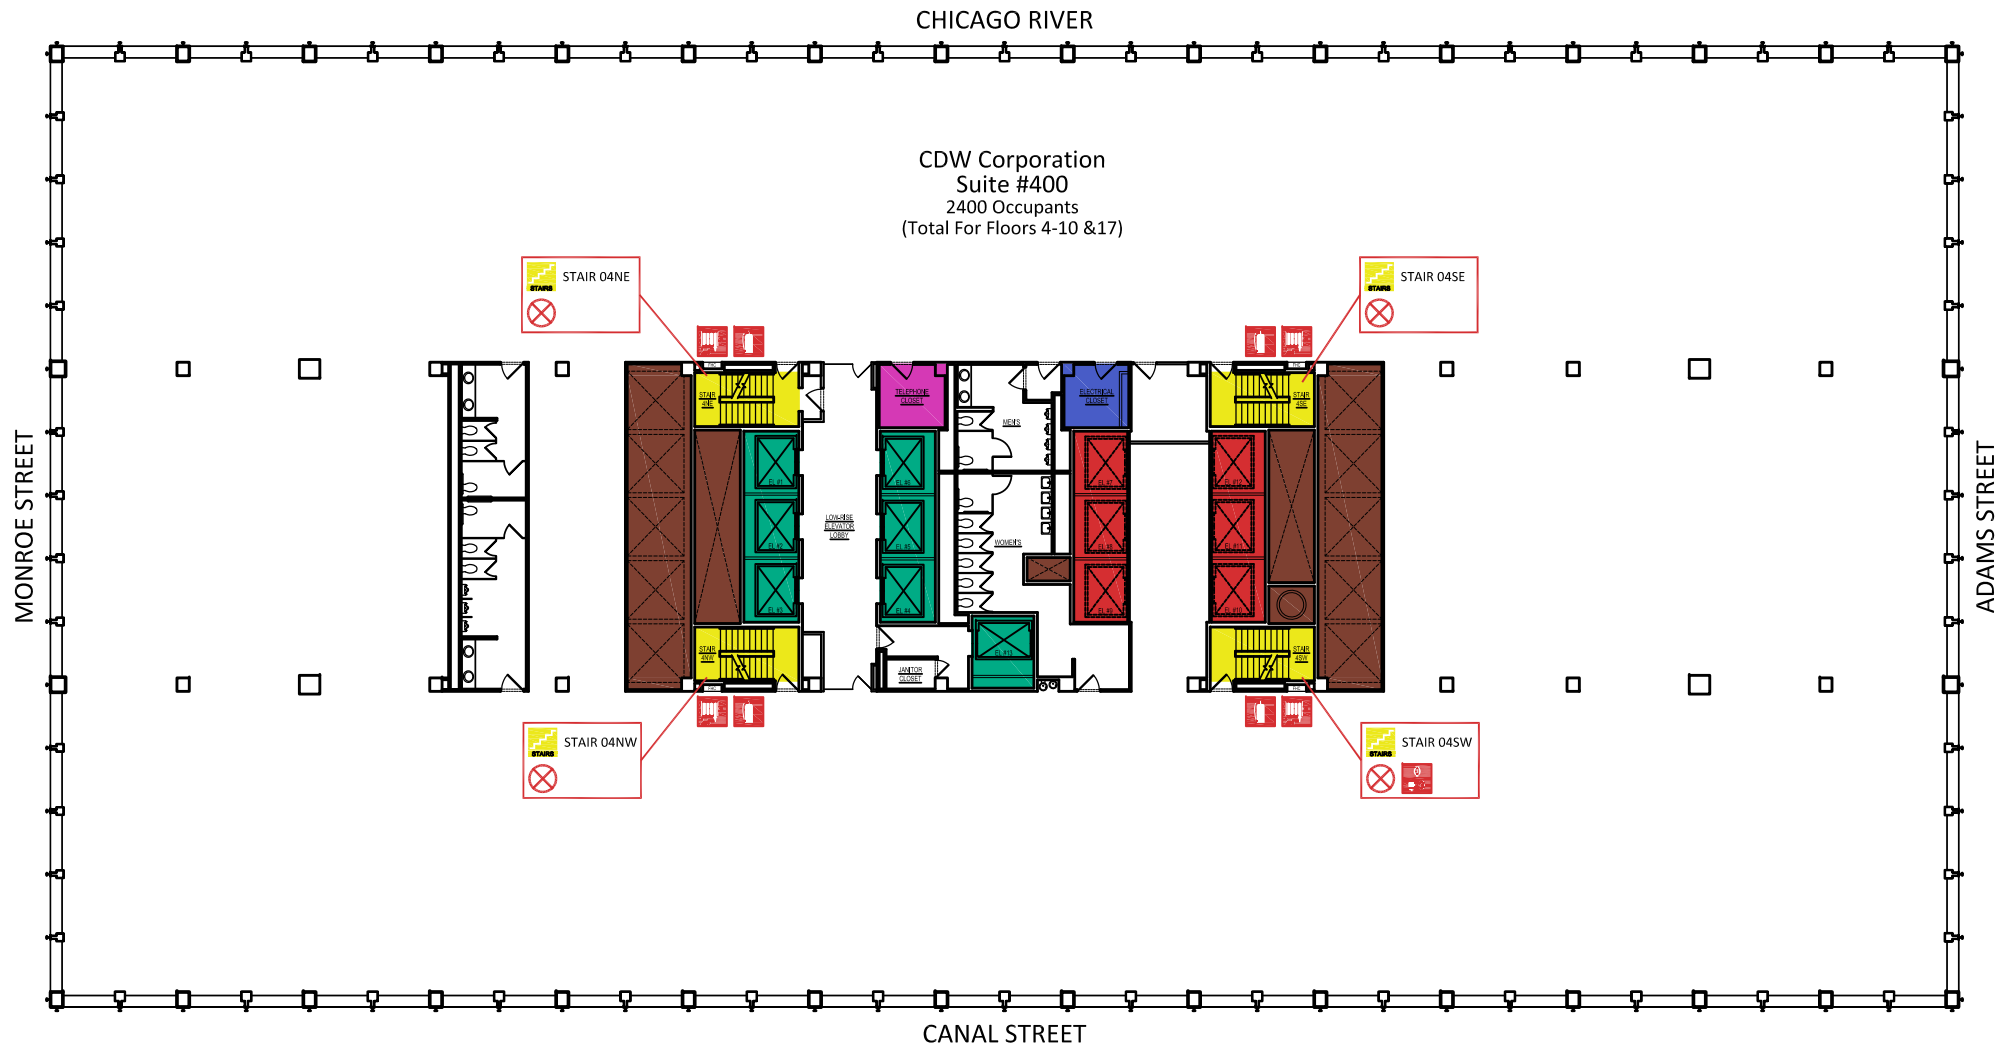


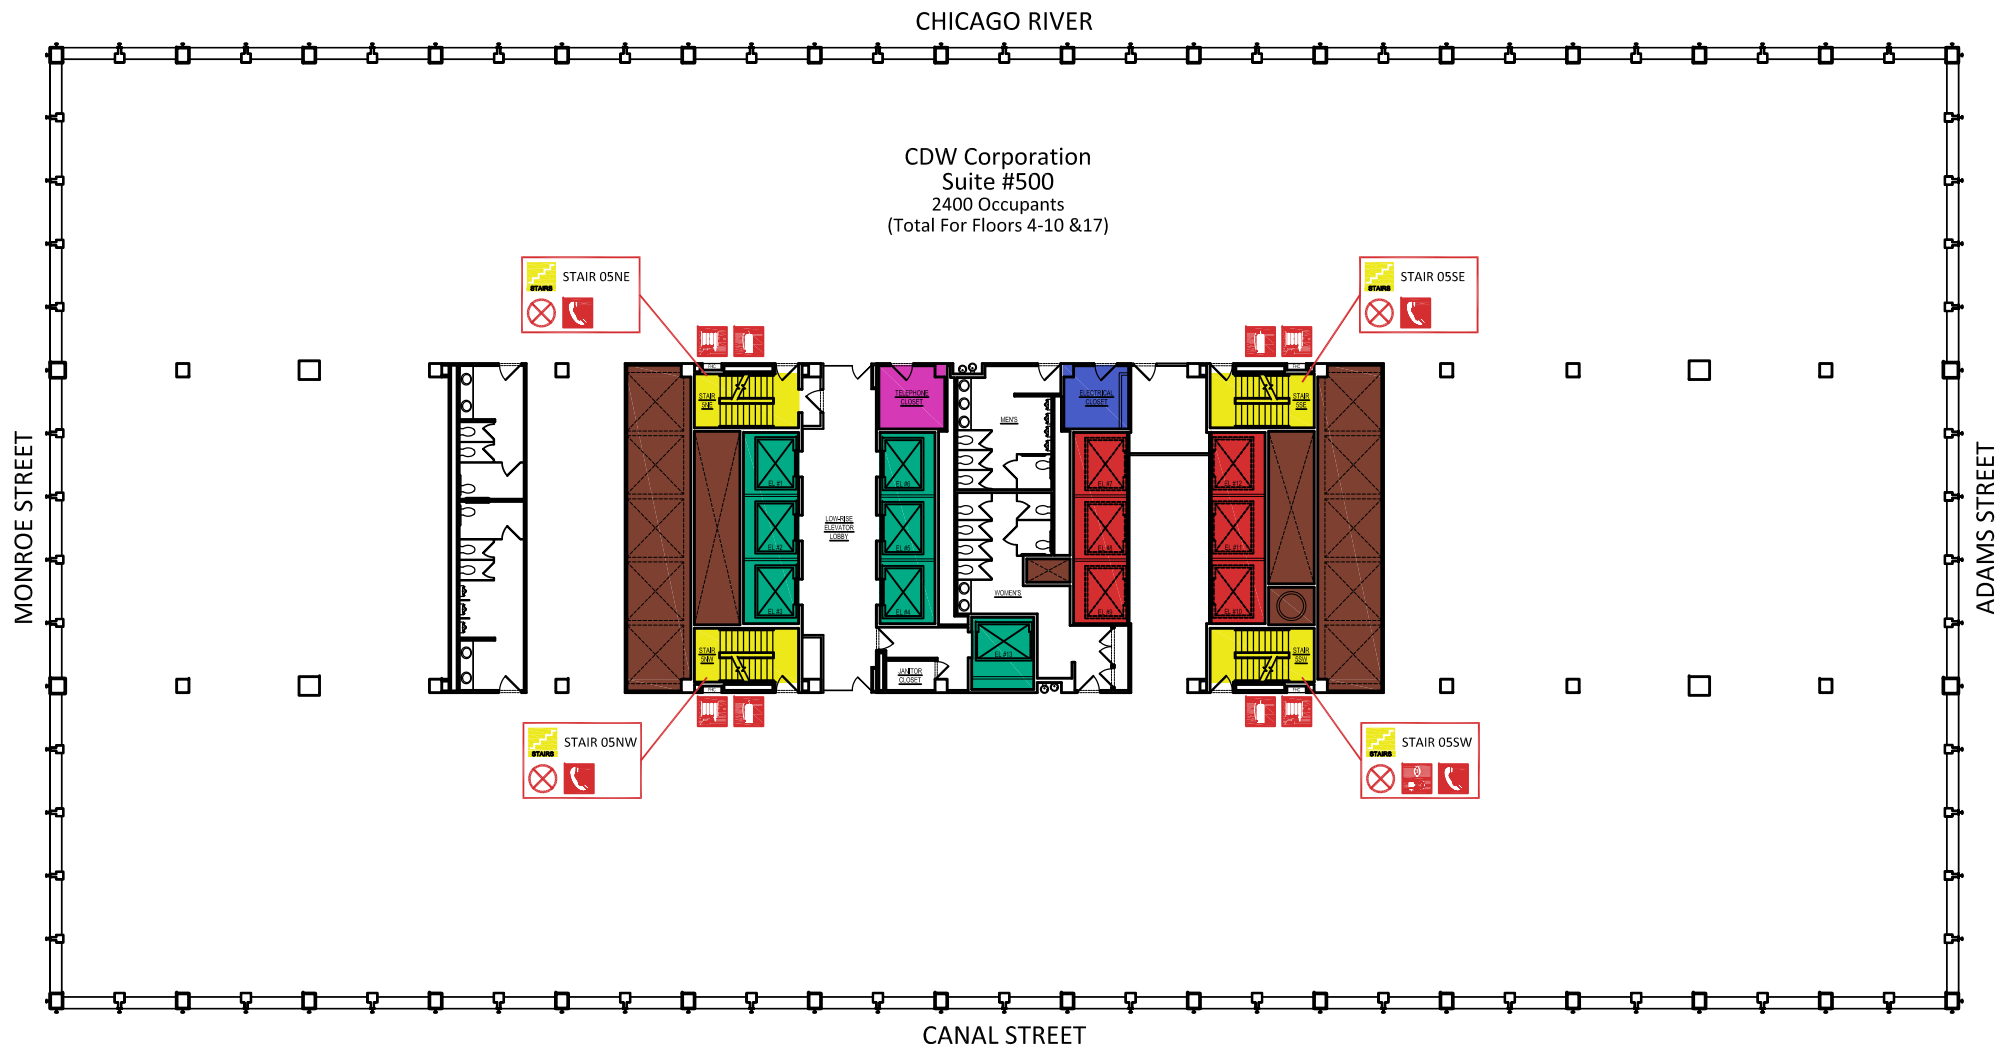


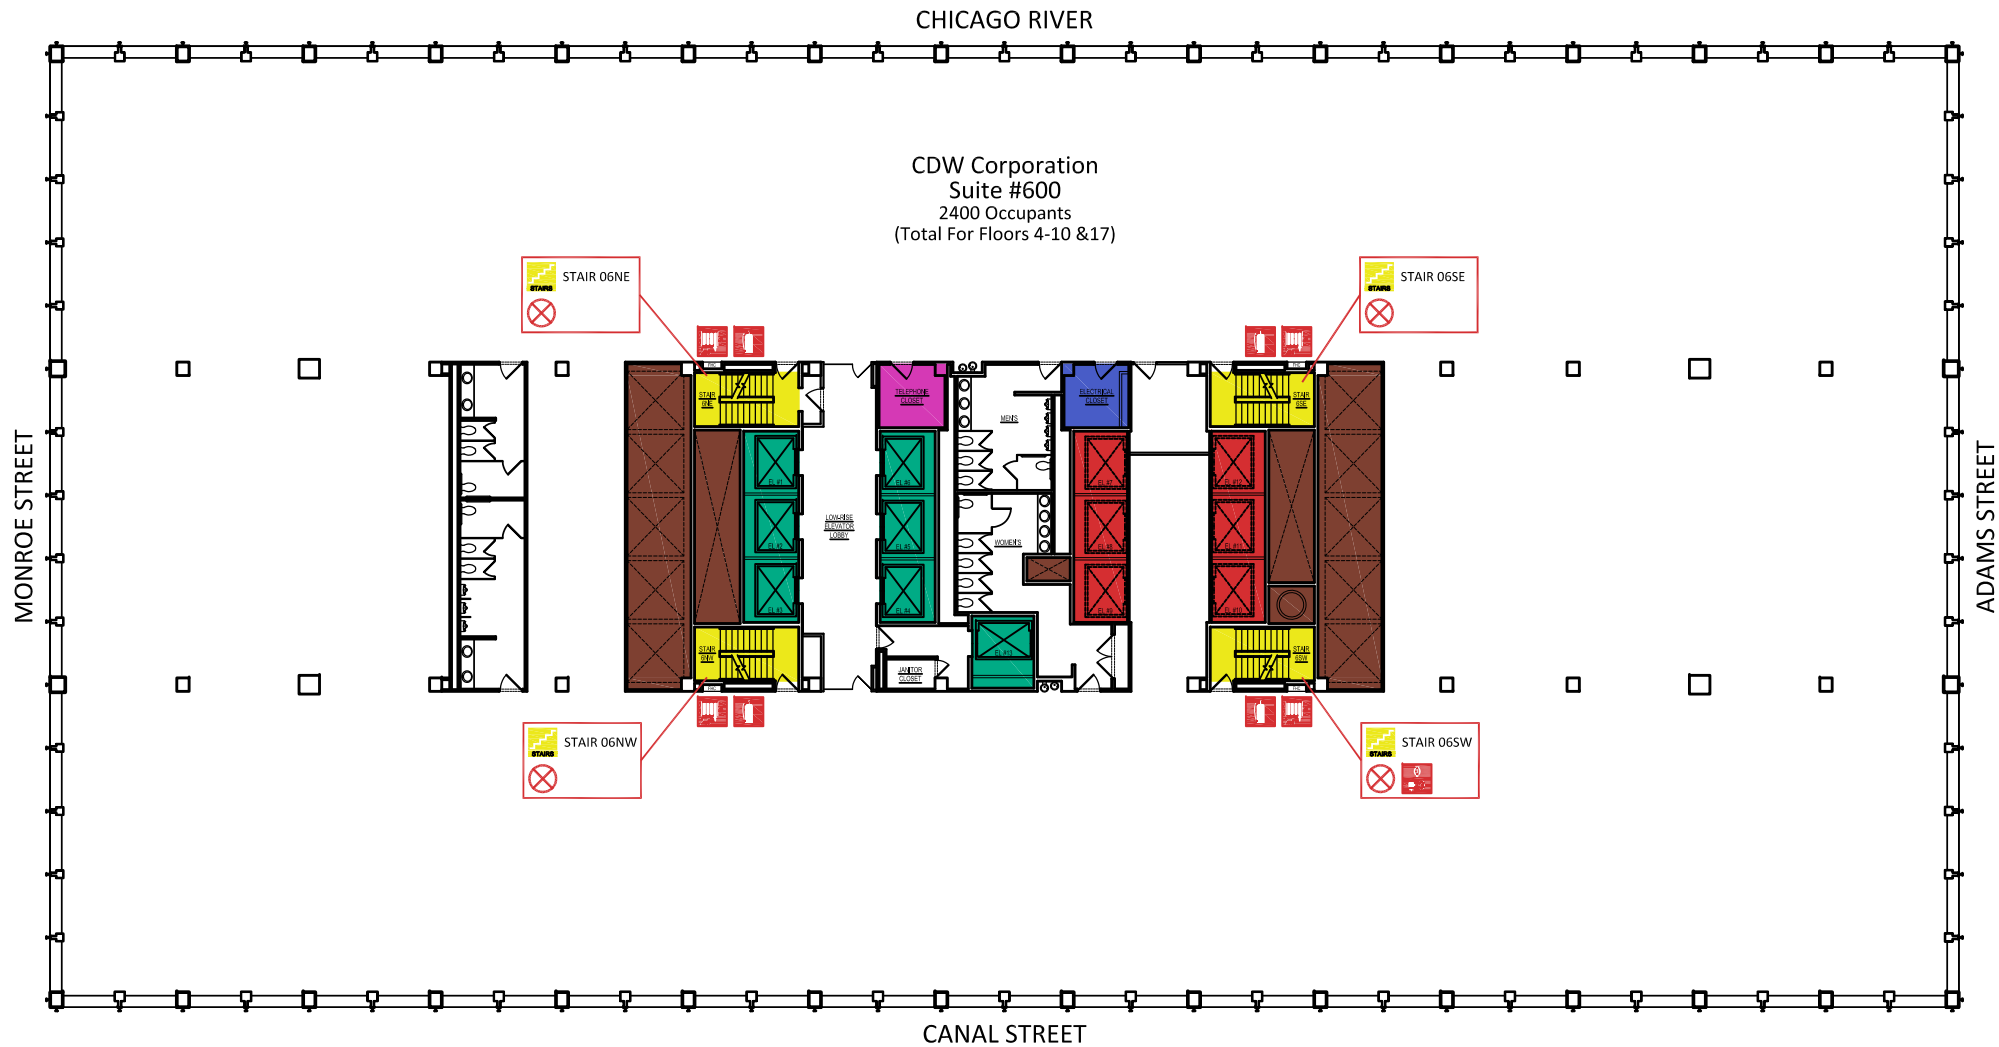


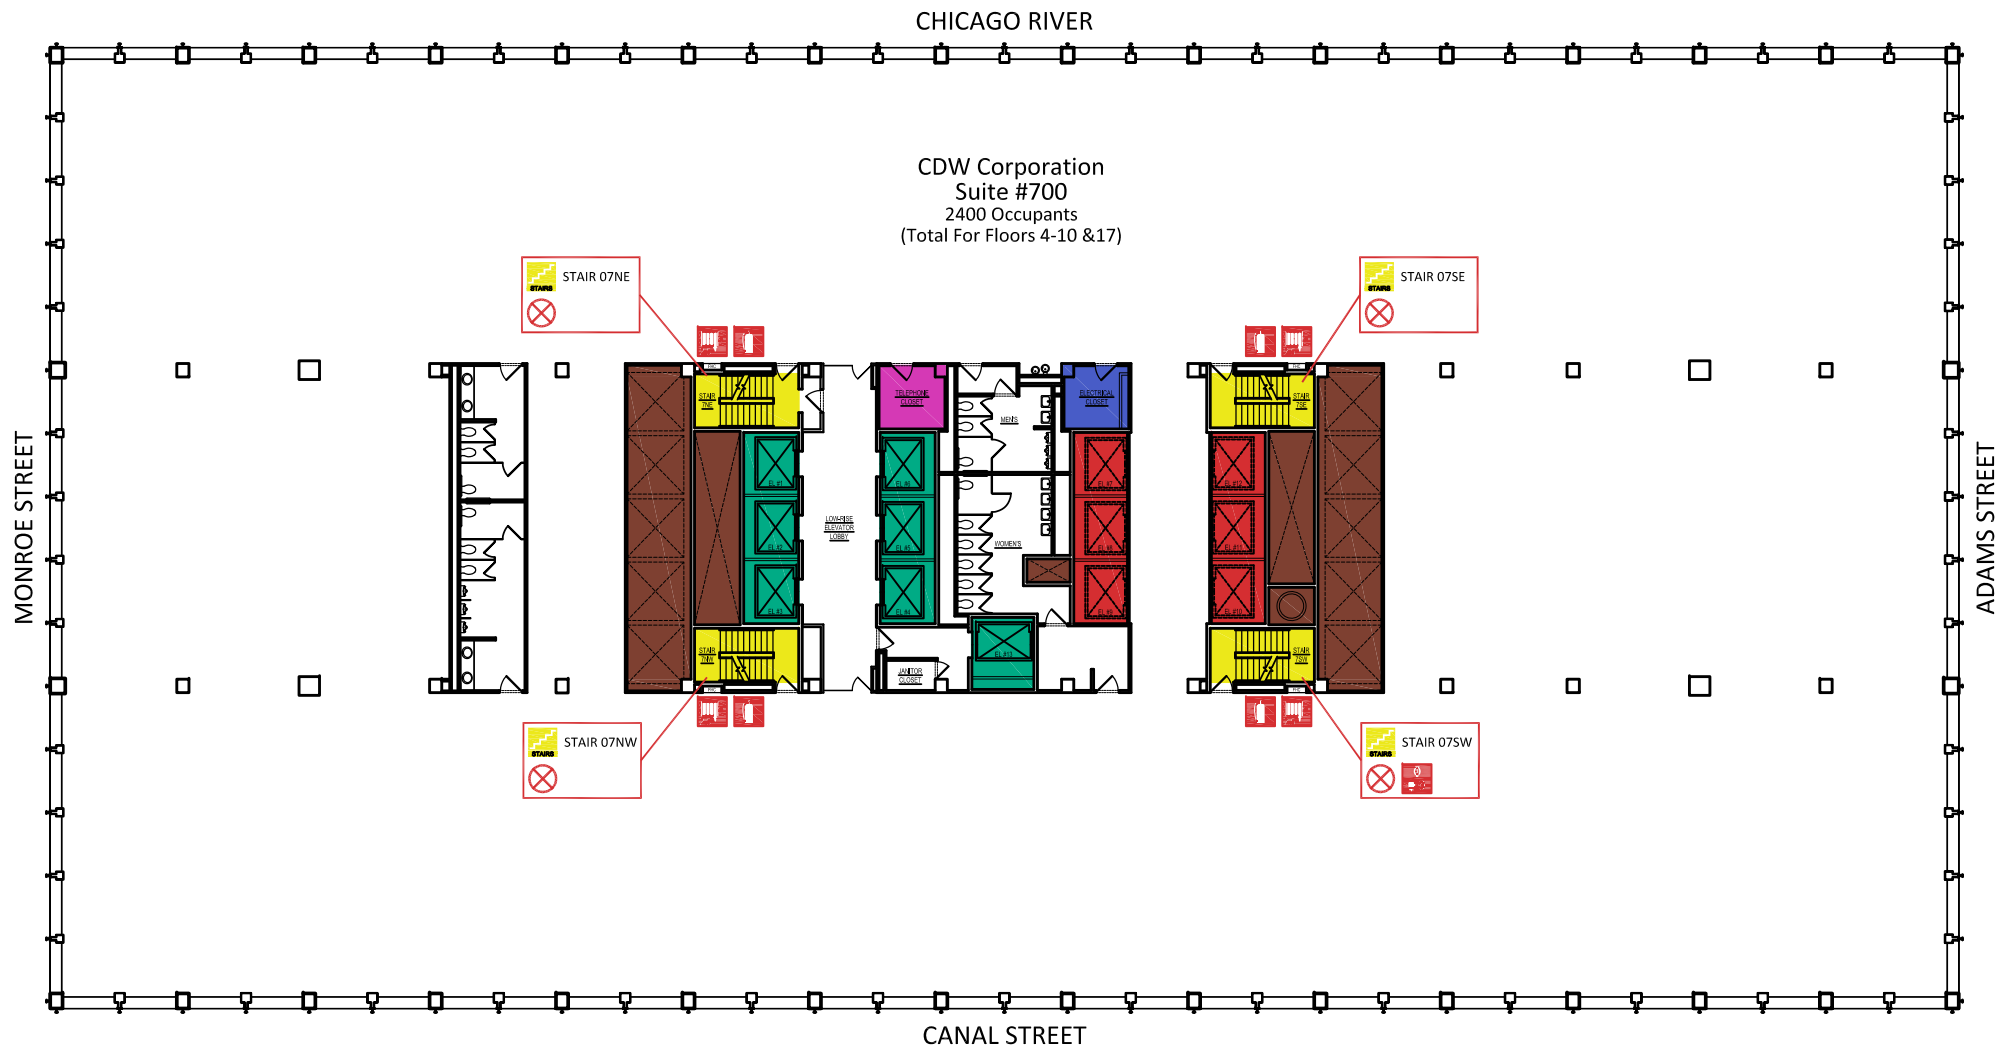


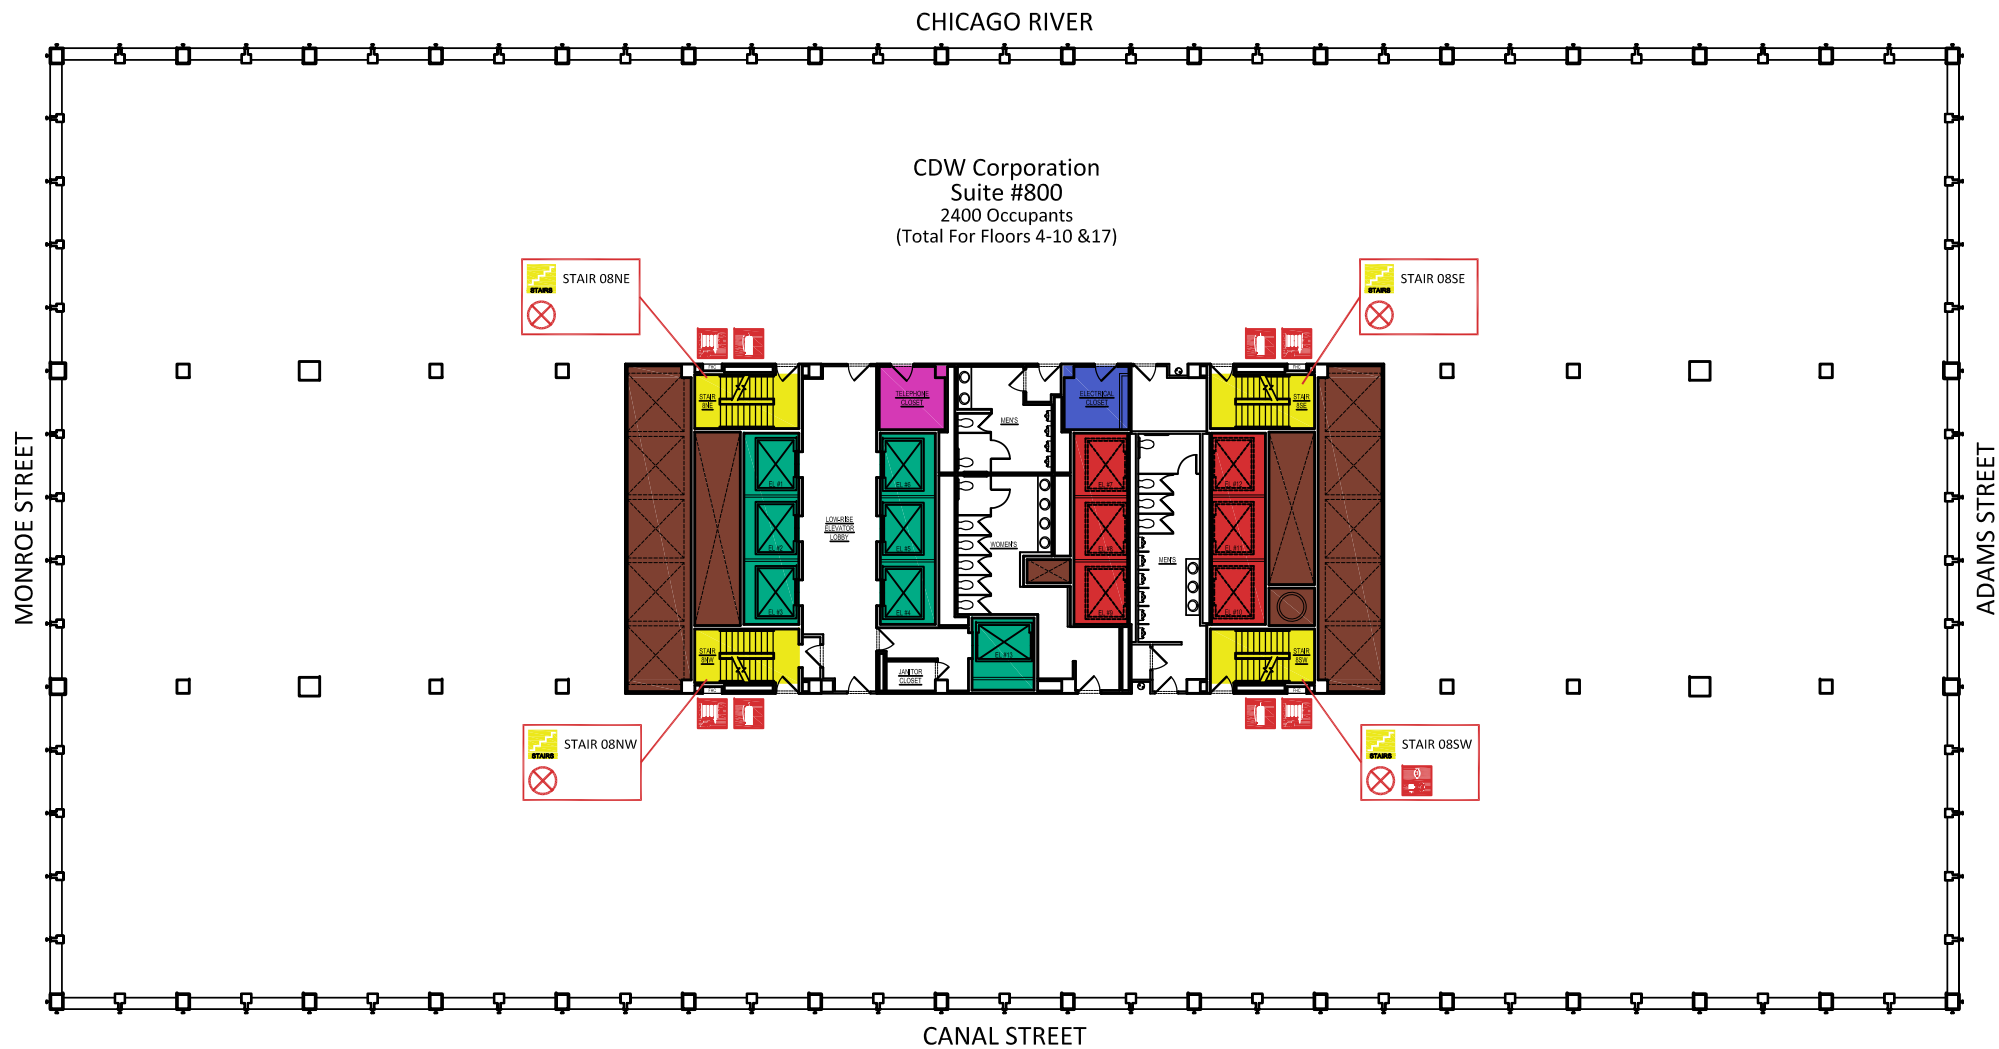


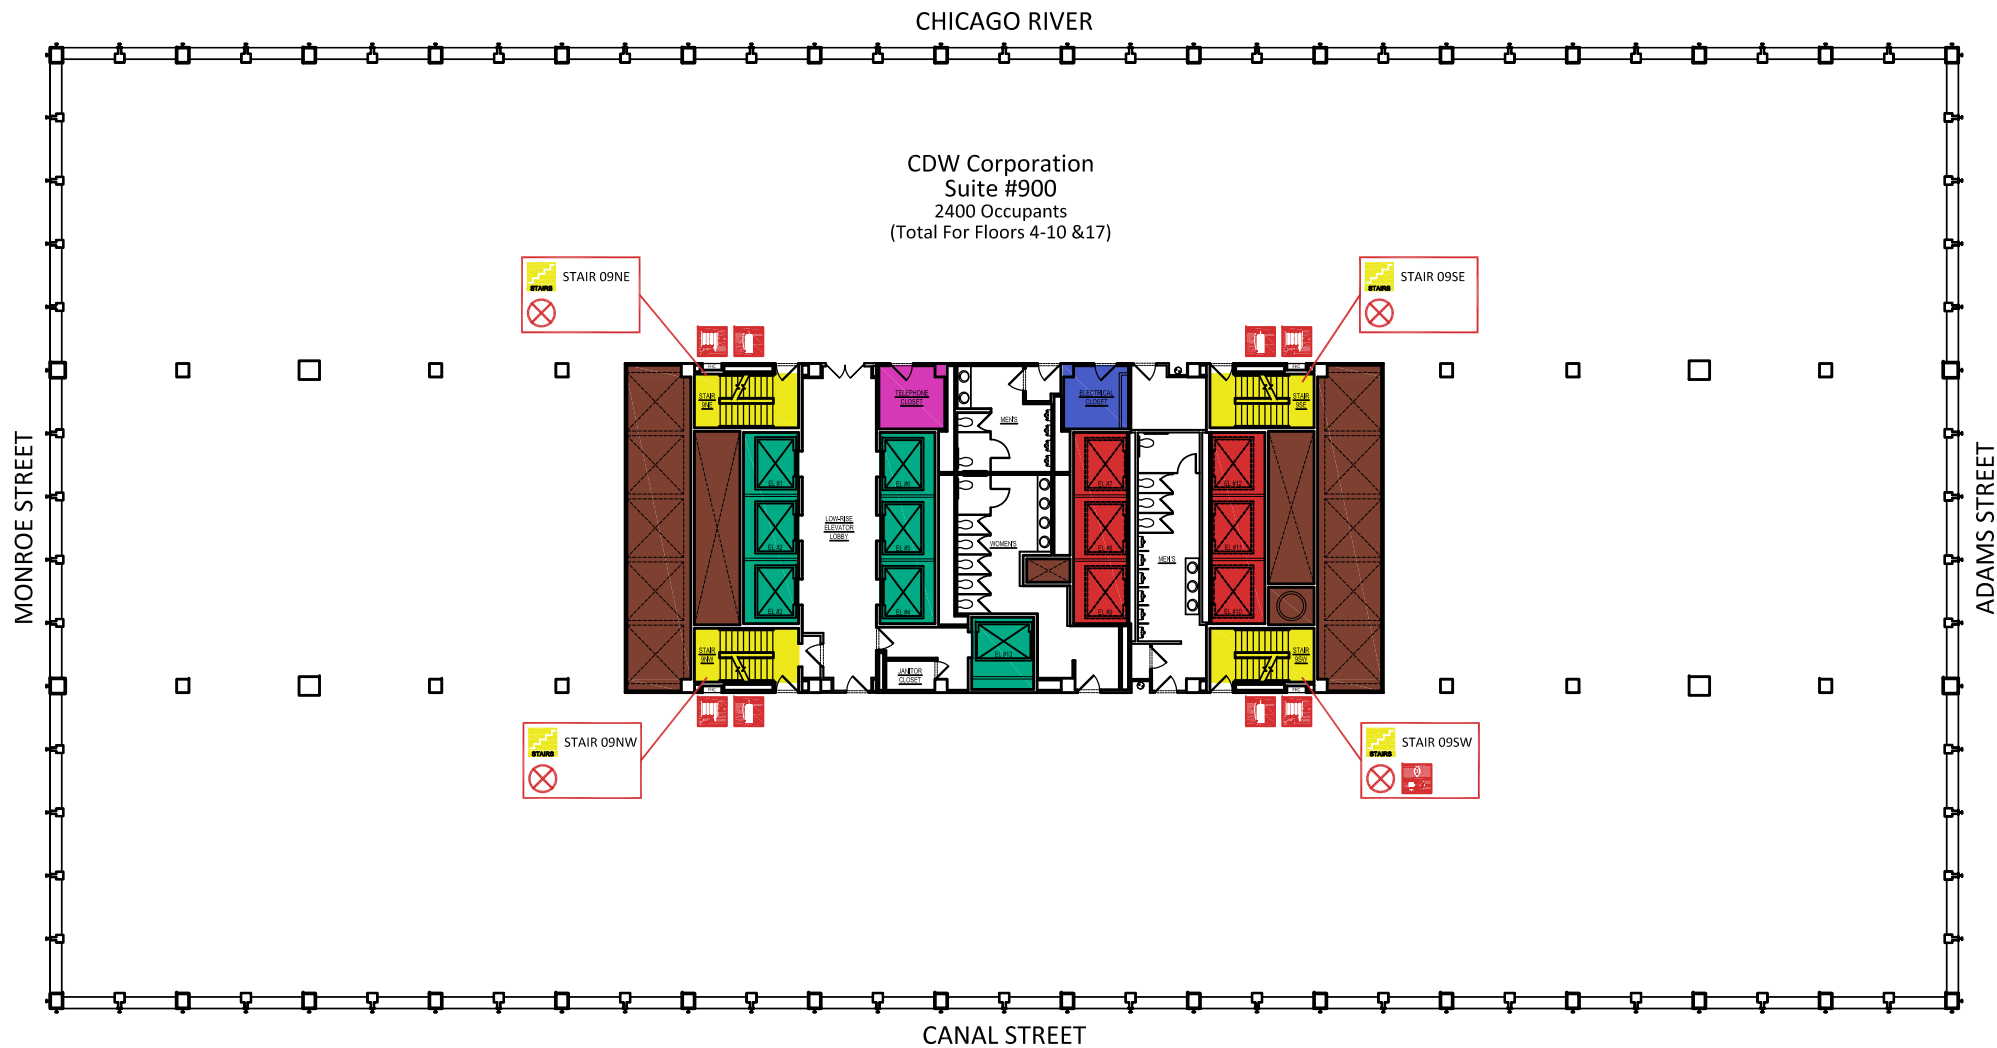

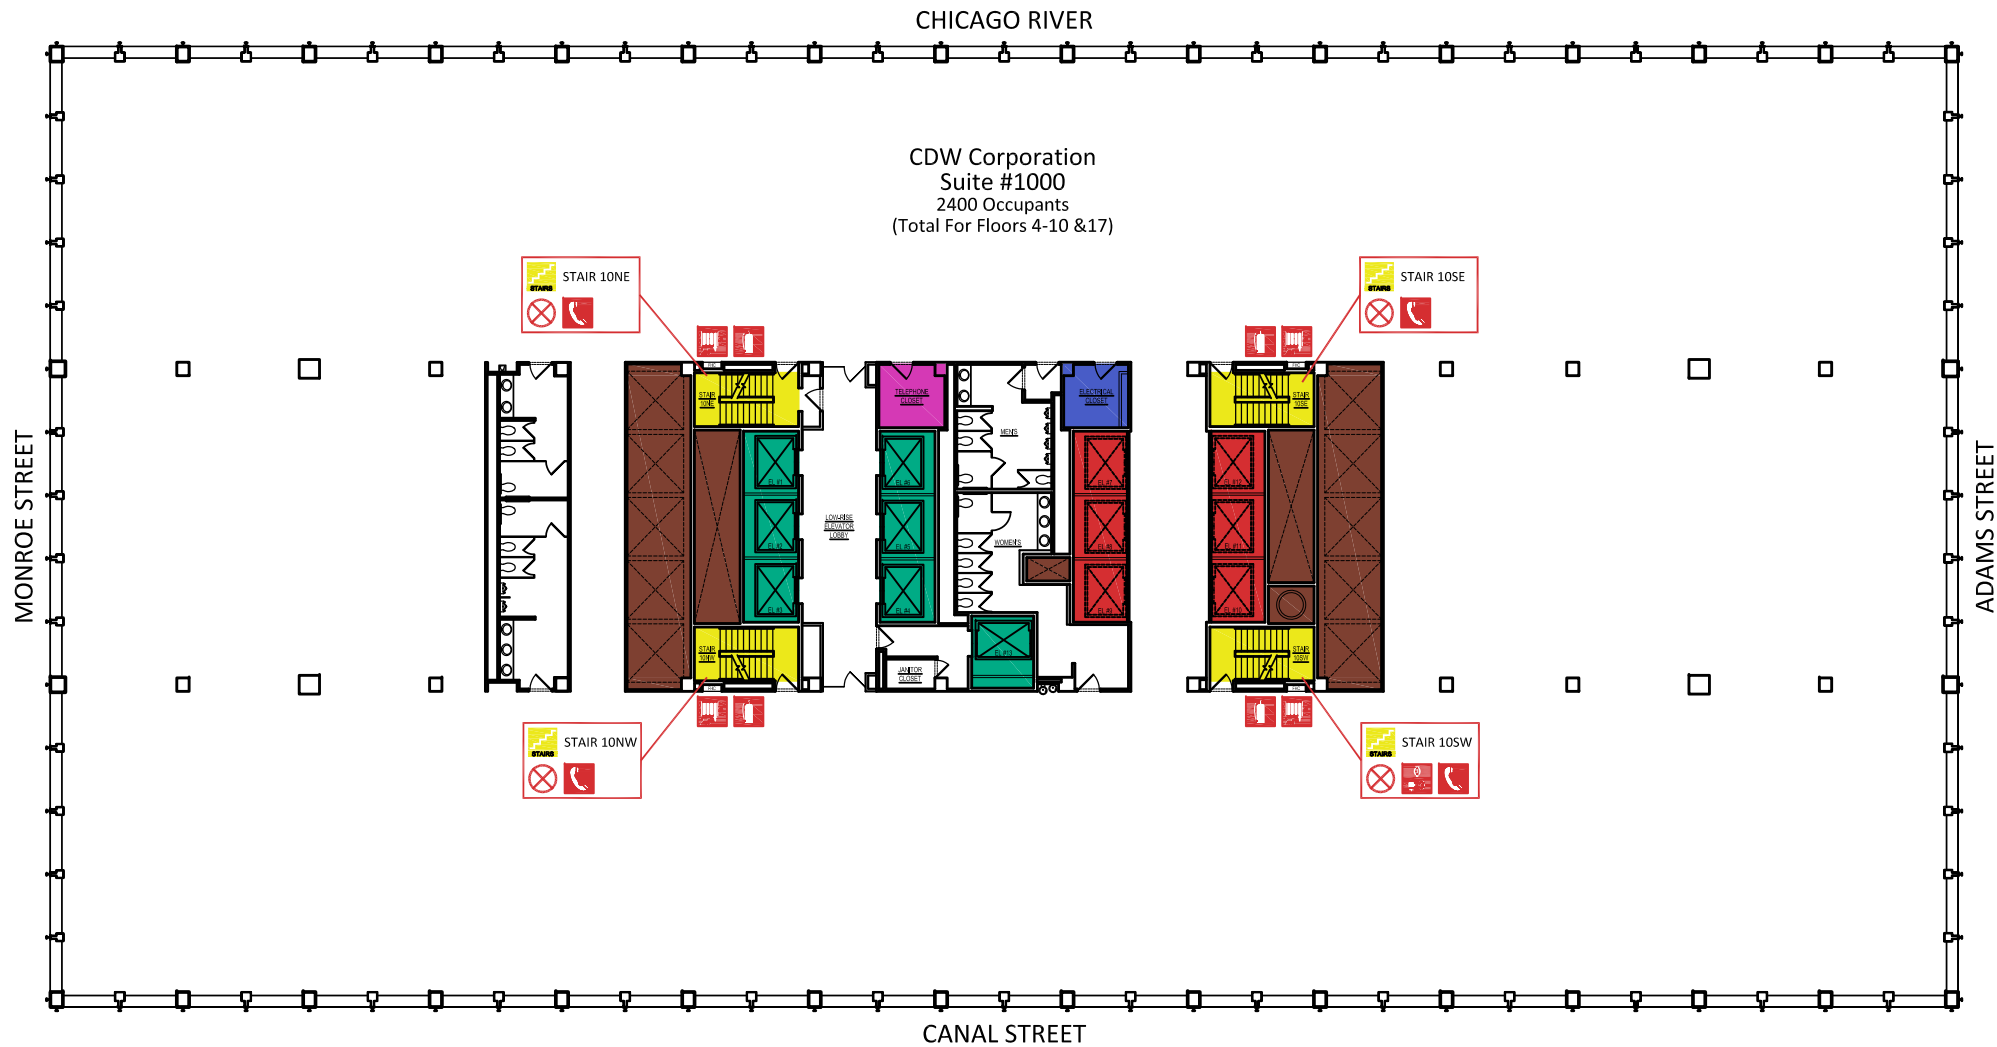

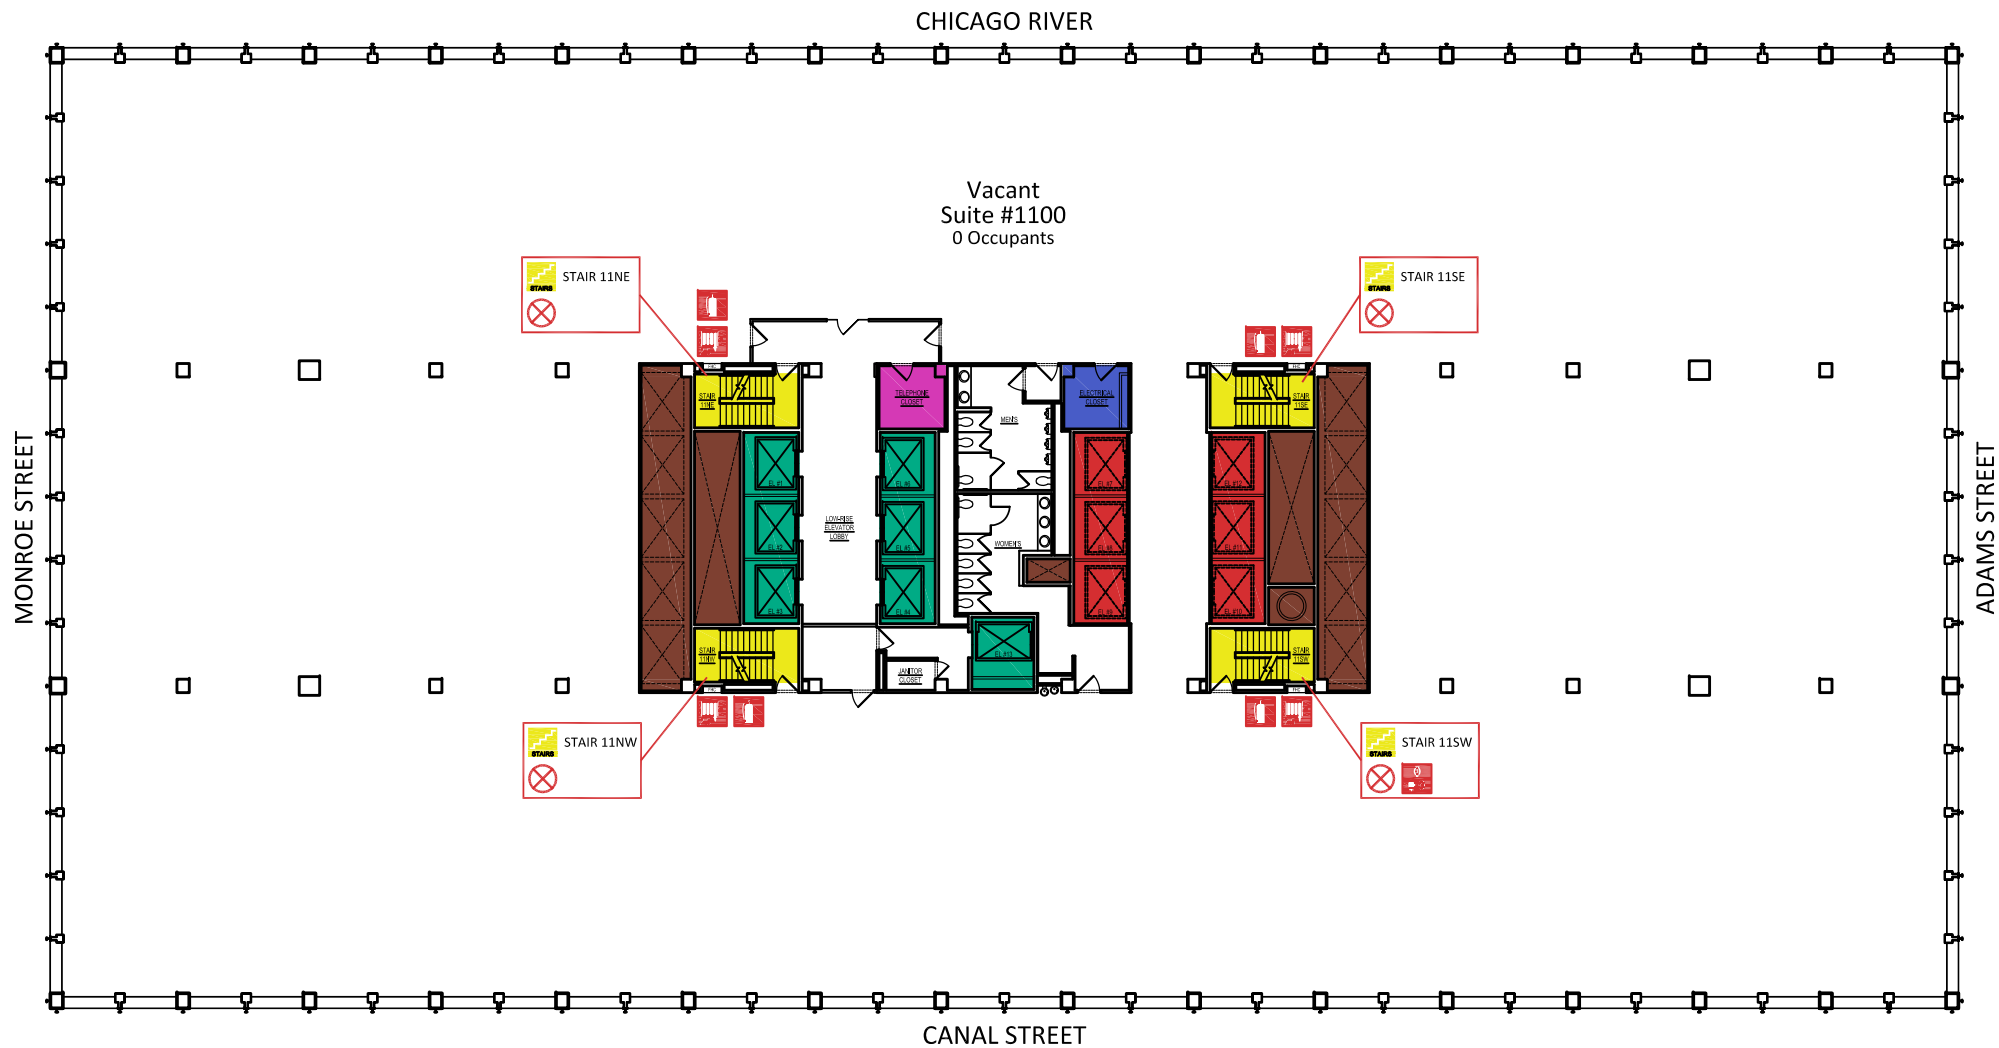

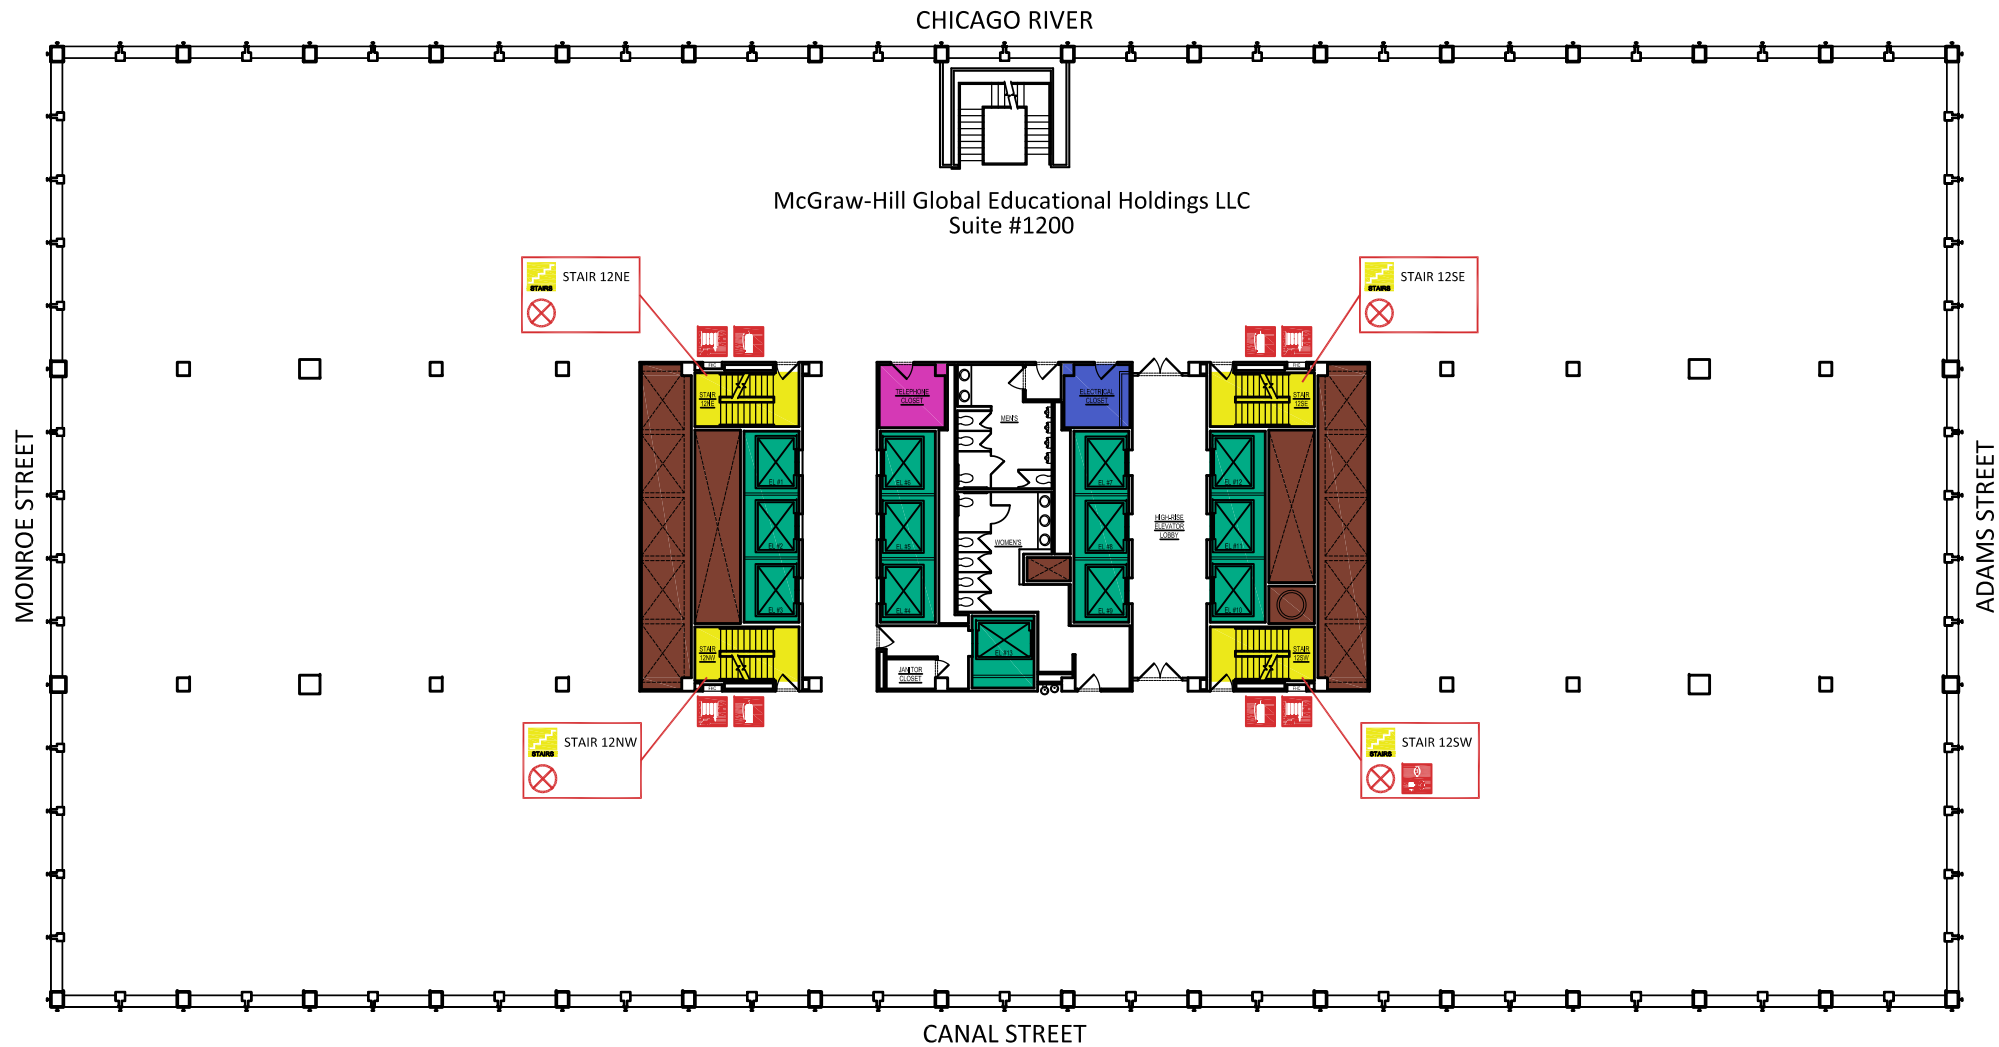

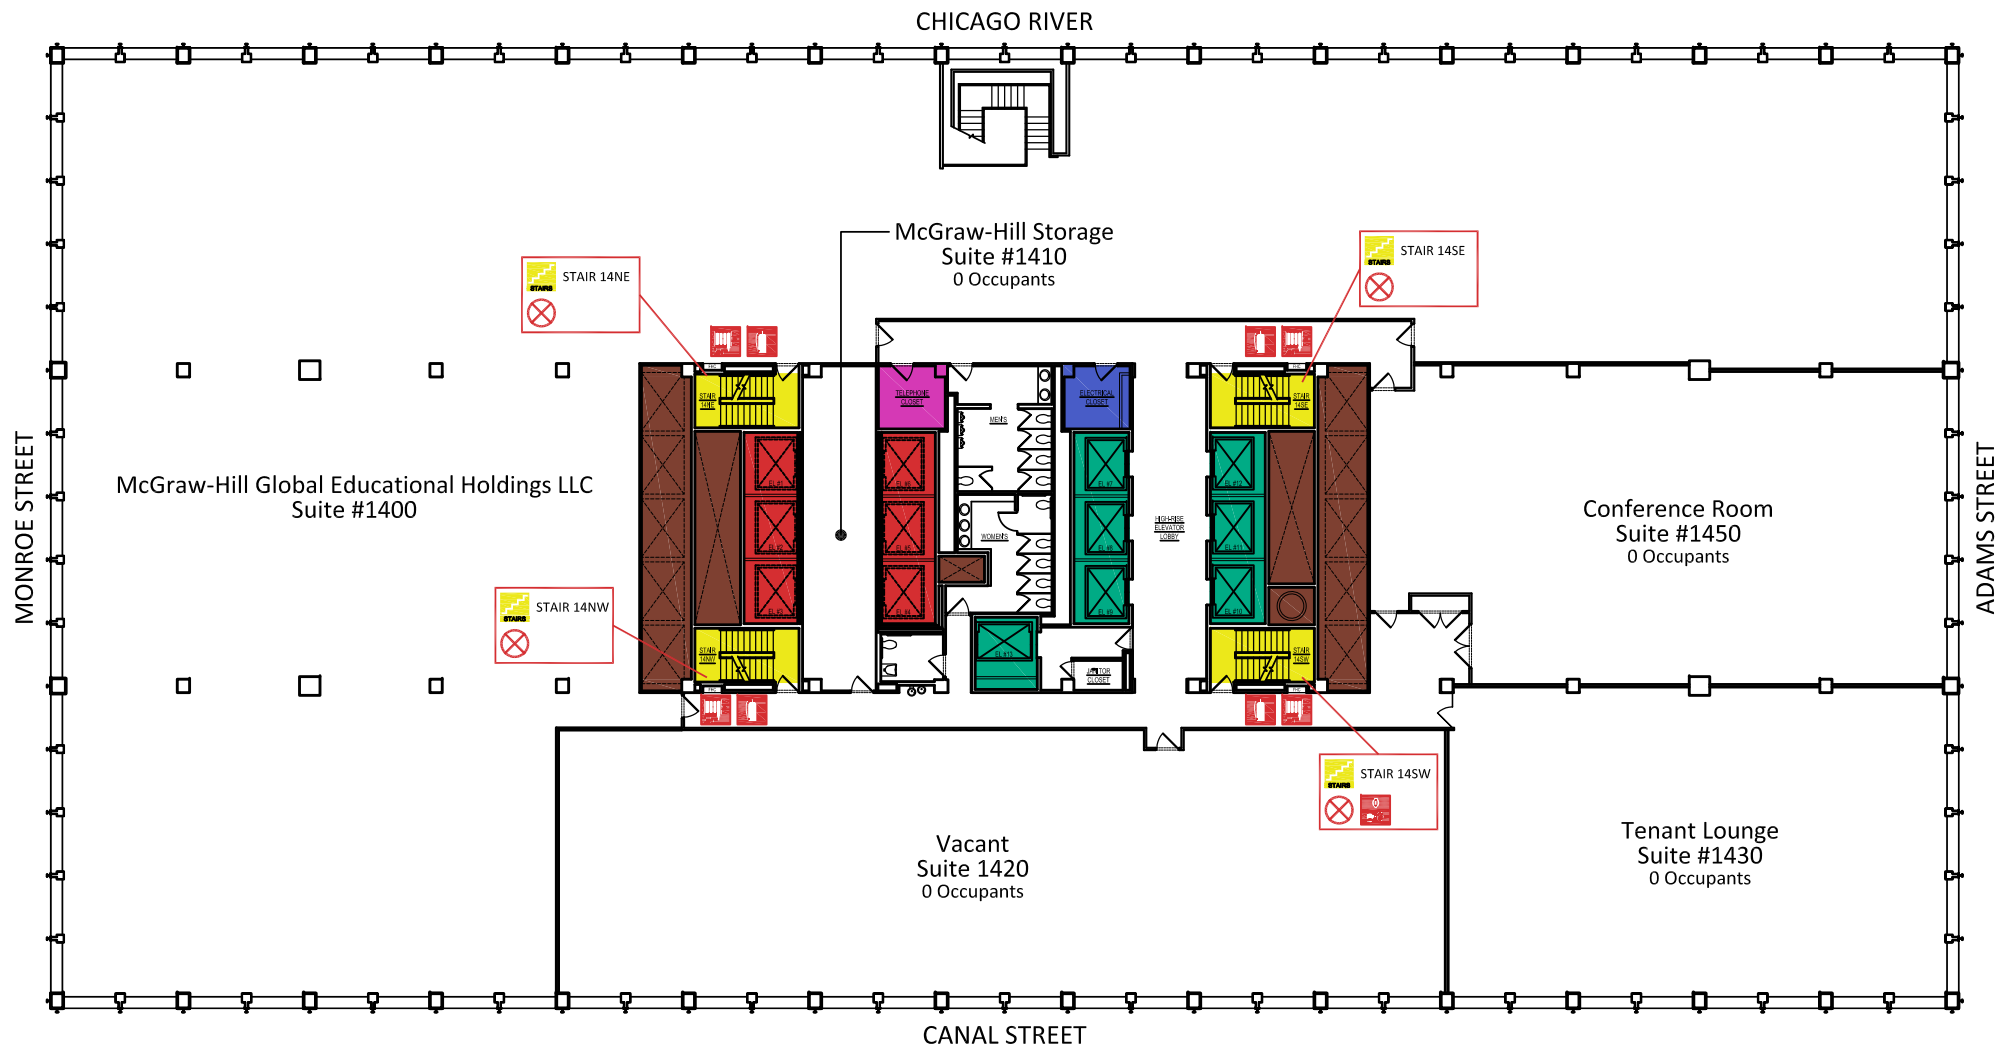

Ulta Inc.
Suite #1500
68 Occupants

MONROE STREET


ADAMS STREET


CANAL STREET


120 S. RIVERSIDE PLAZA - CHICAGO, ILLINOIS
FLOOR 15 - OEMC FIRE PLAN

December 26, 2018



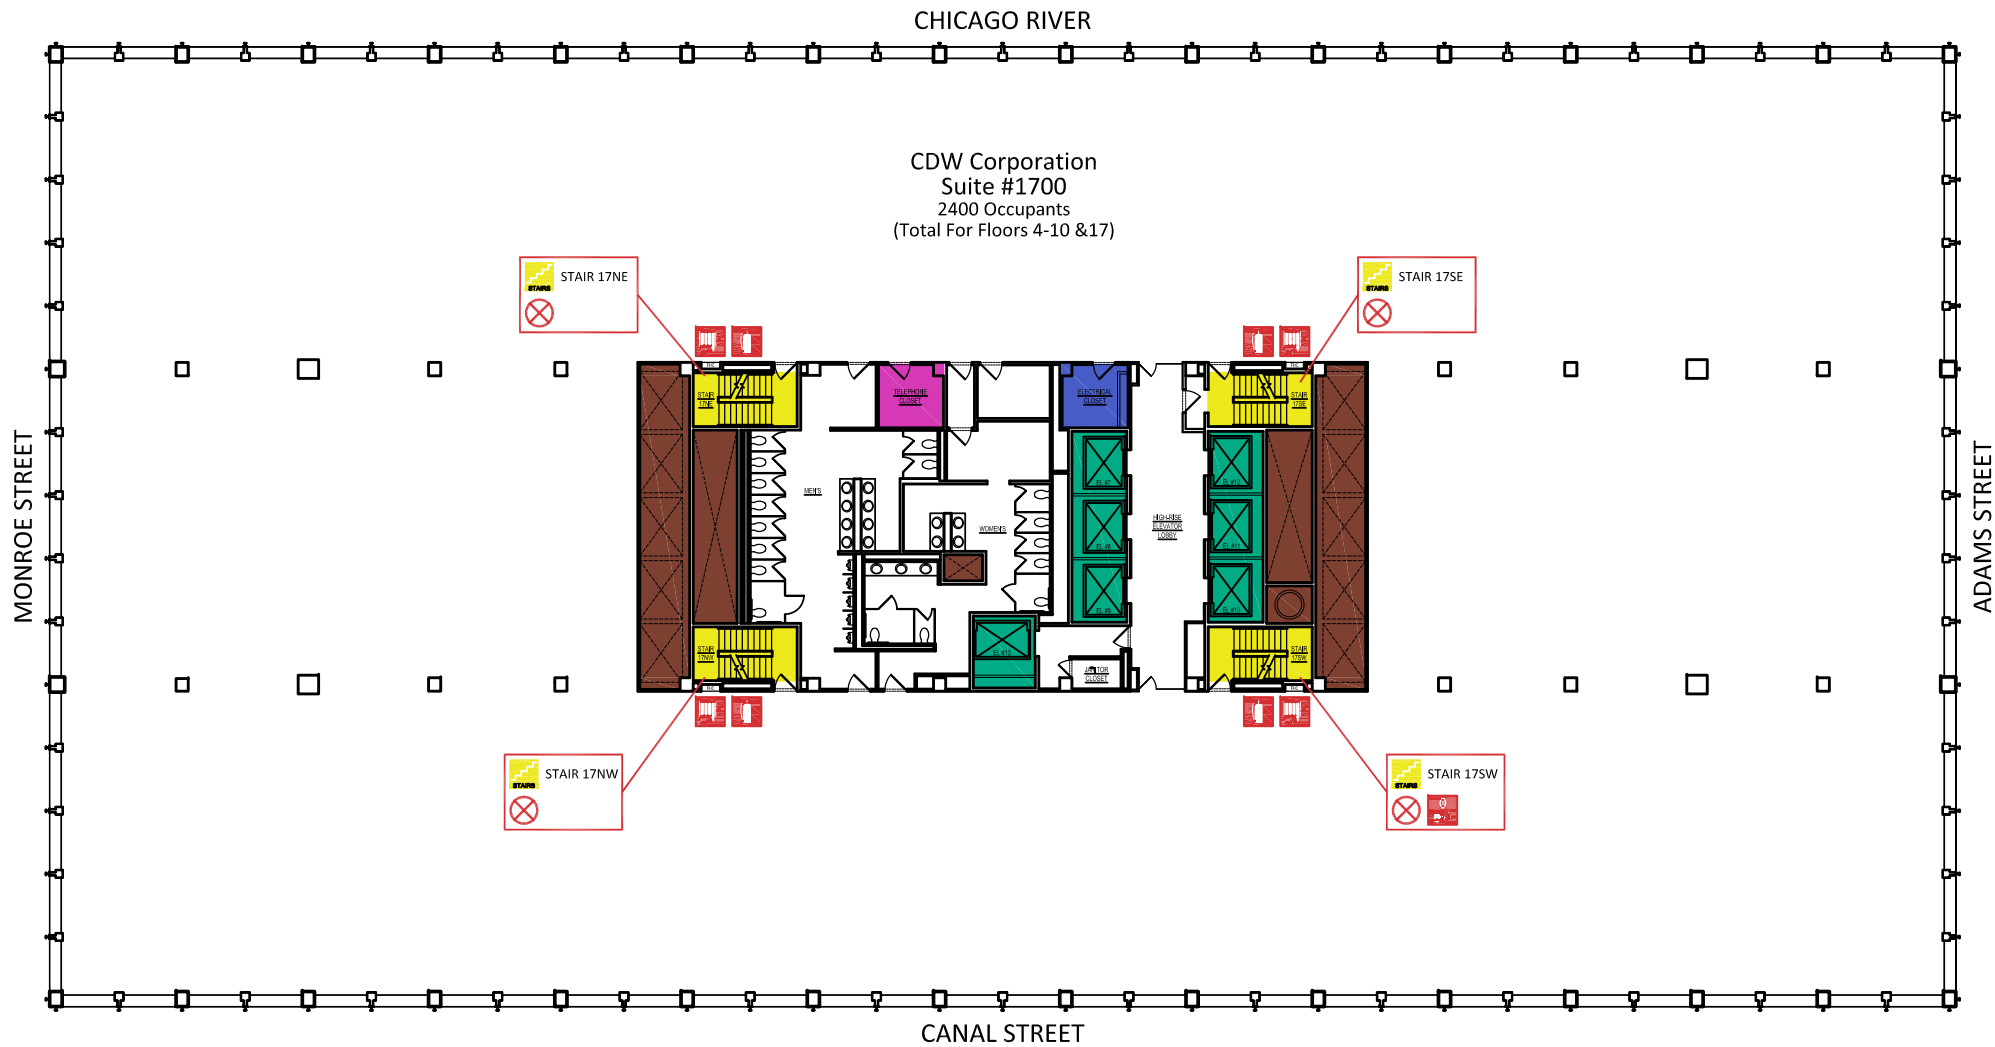

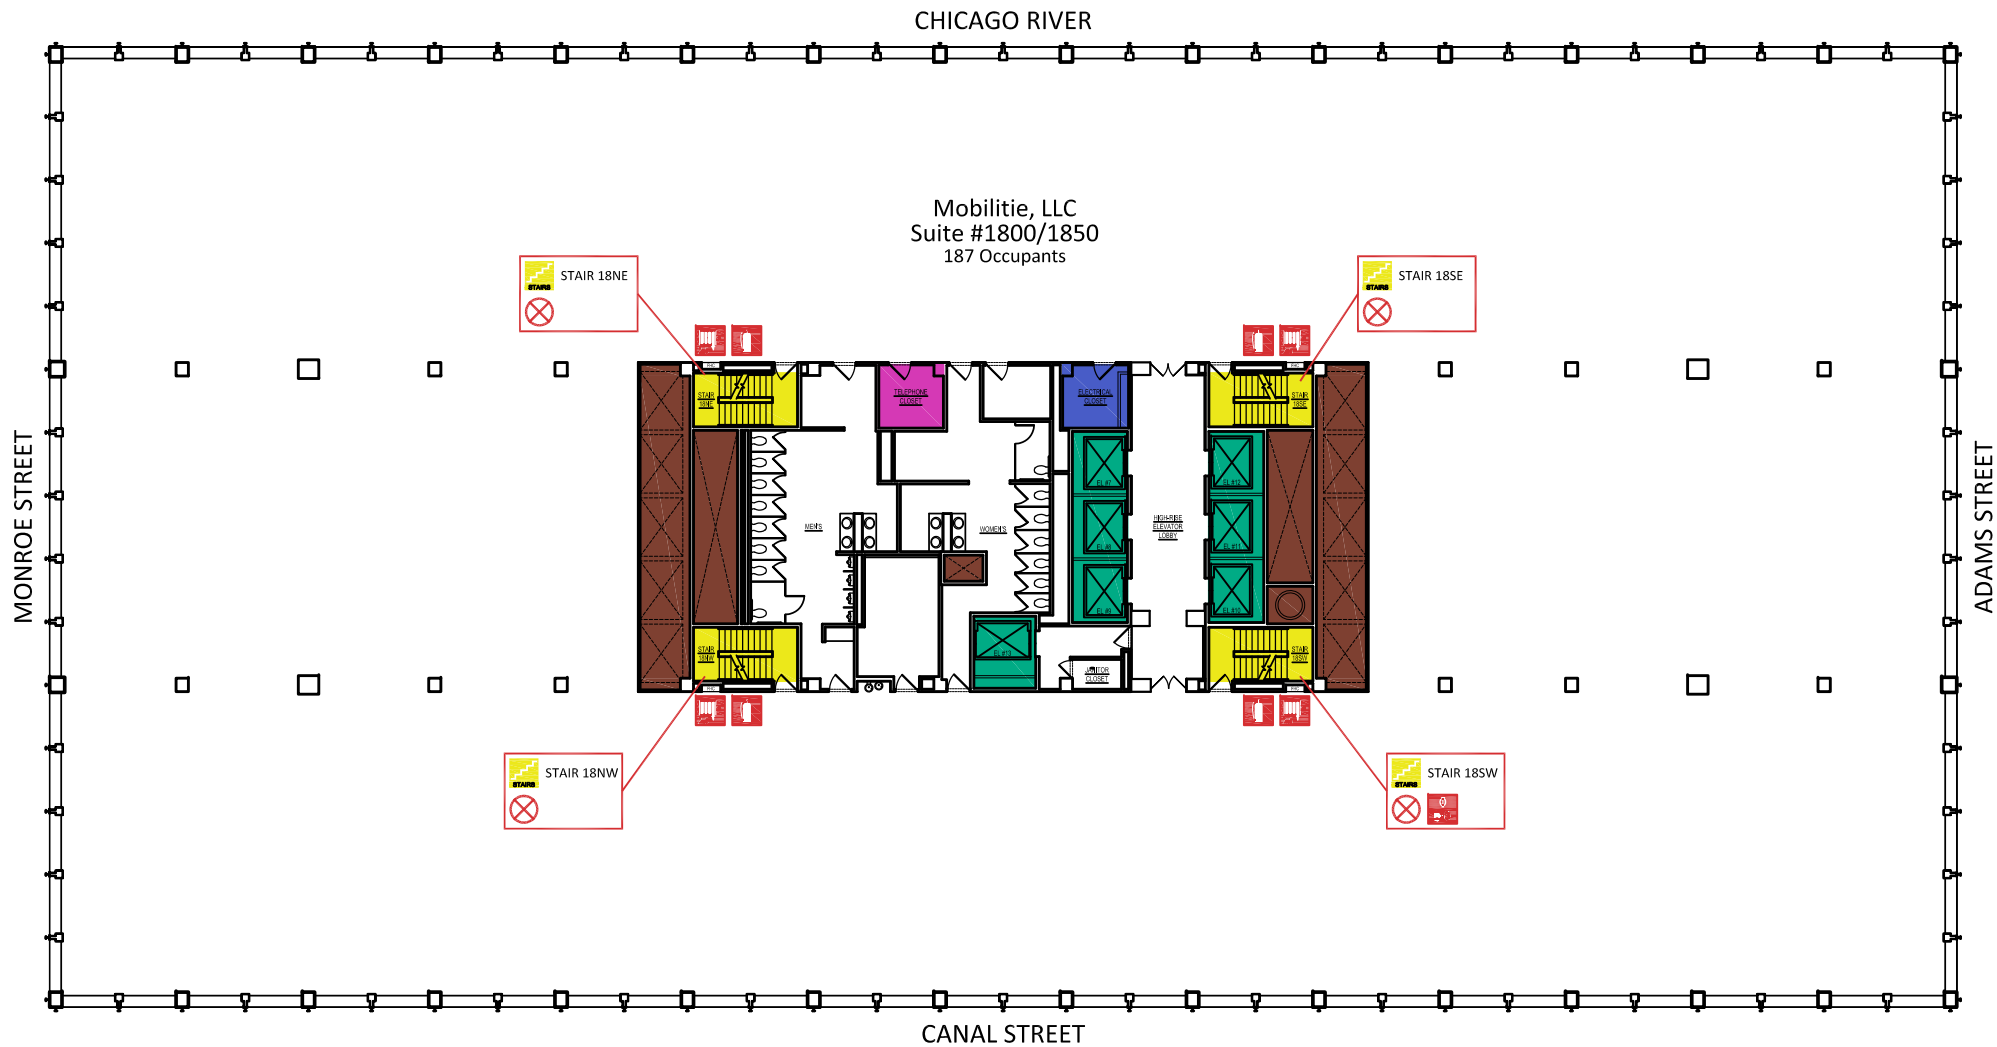

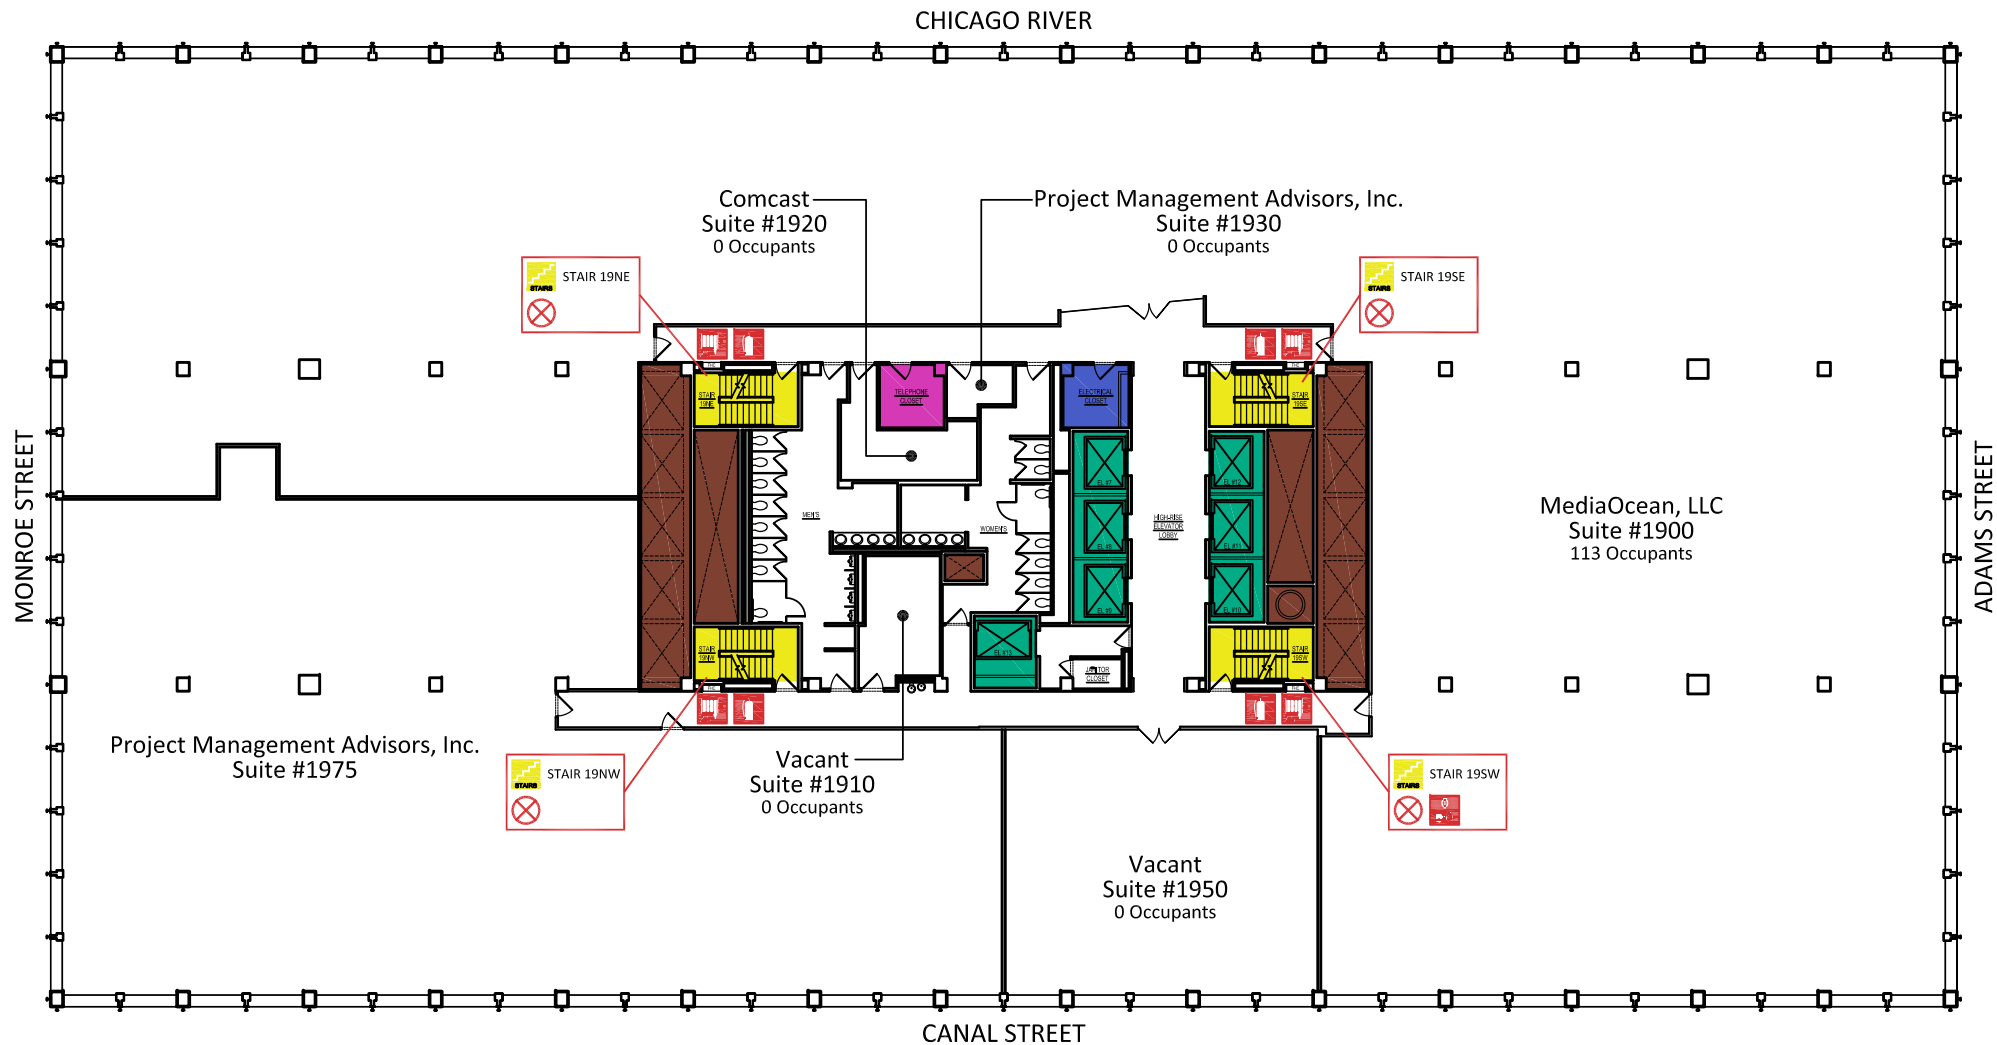

[illegible]

