




	ELEVATOR AVAILABLE		DEFIBRILLATOR (A.E.D.)		FIRE PUMP
	ELEVATOR NOT AVAILABLE		DOMESTIC WATER SHUTOFF		GAS SHUT OFF VALVE
	ELECTRICAL		ELECTRIC SHUTOFF		REFUGE AREA
	HAZARDOUS EQUIPMENT		EMERGENCY TELEPHONE		SIAMESE/FIRE DEPT. CONNECTION
	SMOKE TOWER		FIRE ALARM ANNUNCIATOR		SPRINKLER CONTROL VALVE
	STAIRWELL		FIRE EXTINGUISHER		STANDPIPE/RISER
	TELEPHONE		1-1/2" FIRE HOSE CONNECTION		STAIRWELL
	VERTICAL OPENINGS		2-1/2" FIRE HOSE CONNECTION		VOICE CONTROL PANEL

□ □ □ □ □ □ □ □ □ □ □ □ □ □ □ □




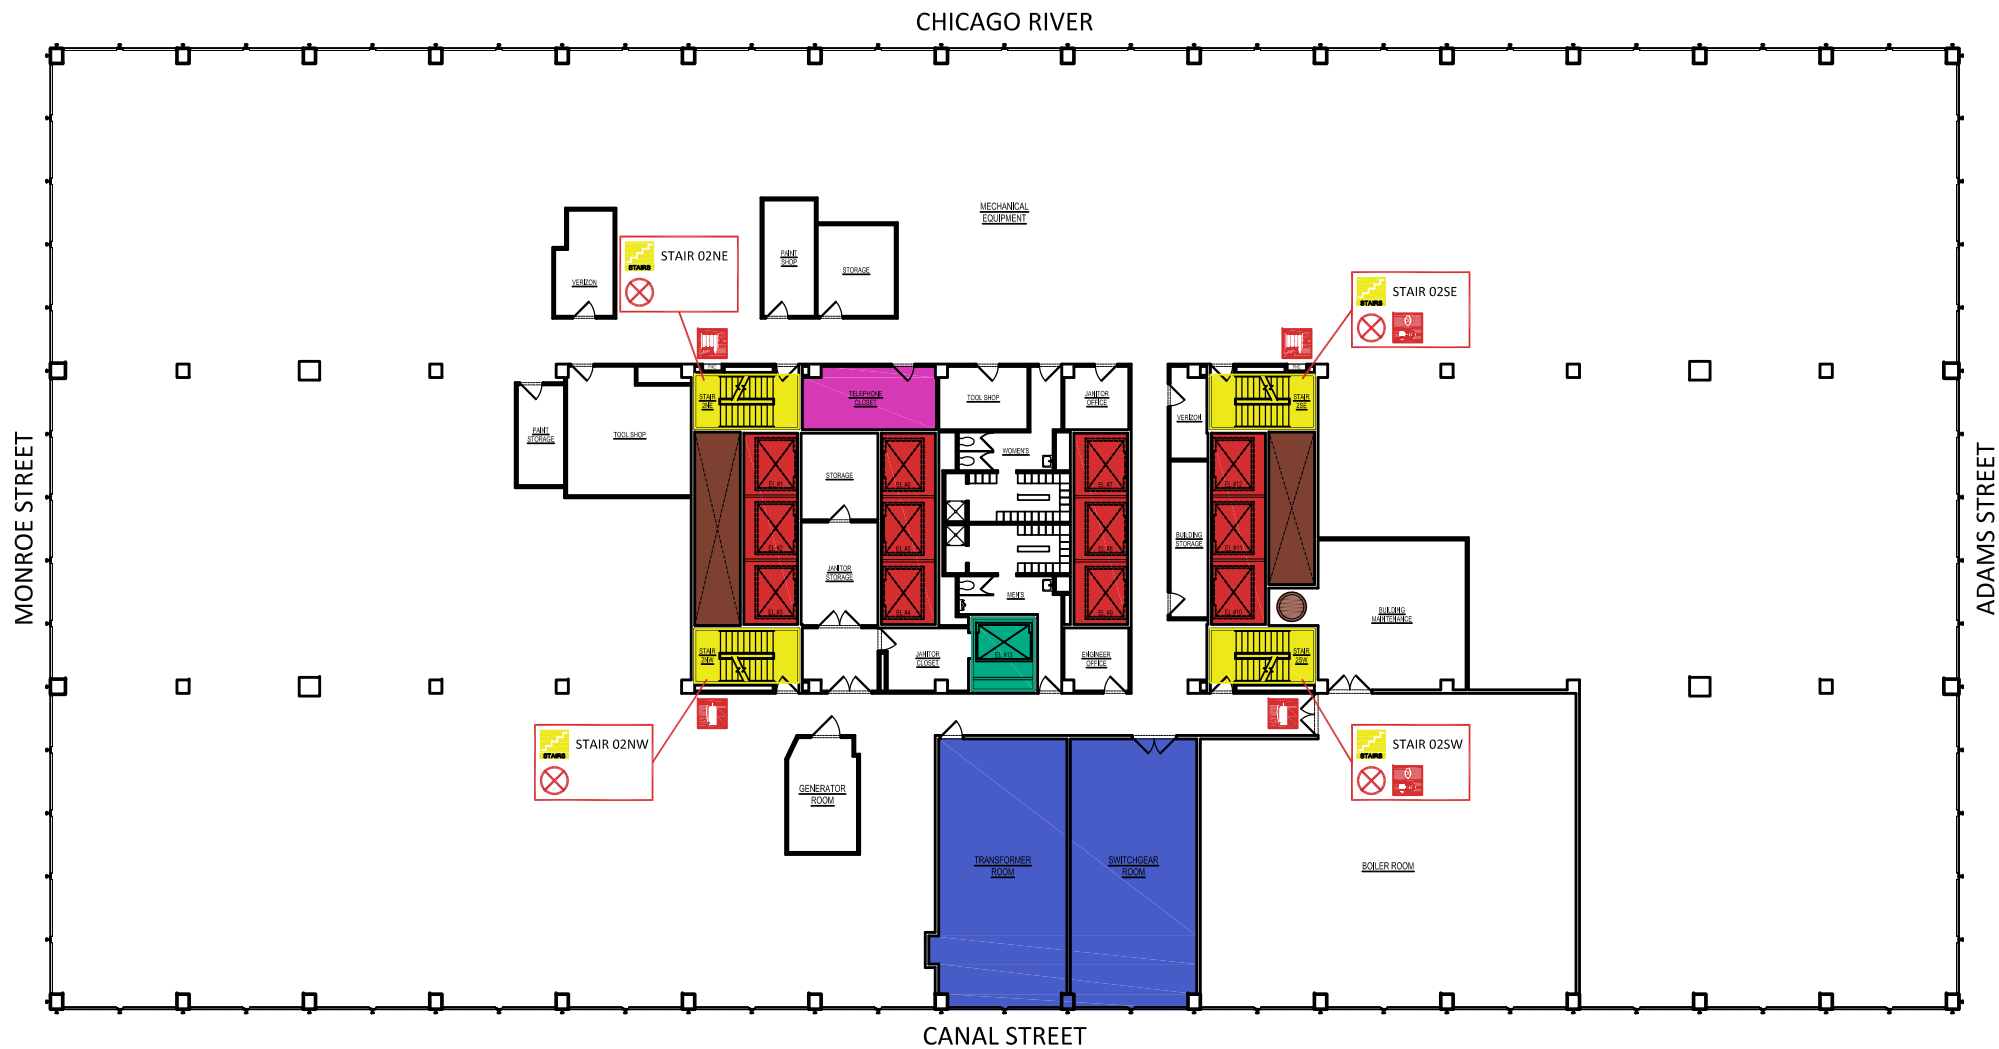


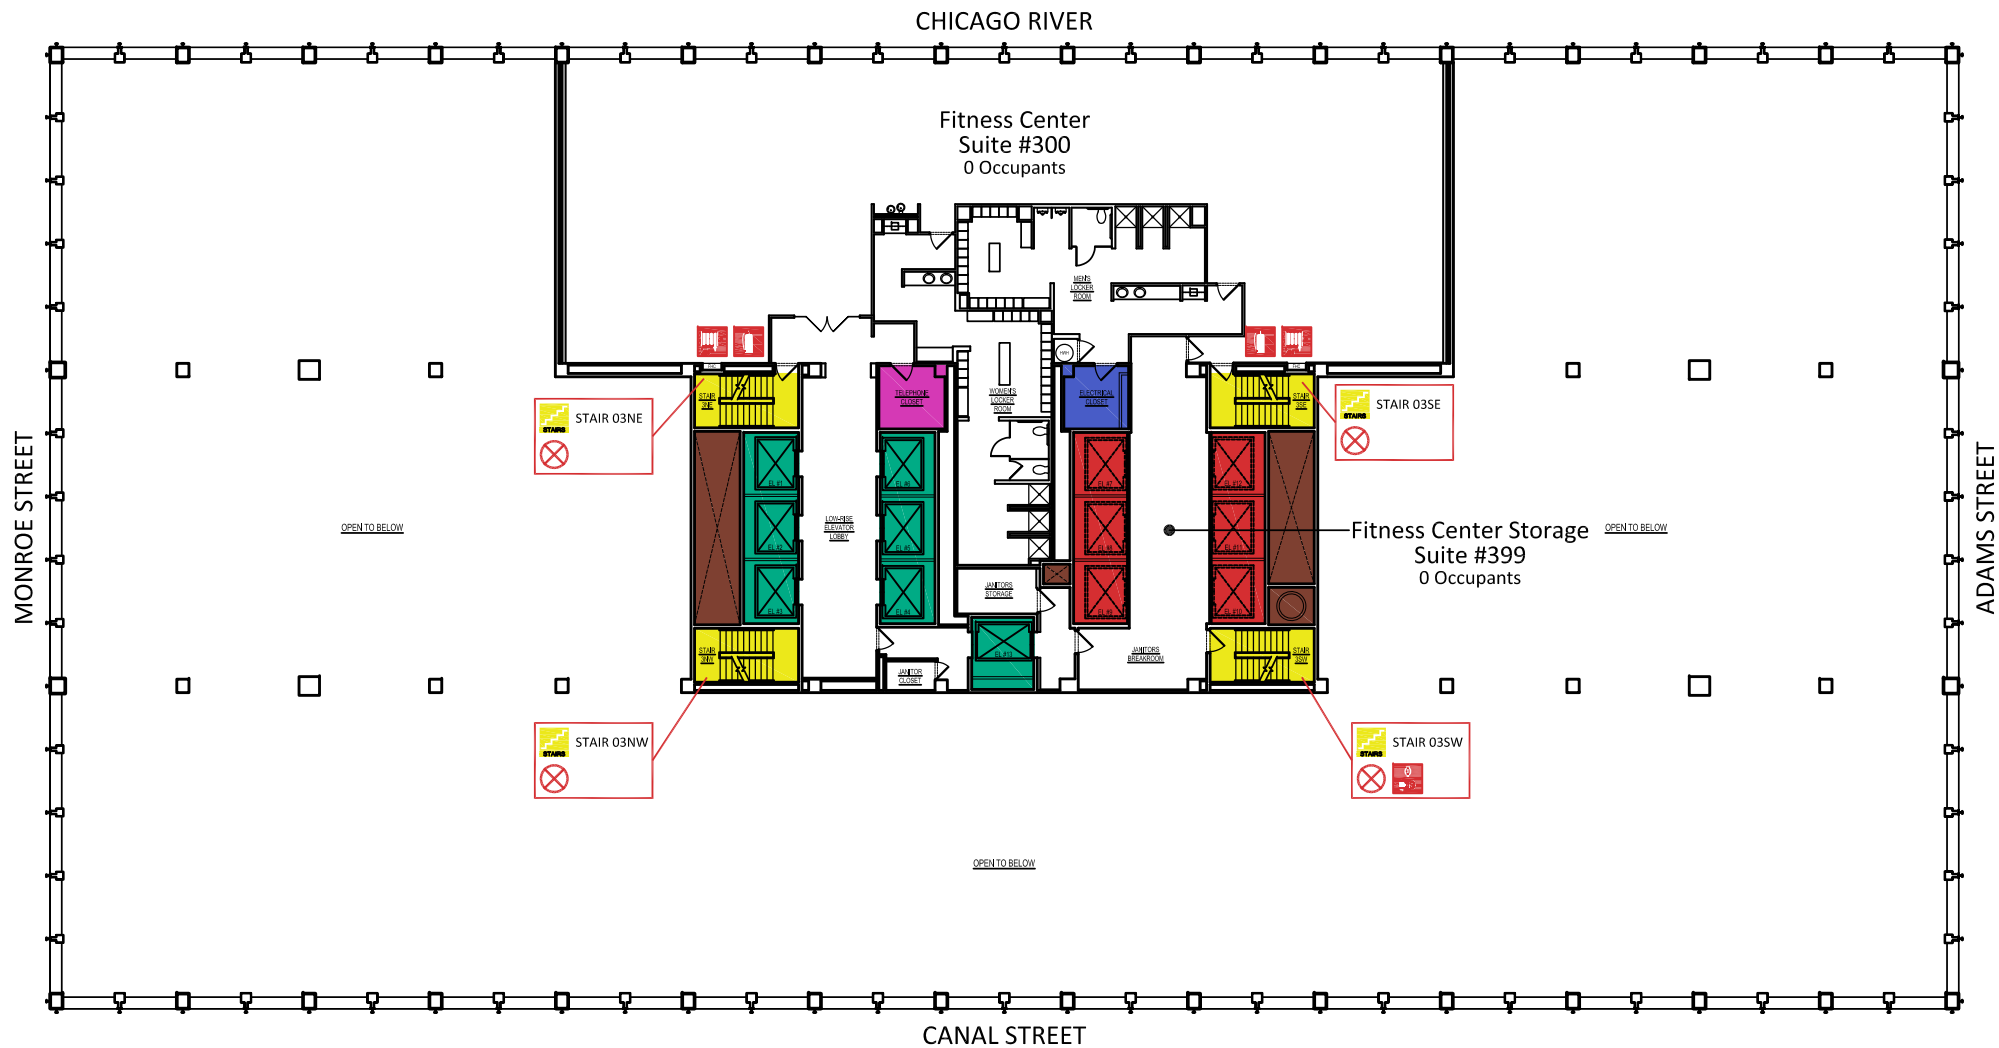

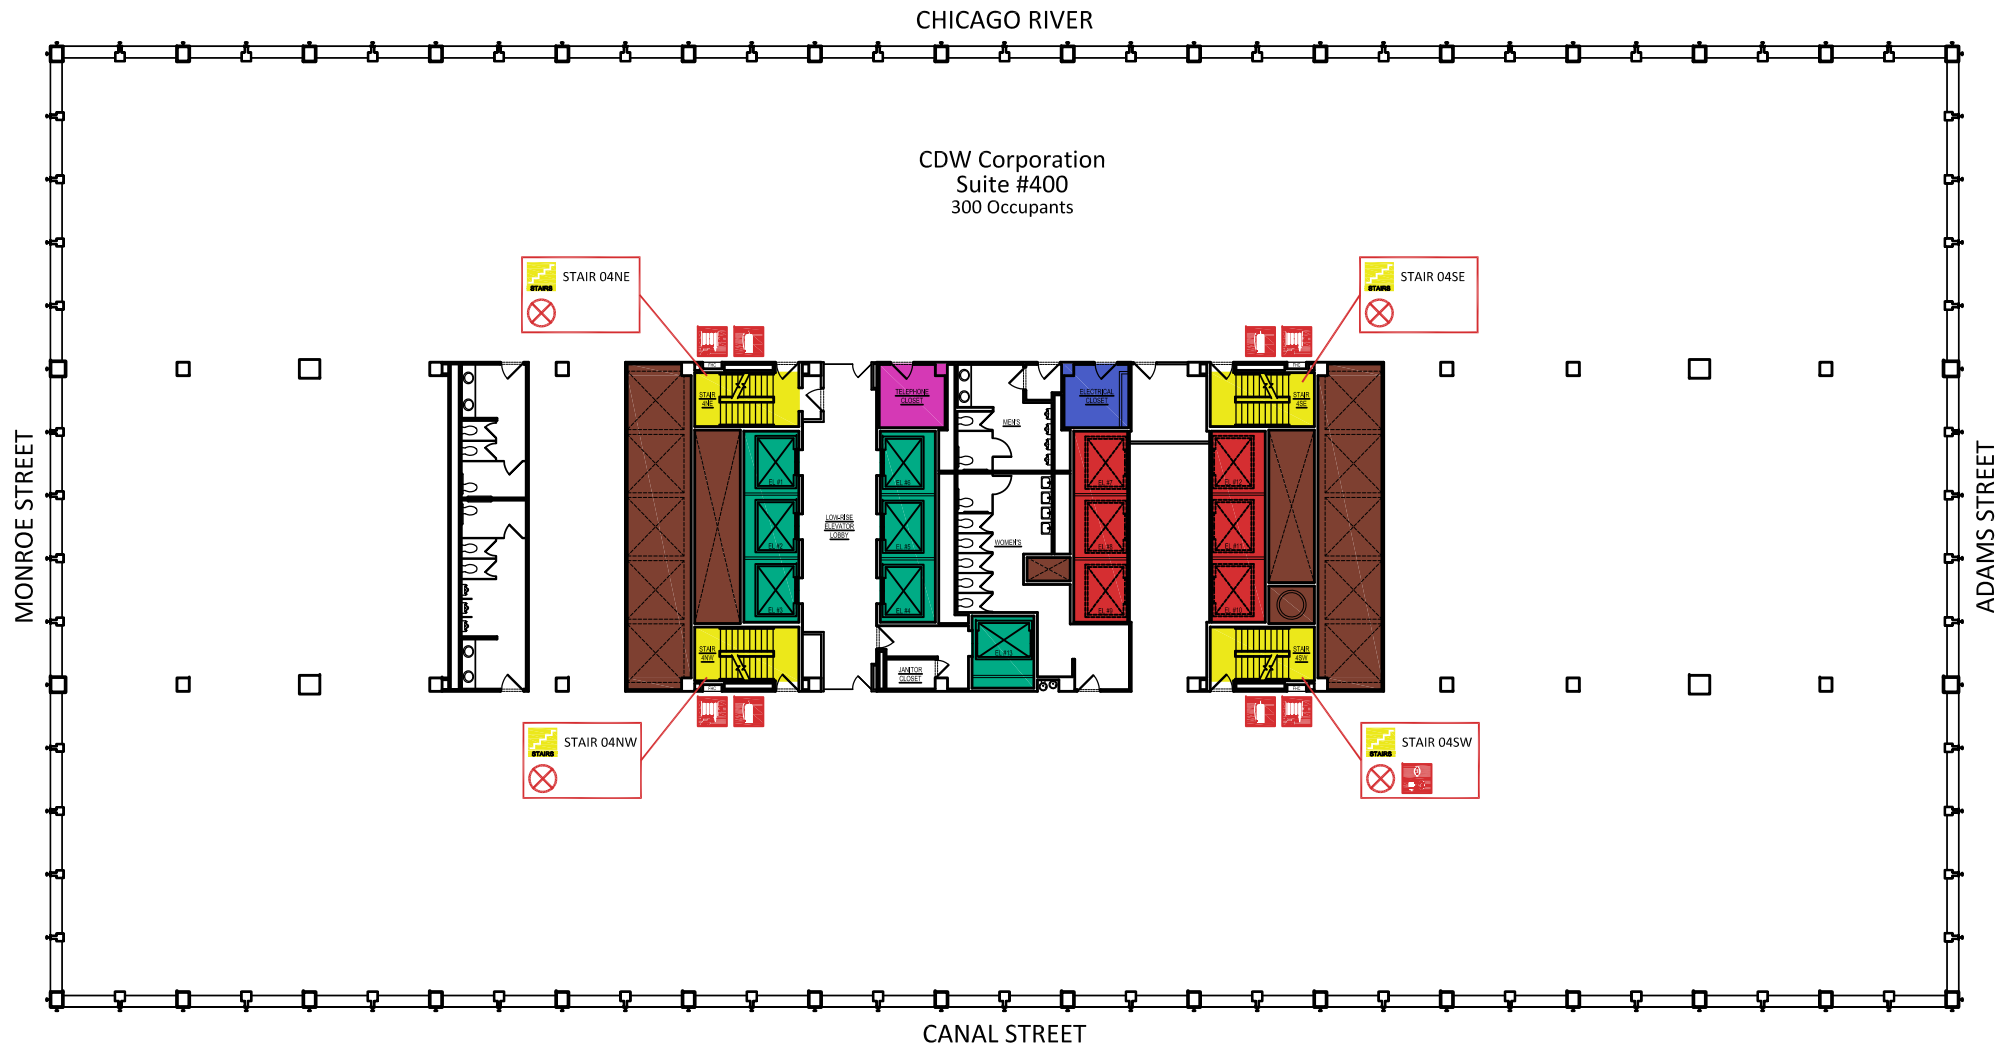

CDW Corporation
Suite #500
300 Occupants

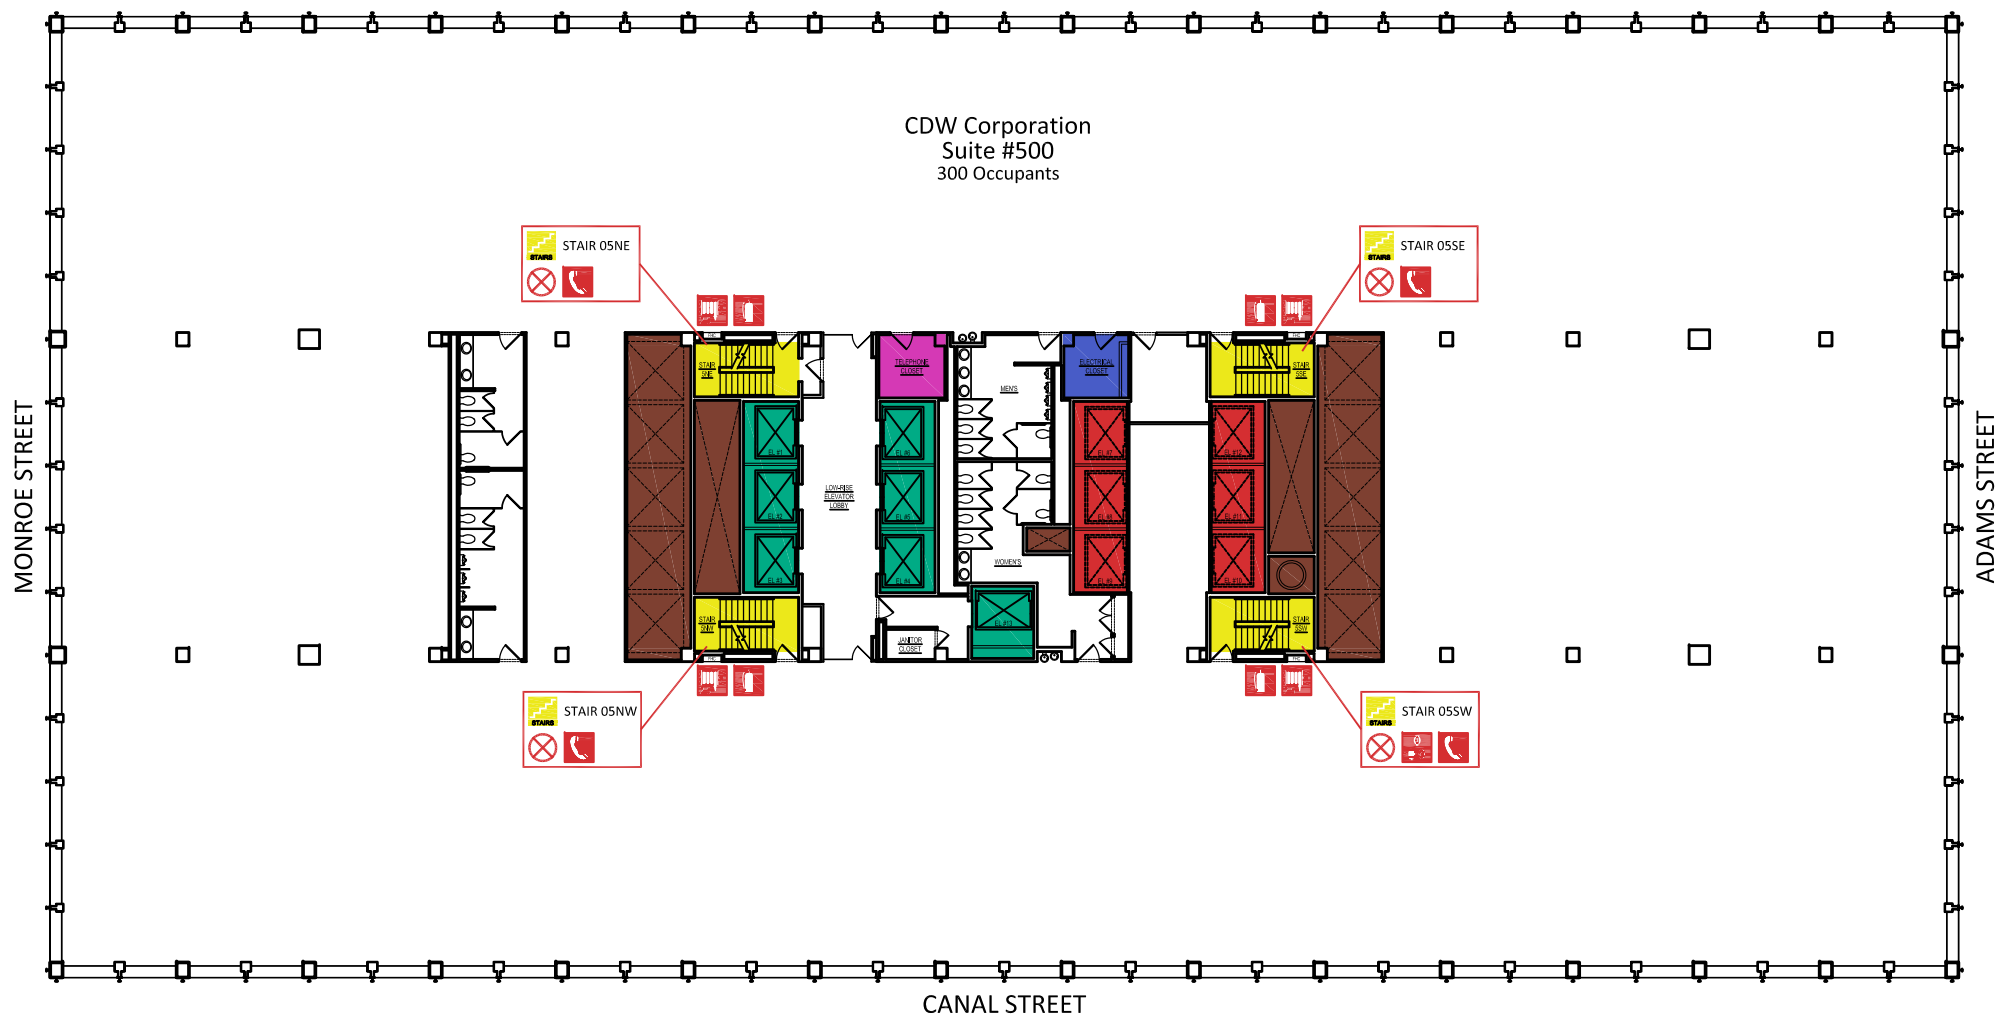

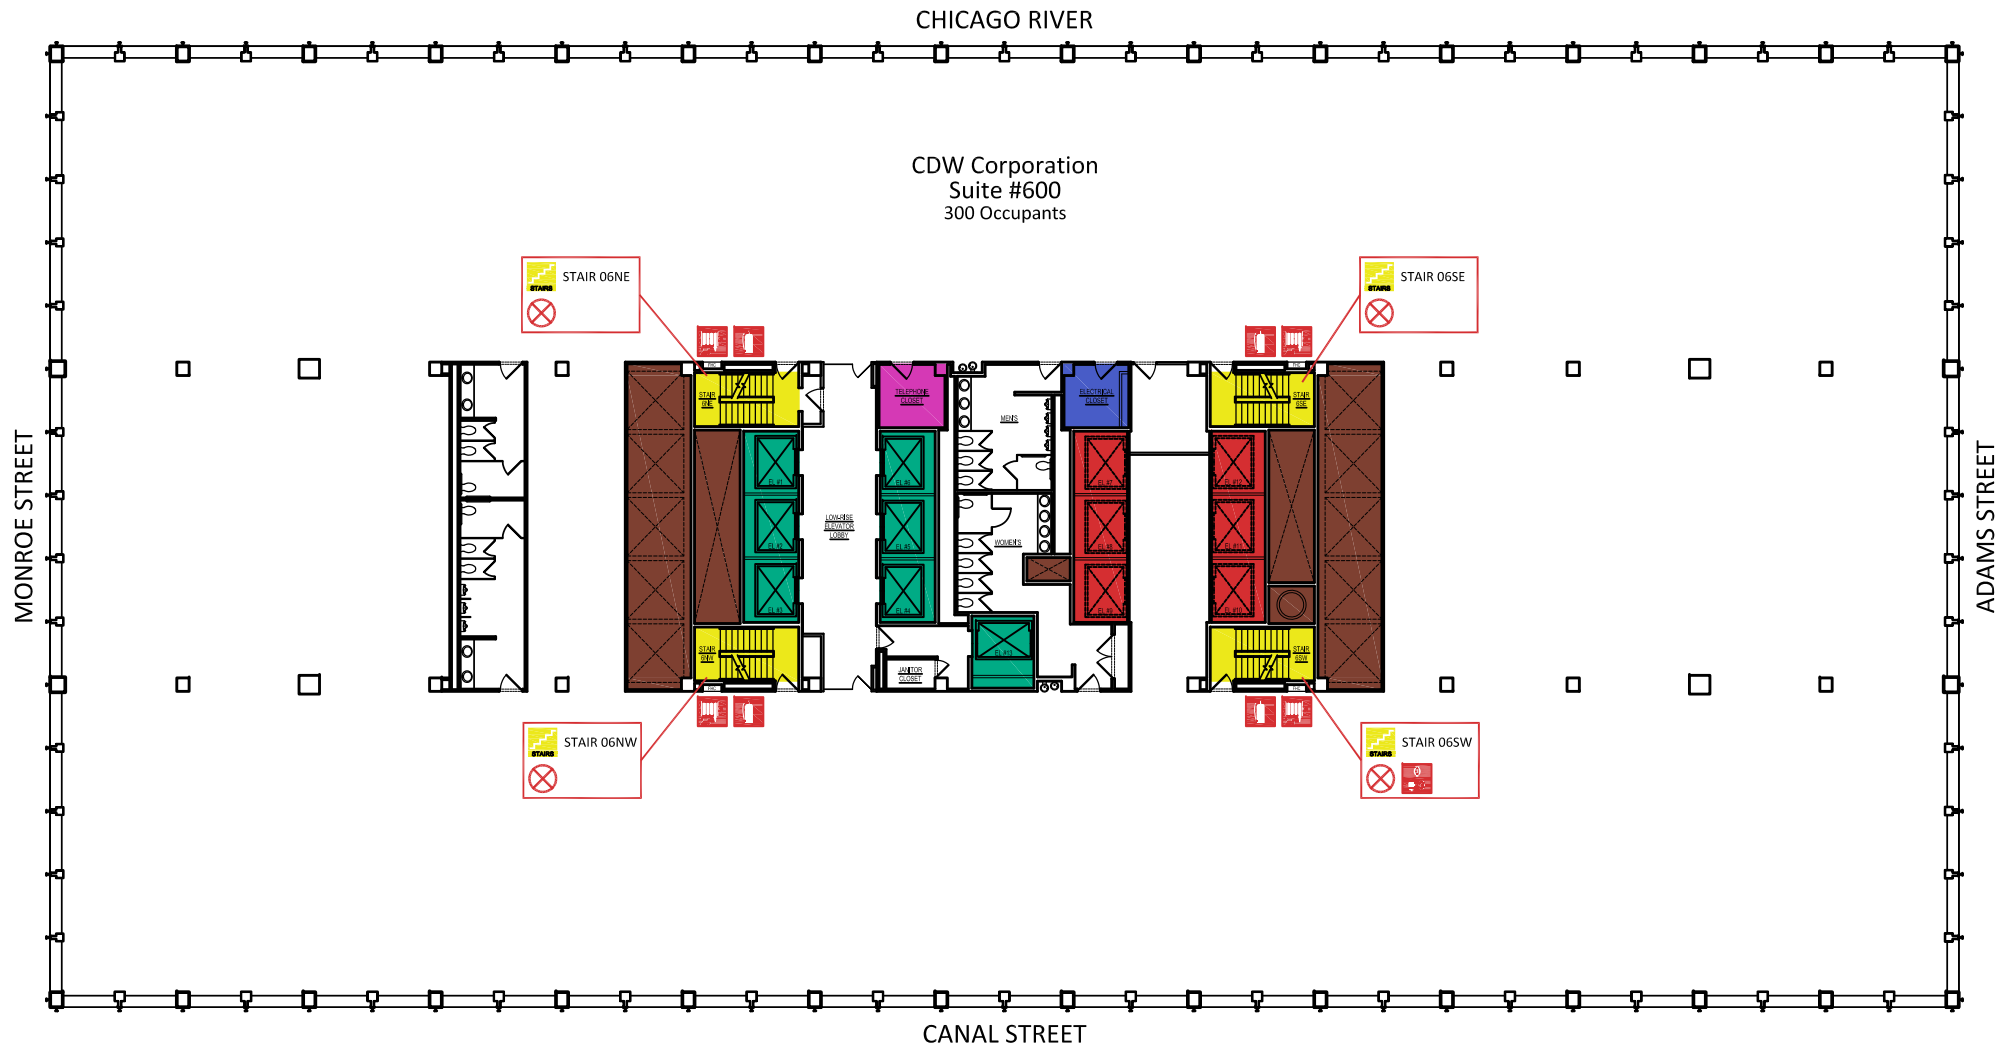



[illegible]


December 19, 2019





CDW Corporation
Suite #800
300 Occupants

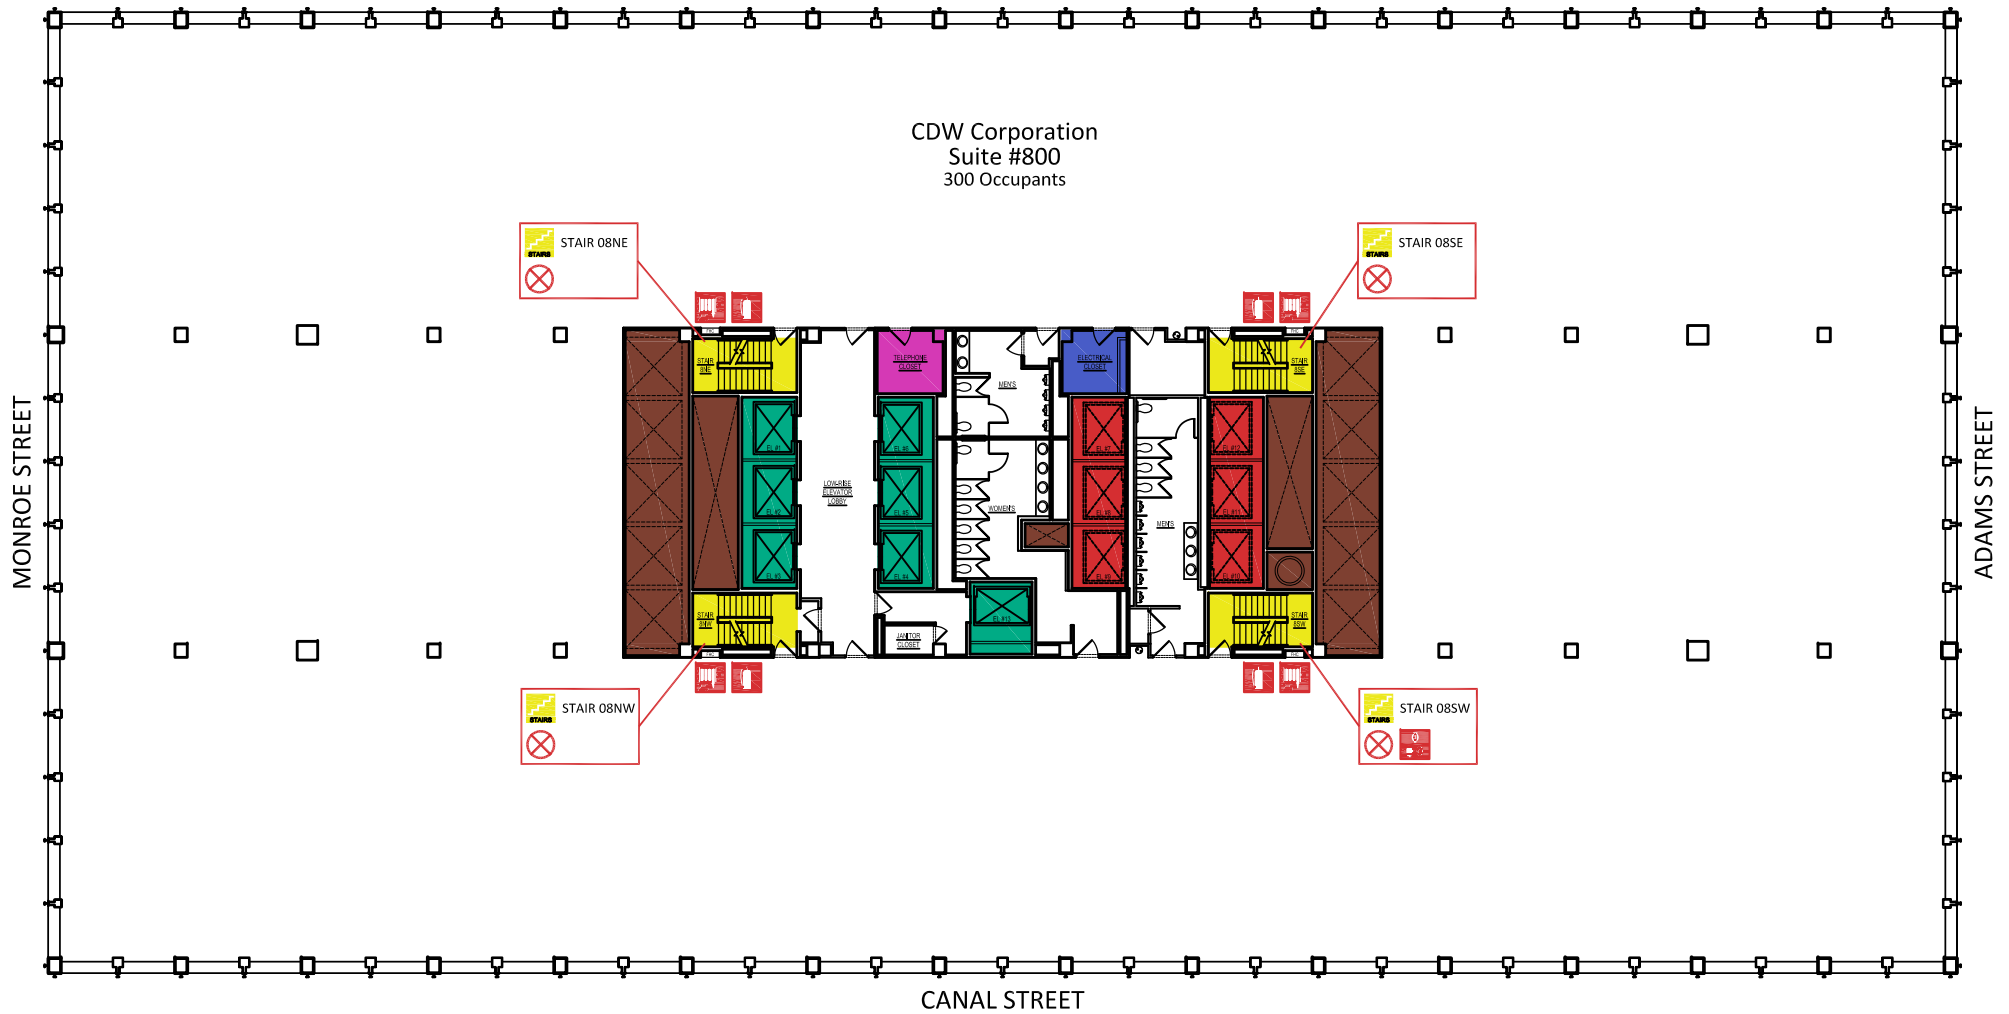


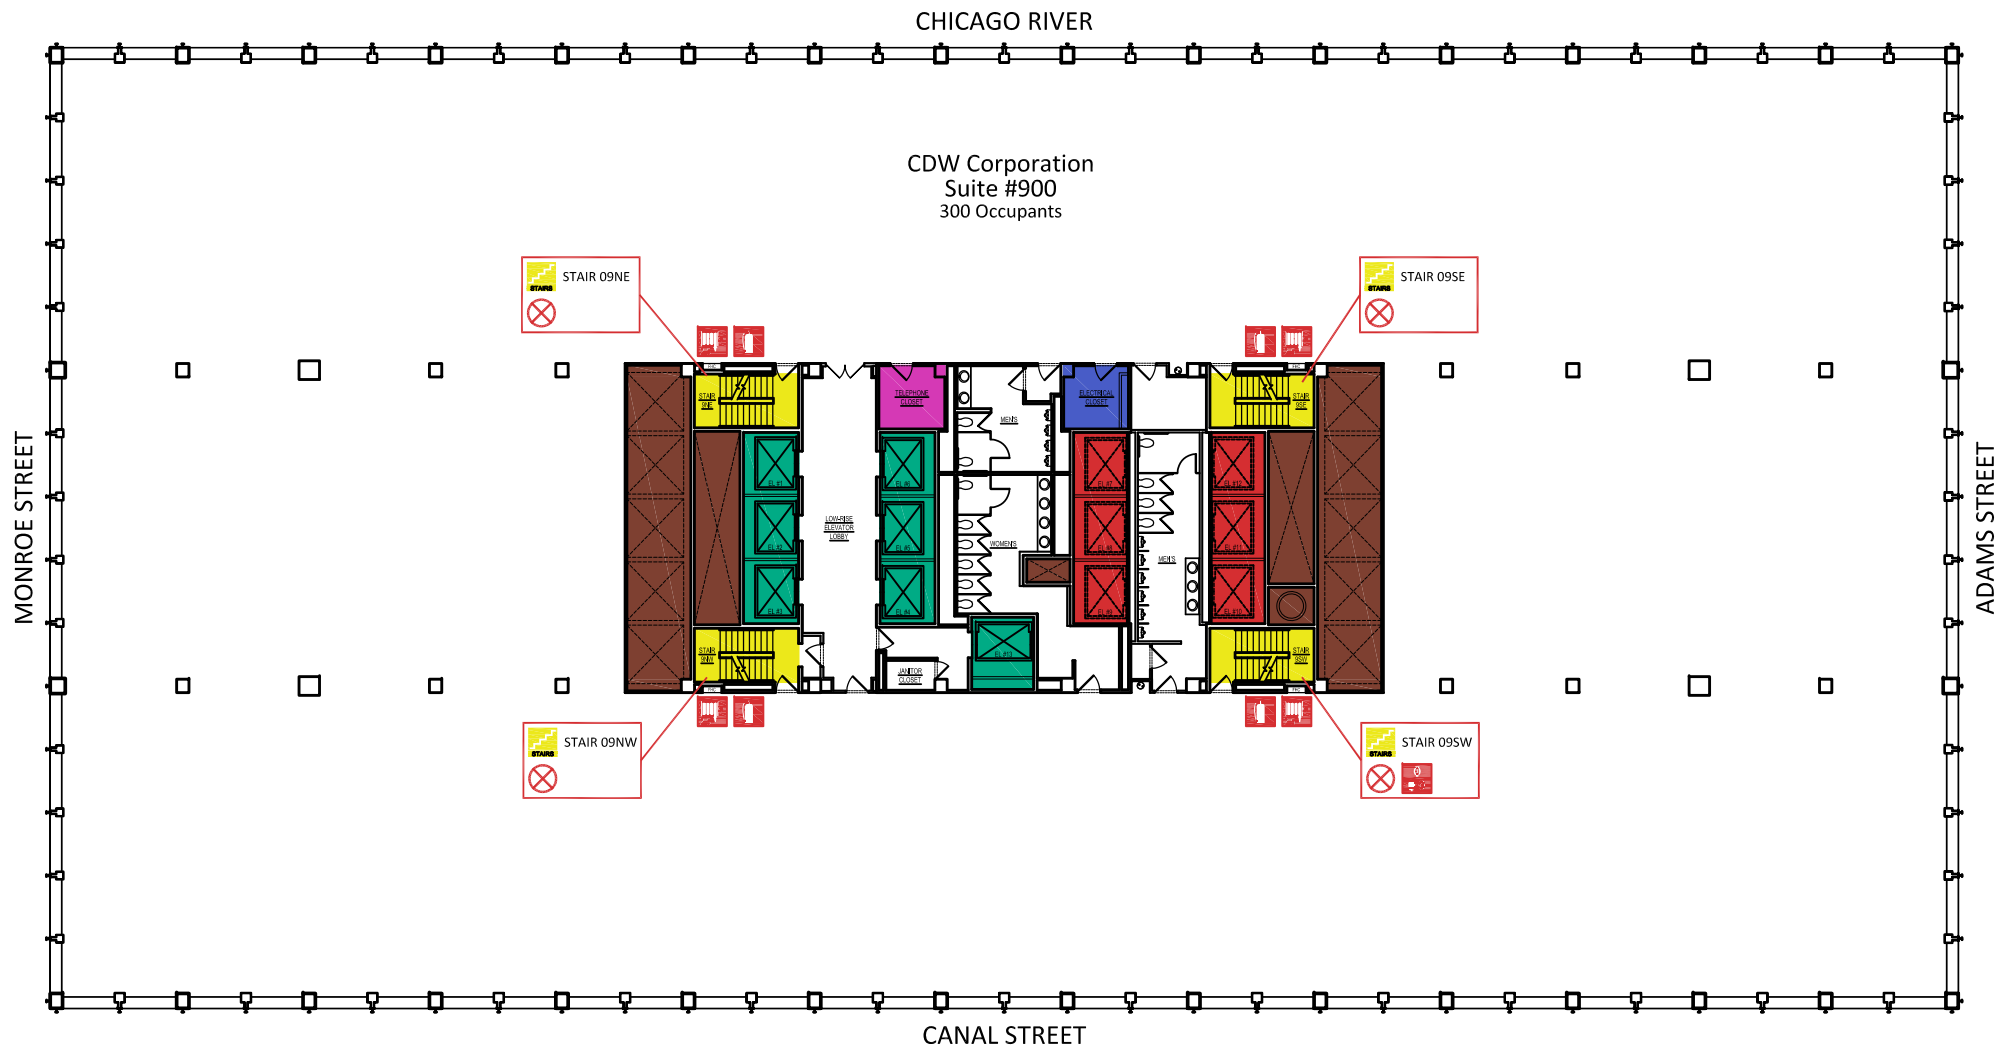


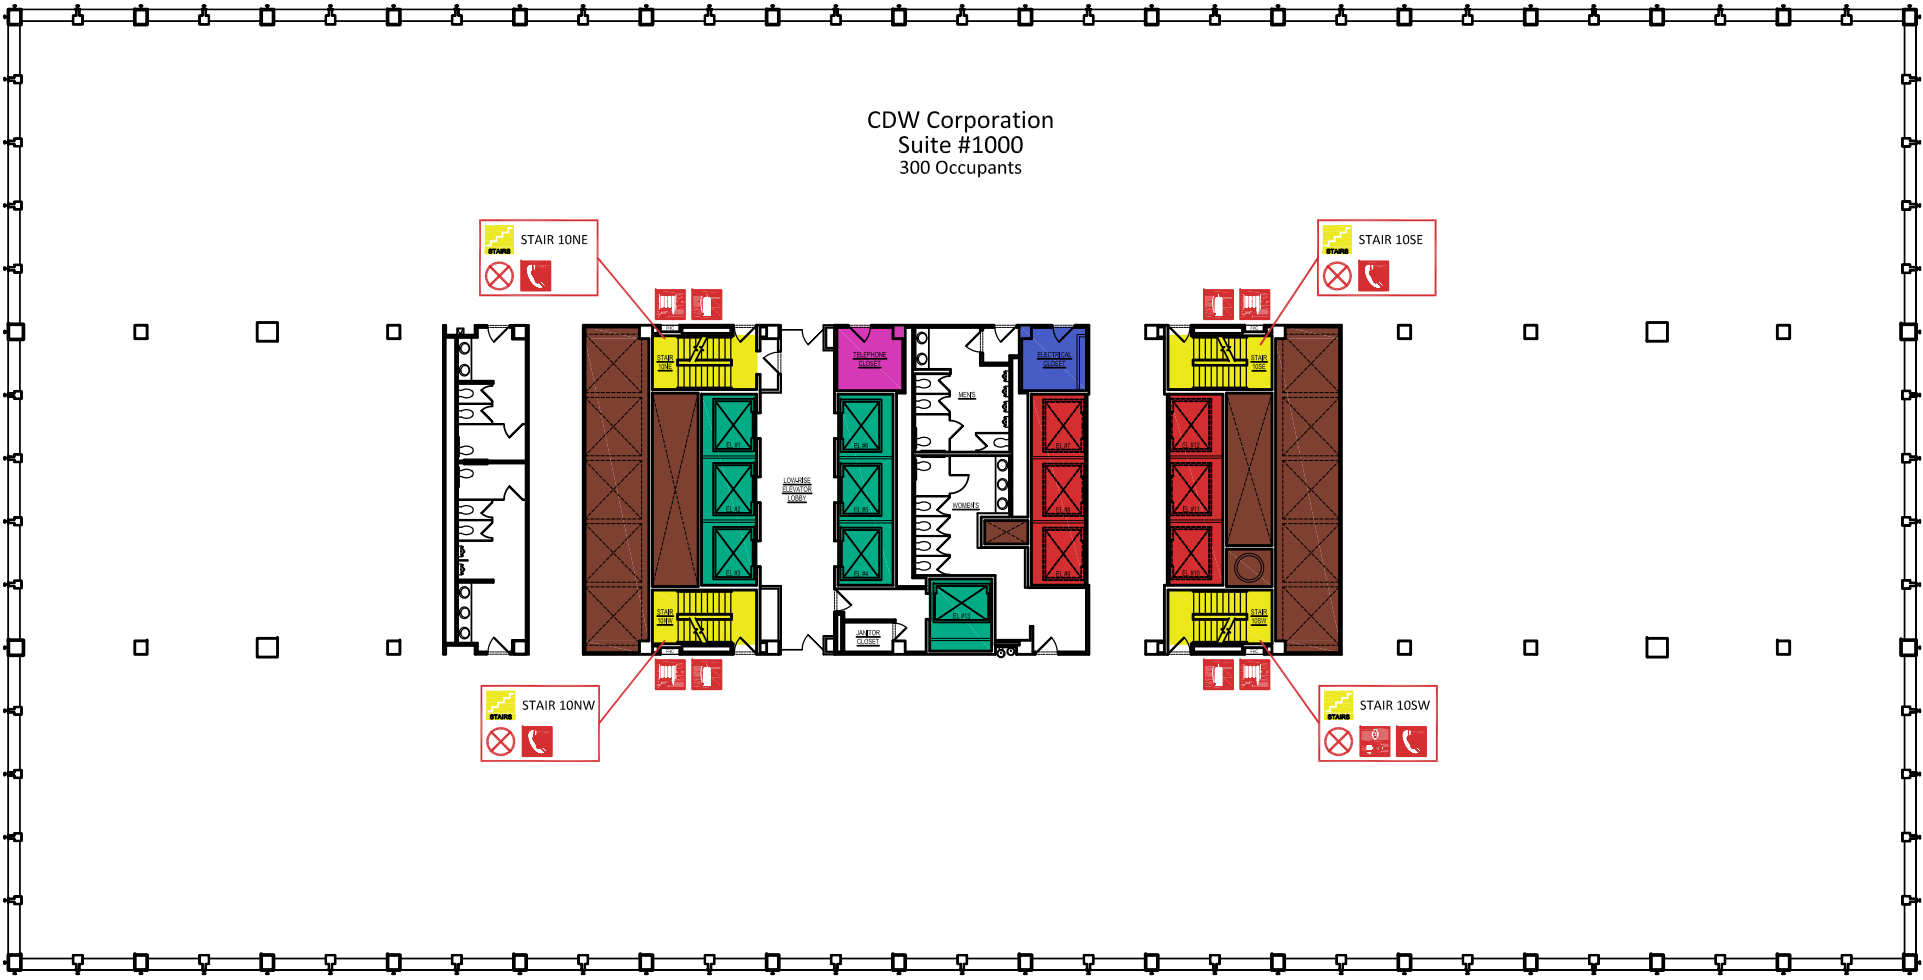
[illegible][illegible][illegible][illegible][illegible]

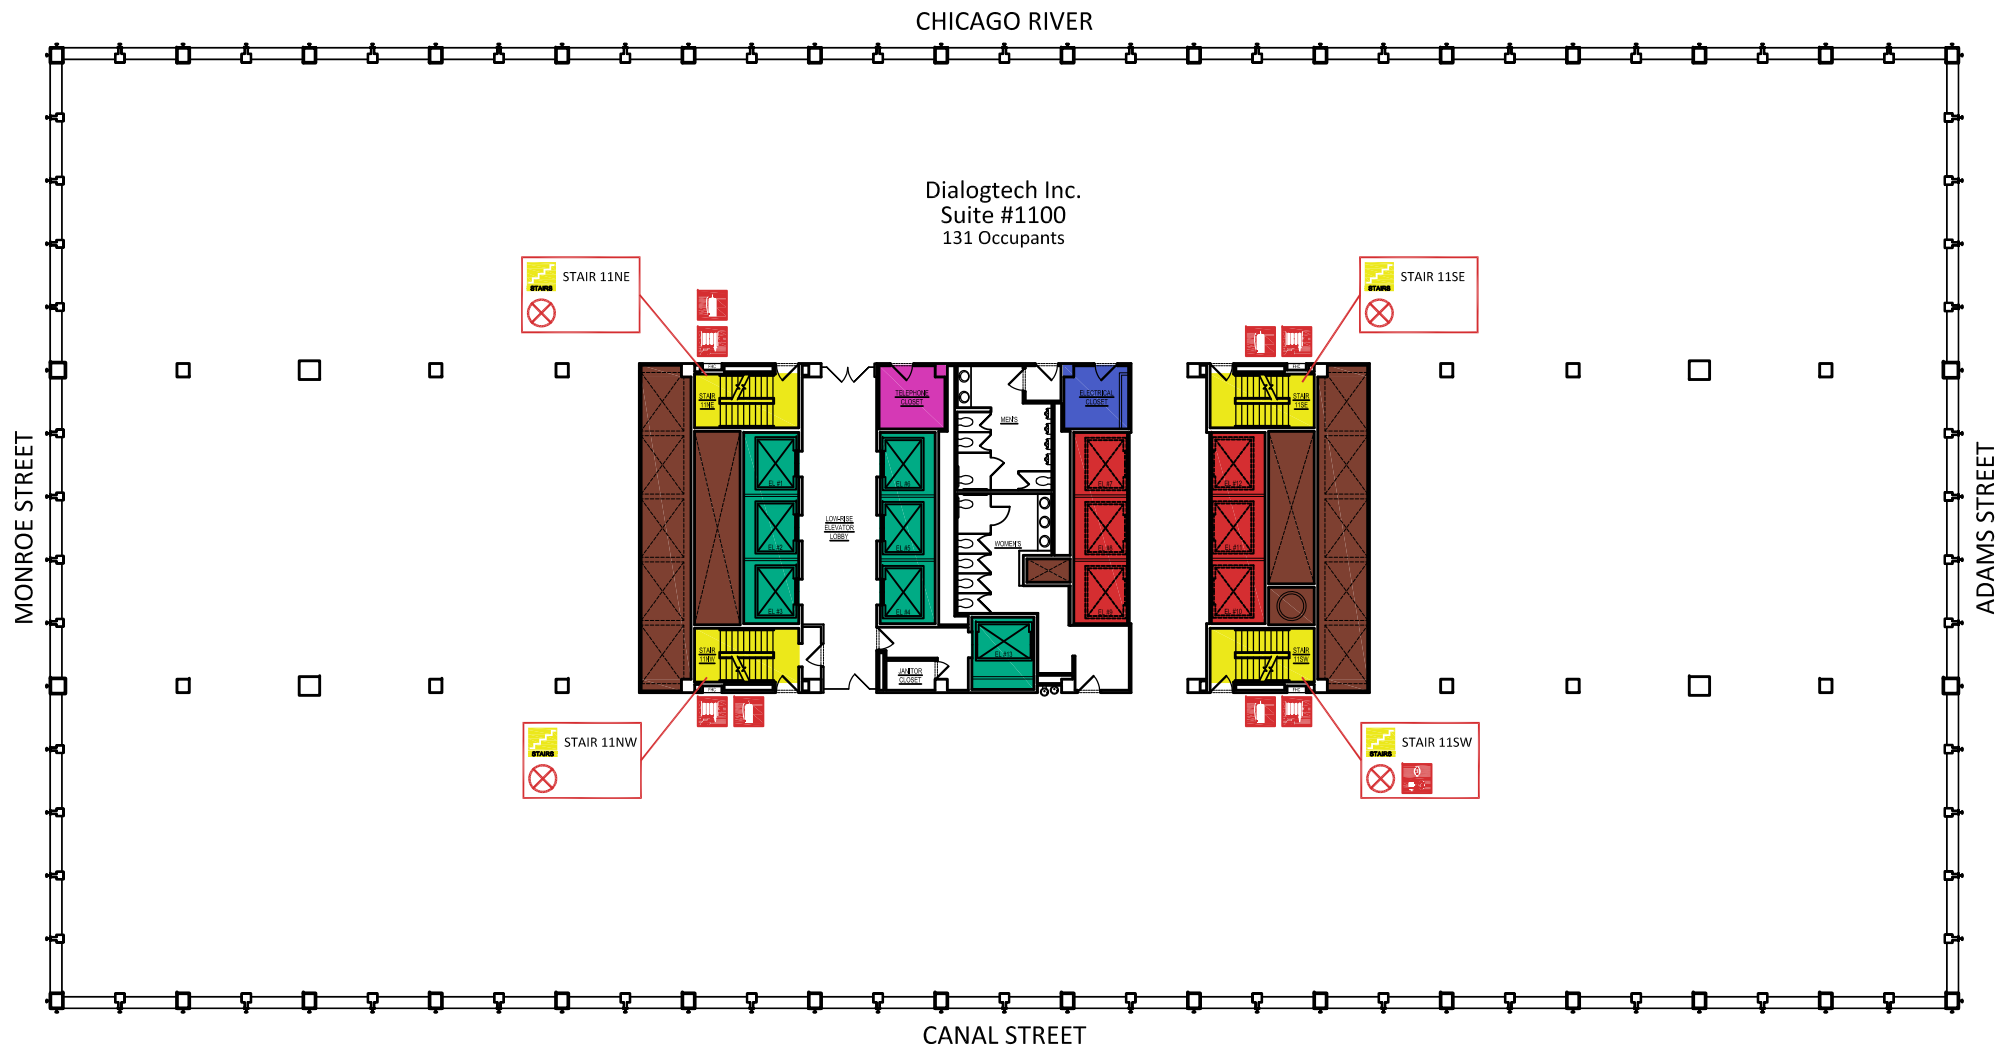


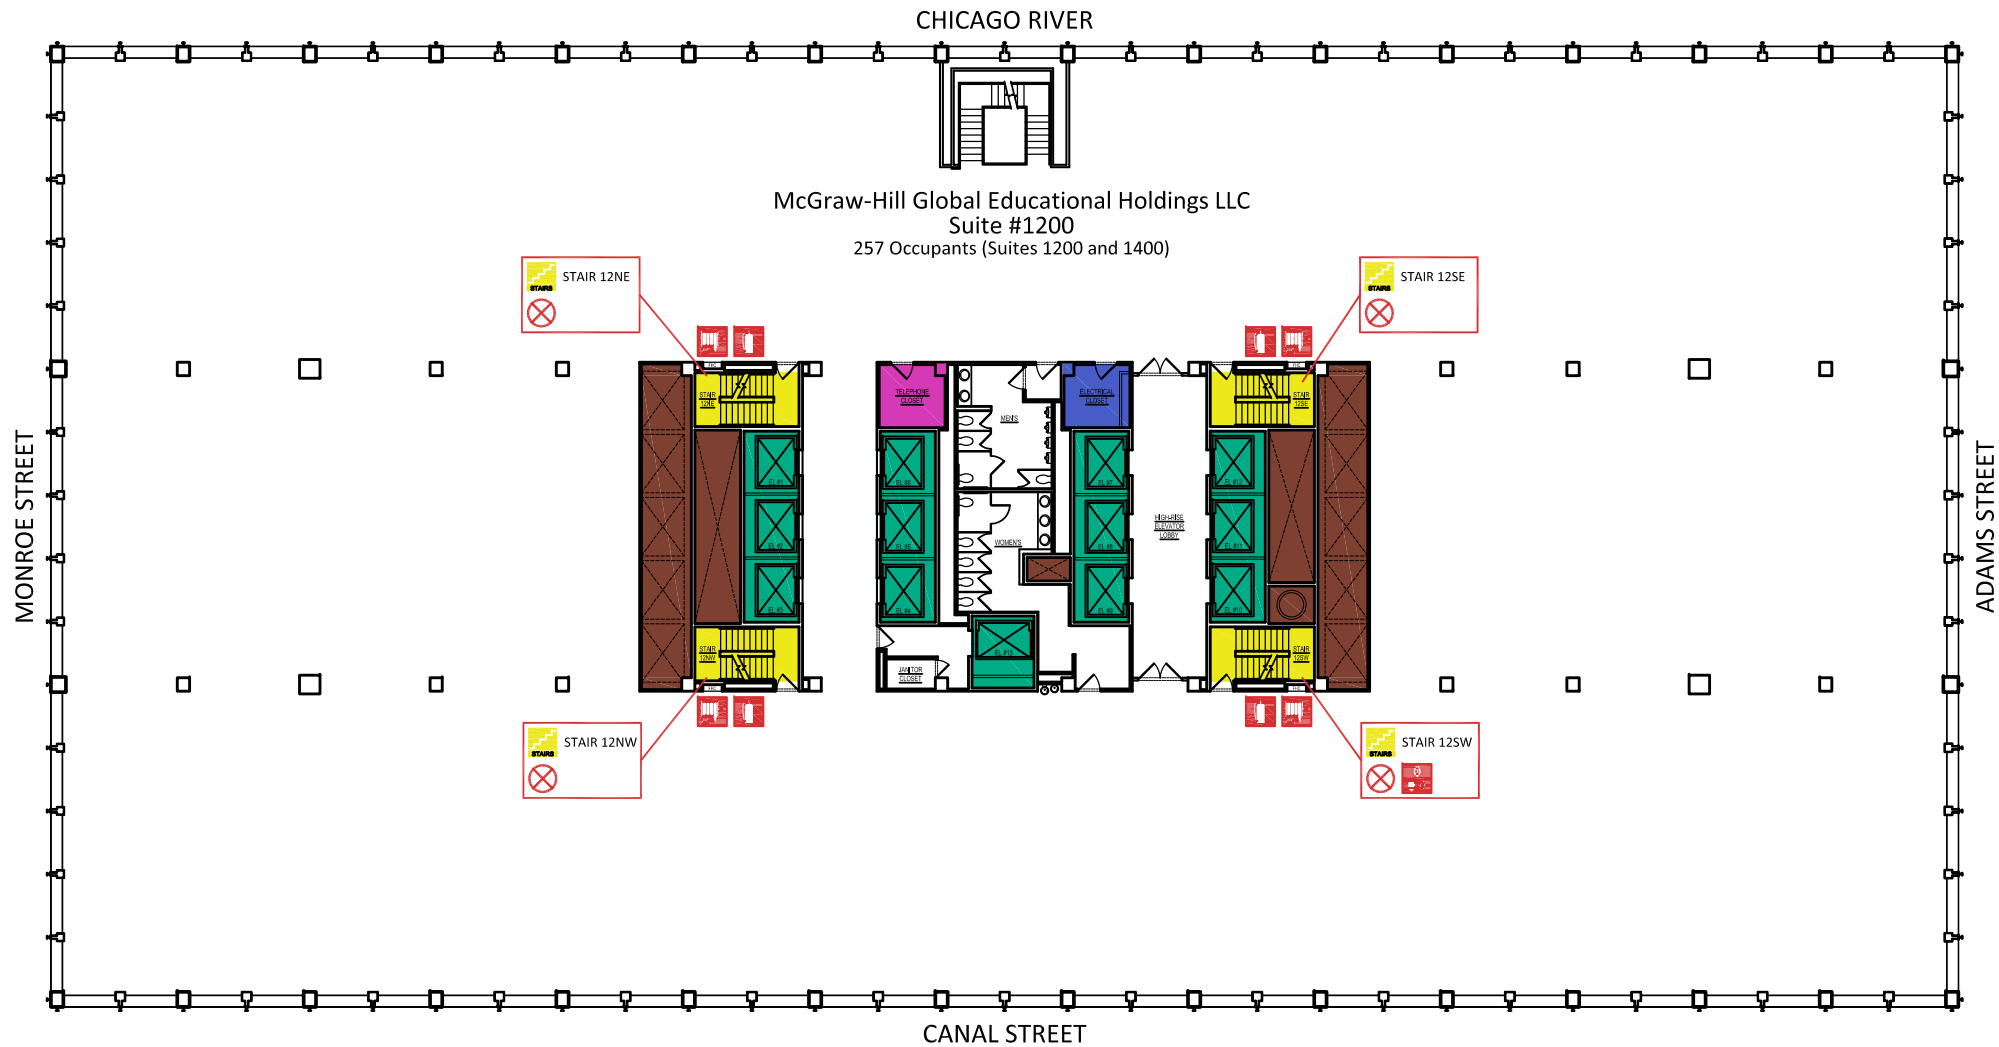


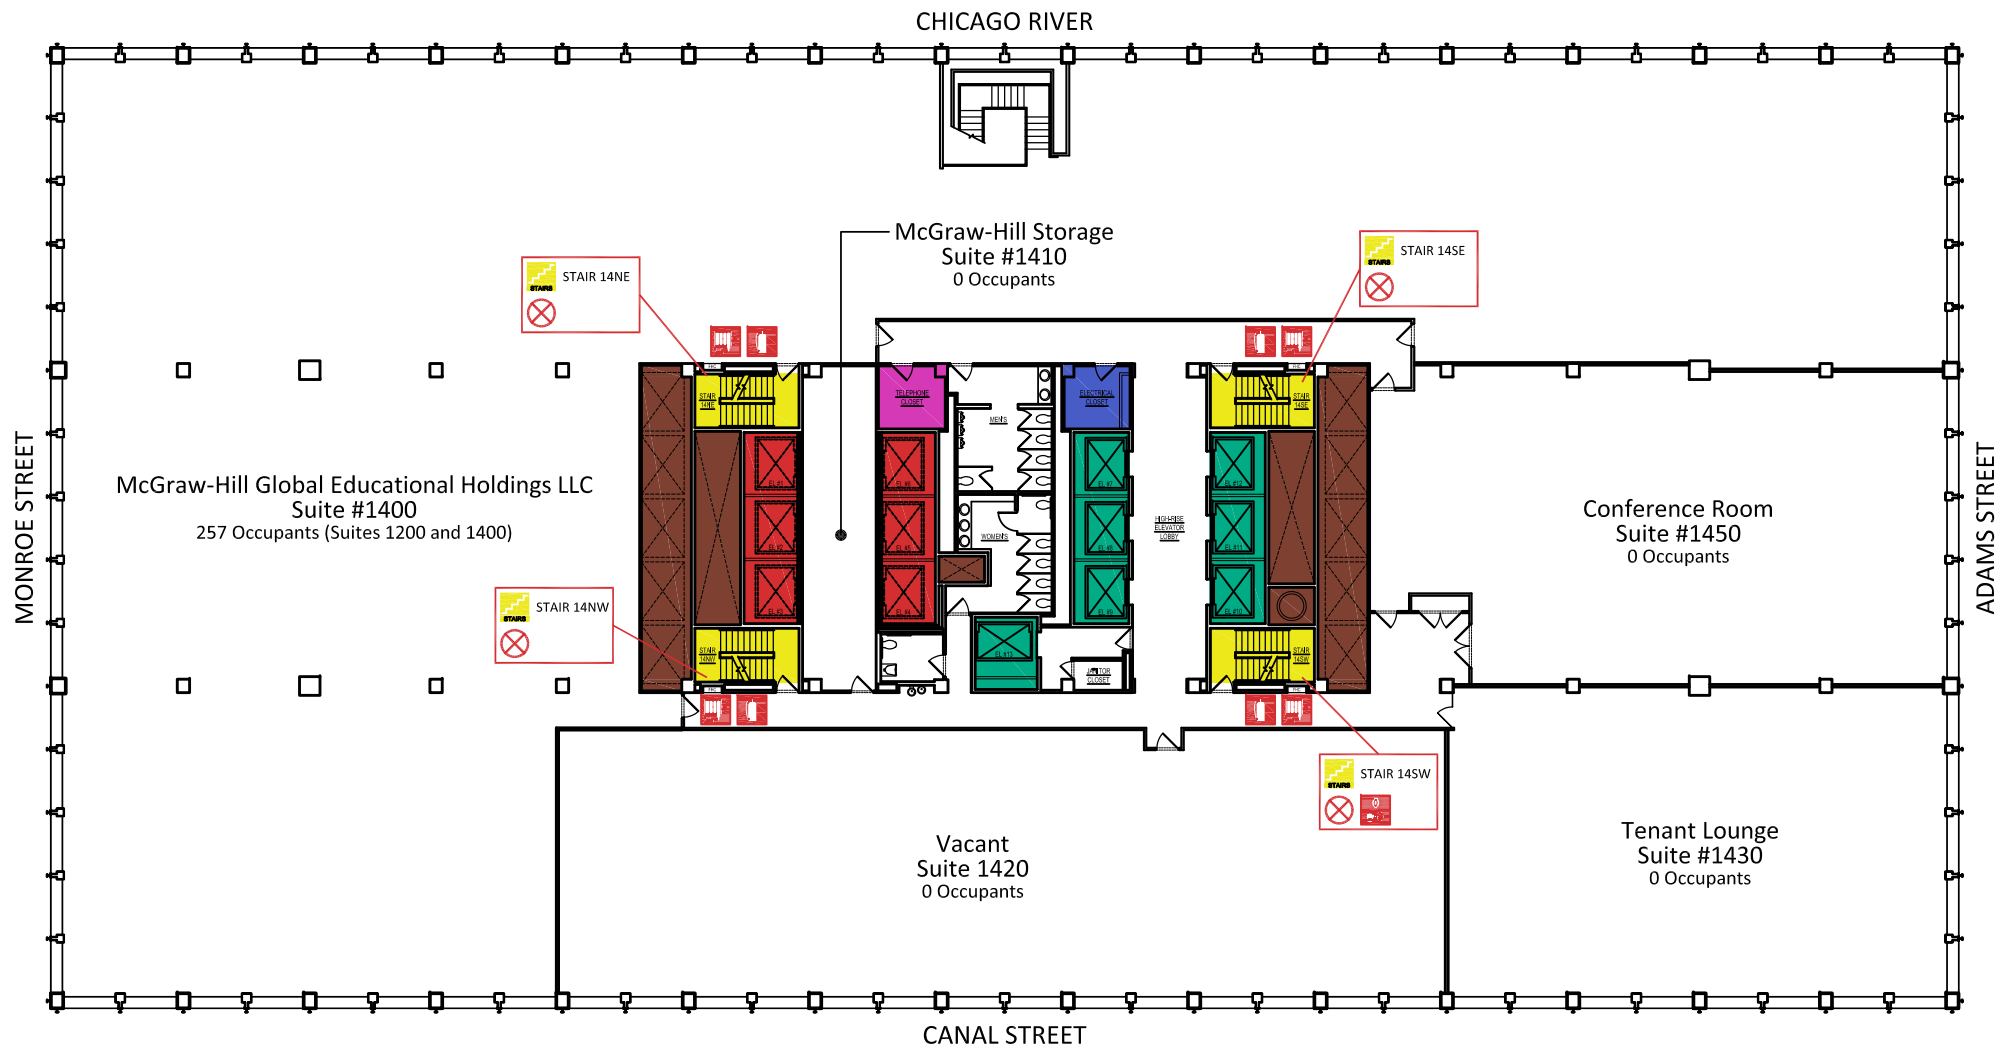

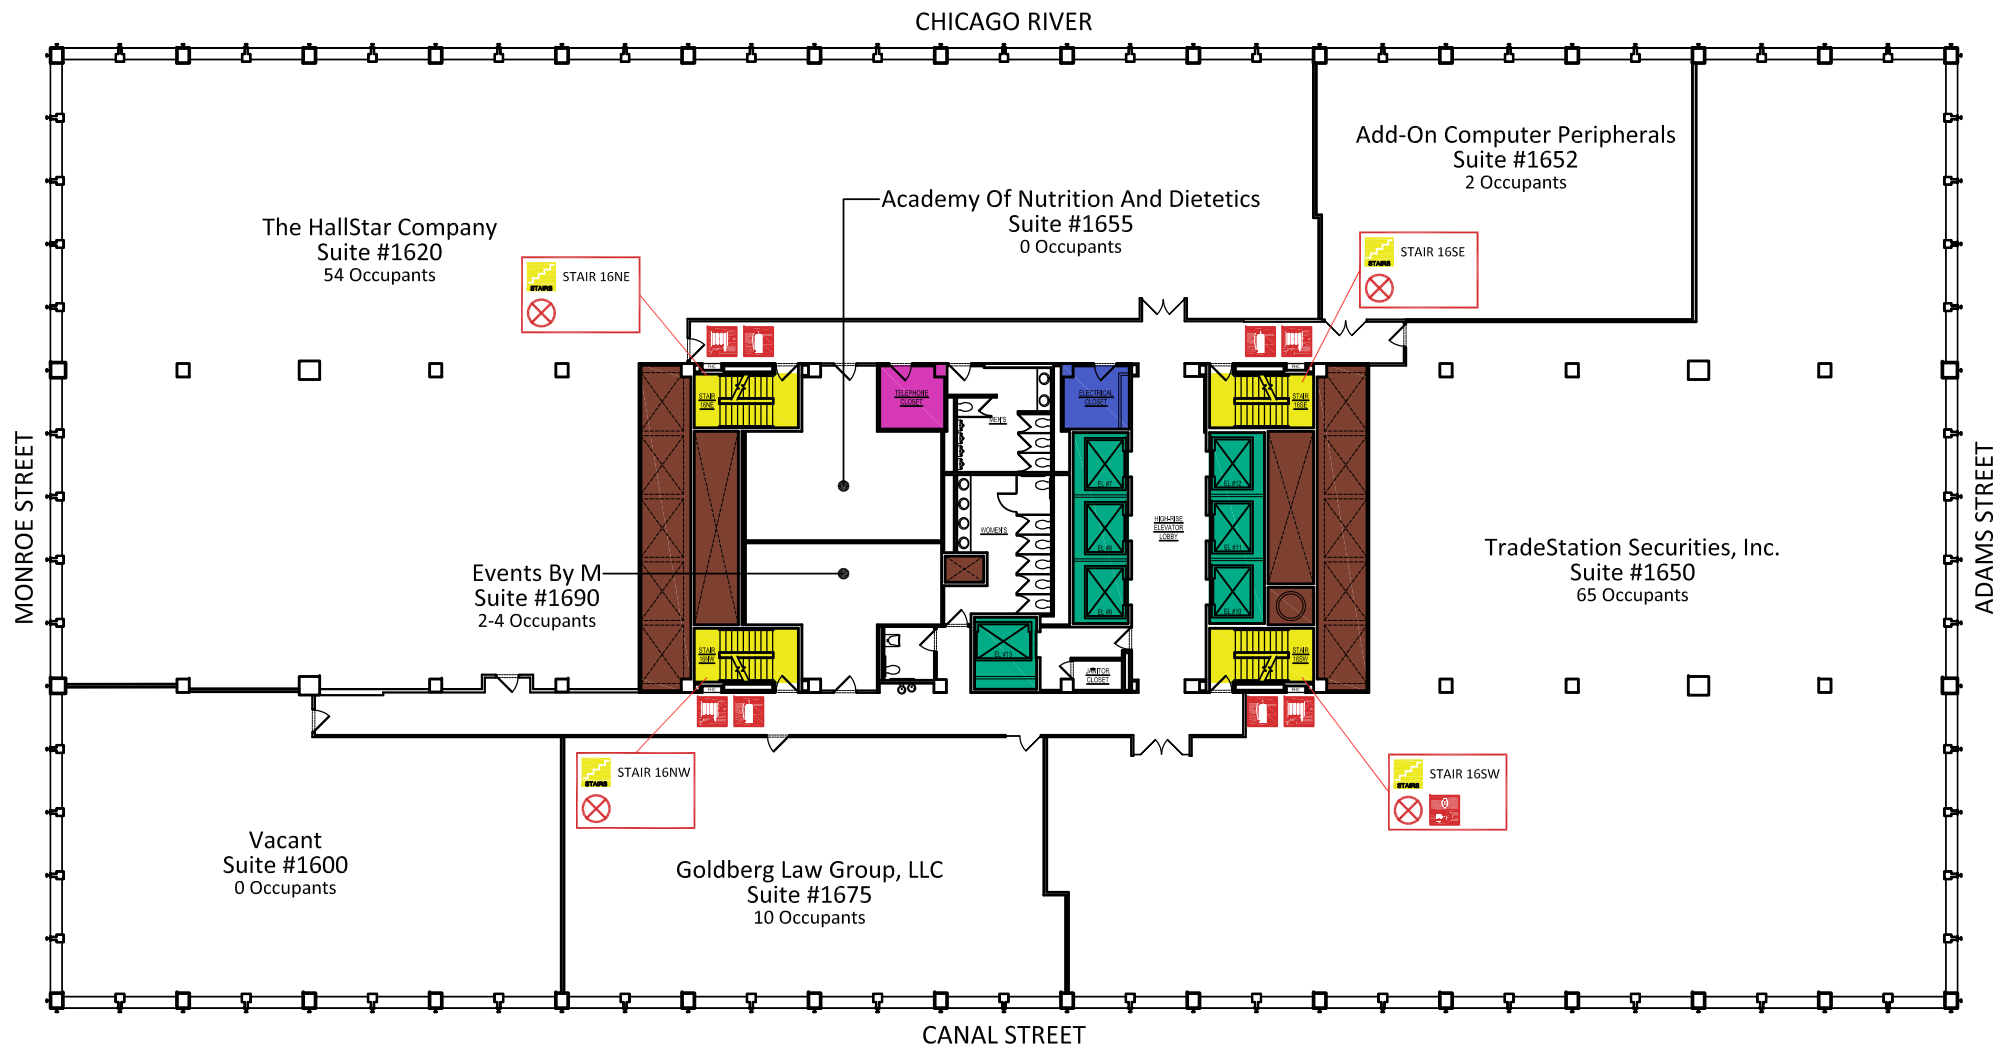

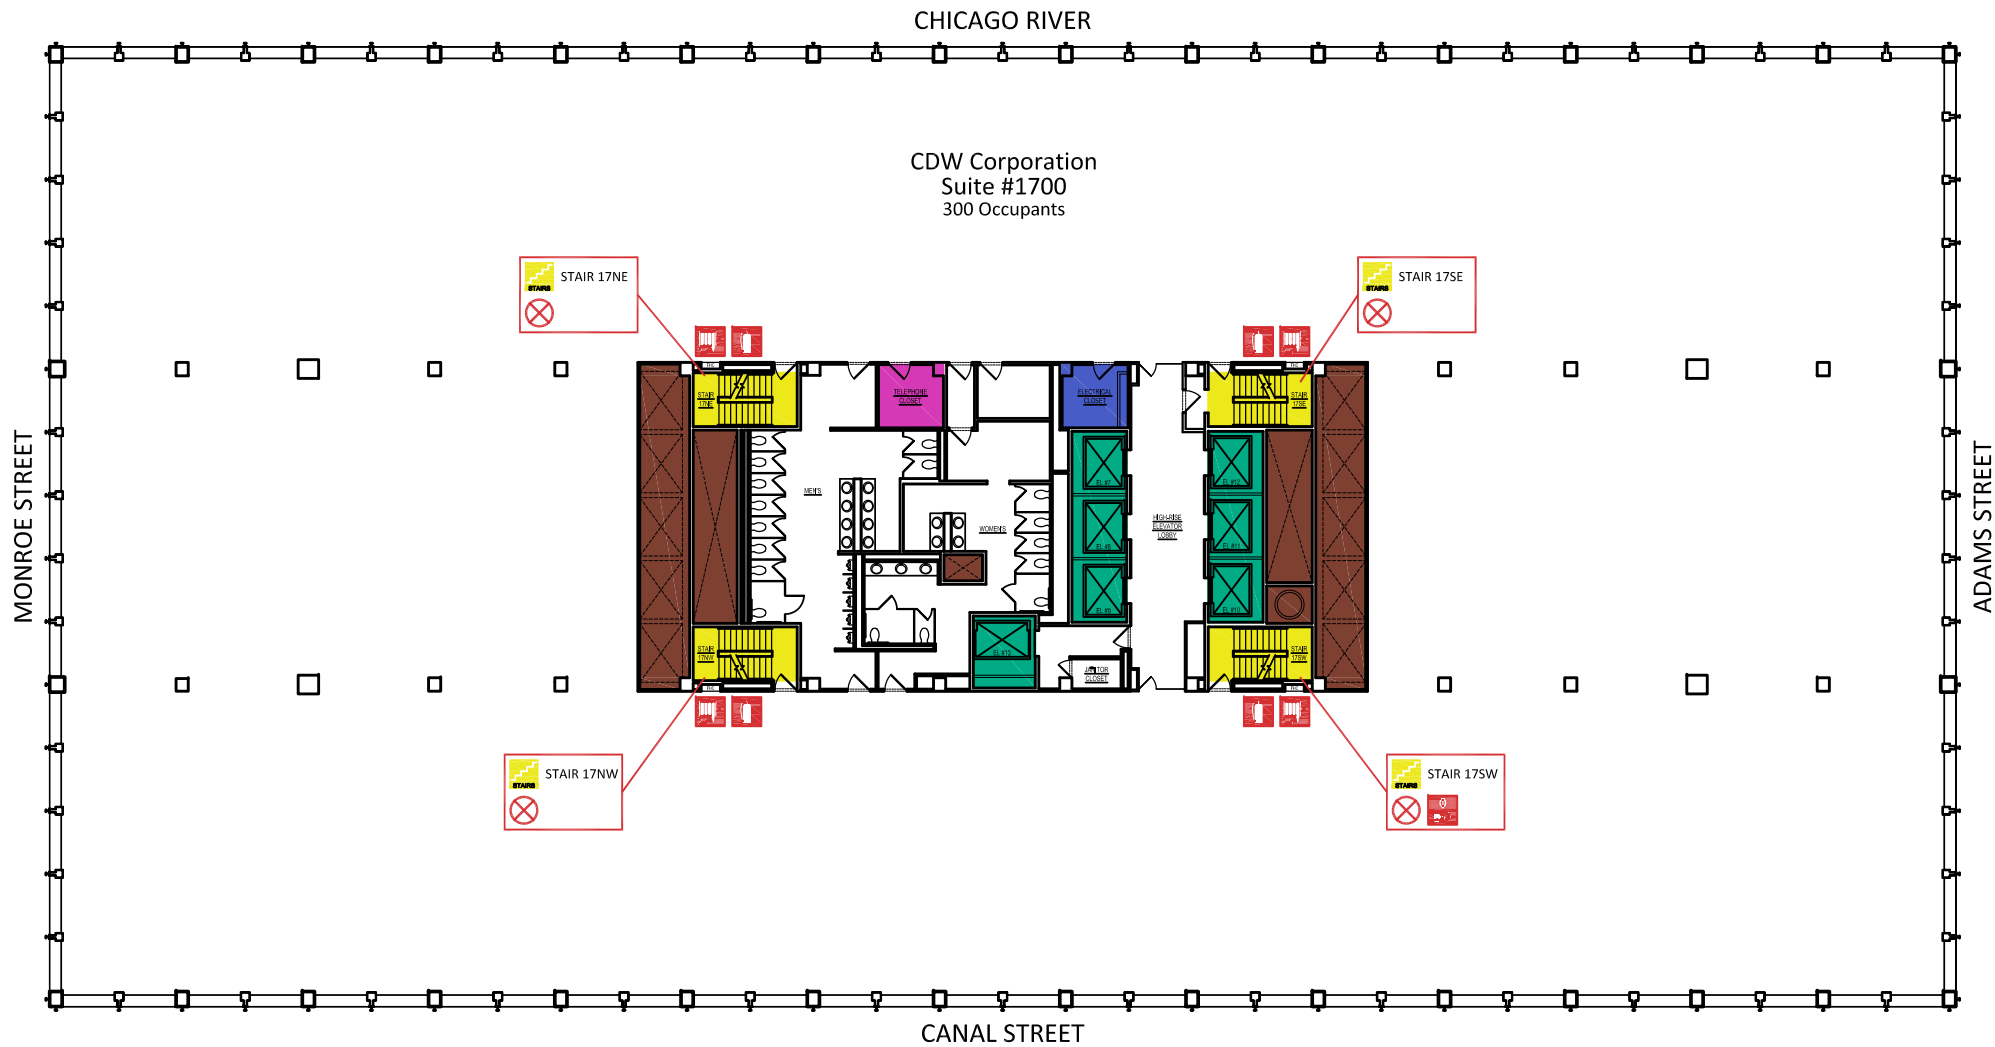

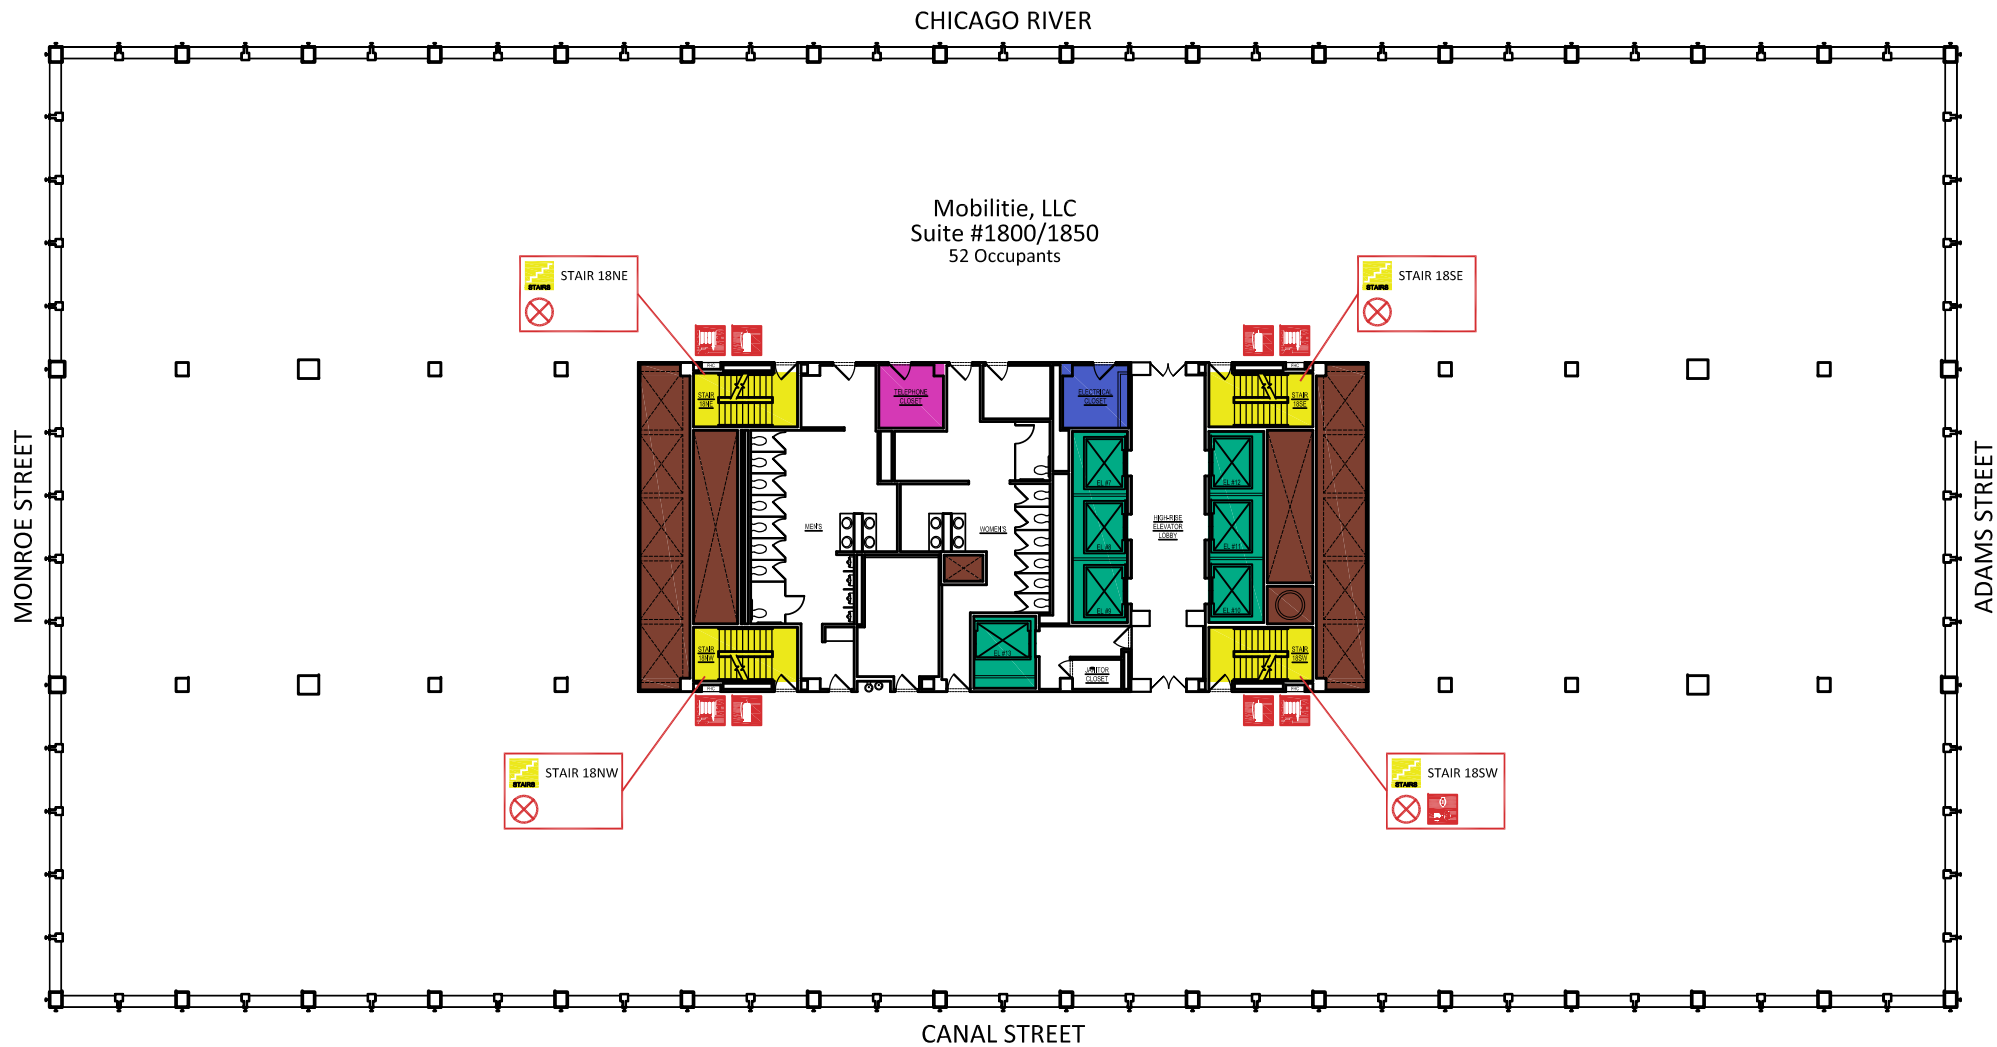

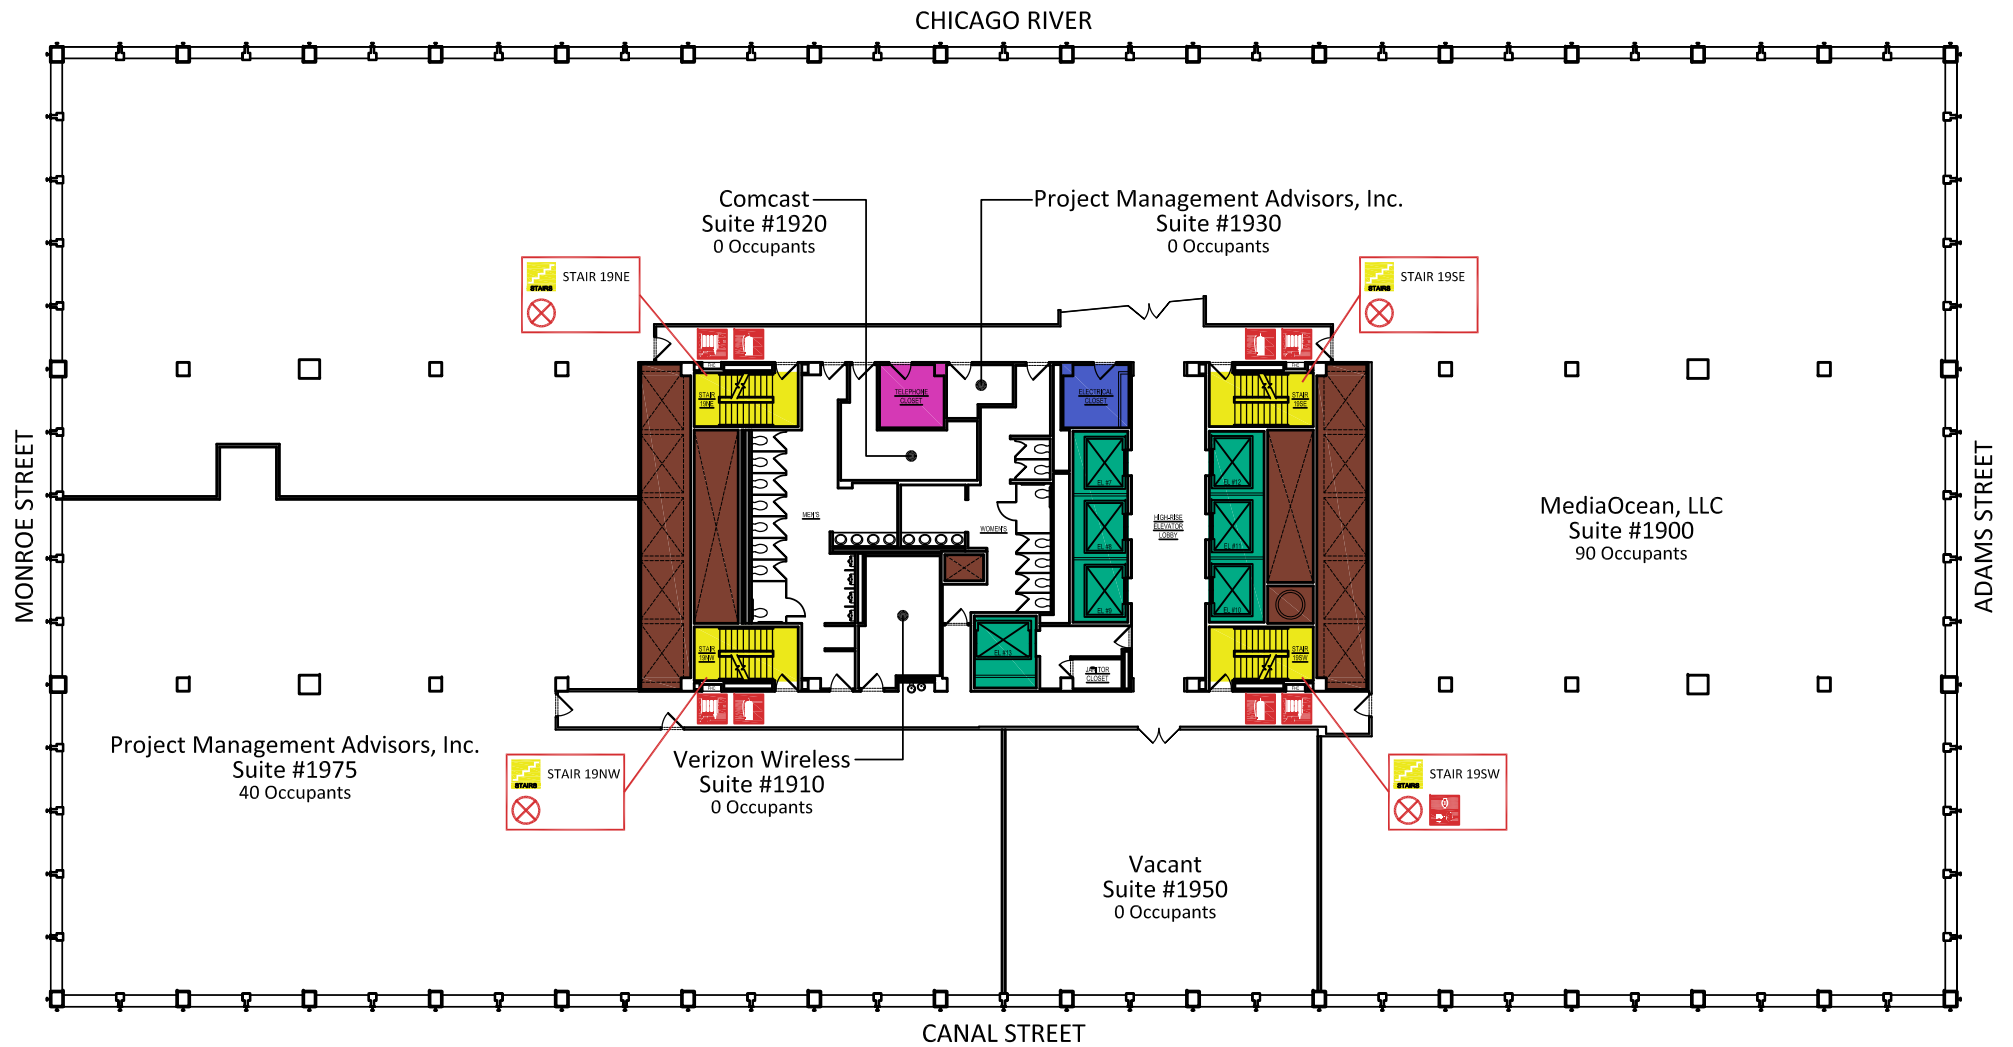

[illegible]

December 19, 2019

